



Installation, Operation, and Maintenance

Stealth™ Air-Cooled Chiller Model RTAE 150 to 300 Nominal Tons



⚠ SAFETY WARNING

Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and requires specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.



Warnings, Cautions and Notices

Warnings, Cautions and Notices. Note that warnings, cautions and notices appear at appropriate intervals throughout this manual. Warnings are provided to alert installing contractors to potential hazards that could result in death or personal injury. Cautions are designed to alert personnel to hazardous situations that could result in personal injury, while notices indicate a situation that could result in equipment or property-damage-only accidents.

Your personal safety and the proper operation of this machine depend upon the strict observance of these precautions.

Read this manual thoroughly before operating or servicing this unit.

ATTENTION: Warnings, Cautions and Notices appear at appropriate sections throughout this literature. Read these carefully:

⚠ WARNING Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.

⚠ CAUTION Indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury. It could also be used to alert against unsafe practices.

NOTICE: Indicates a situation that could result in equipment or property-damage only

Important Environmental Concerns!

Scientific research has shown that certain man-made chemicals can affect the earth's naturally occurring stratospheric ozone layer when released to the atmosphere. In particular, several of the identified chemicals that may affect the ozone layer are refrigerants that contain Chlorine, Fluorine and Carbon (CFCs) and those containing Hydrogen, Chlorine, Fluorine and Carbon (HCFCs). Not all refrigerants containing these compounds have the same potential impact to the environment. Trane advocates the responsible handling of all refrigerants-including industry replacements for CFCs such as HCFCs and HFCs.

Responsible Refrigerant Practices!

Trane believes that responsible refrigerant practices are important to the environment, our customers, and the air conditioning industry. All technicians who handle refrigerants must be certified. The Federal Clean Air Act (Section 608) sets forth the requirements for handling, reclaiming, recovering and recycling of certain refrigerants and the equipment that is used in these service procedures. In addition, some states or municipalities may have additional requirements that

must also be adhered to for responsible management of refrigerants. Know the applicable laws and follow them.

⚠ WARNING

Refrigerant under High Pressure!

System contains oil and refrigerant under high pressure. Recover refrigerant to relieve pressure before opening the system. See unit nameplate for refrigerant type. Do not use non-approved refrigerants, refrigerant substitutes, or refrigerant additives. Failure to recover refrigerant to relieve pressure or the use of non-approved refrigerants, refrigerant substitutes, or refrigerant additives could result in an explosion which could result in death or serious injury or equipment damage.

⚠ WARNING

Personal Protective Equipment (PPE) Required!

Installing/servicing this unit could result in exposure to electrical, mechanical and chemical hazards.

- Before installing/servicing this unit, technicians **MUST** put on all PPE required for the work being undertaken (Examples; cut resistant gloves/sleeves, butyl gloves, safety glasses, hard hat/bump cap, fall protection, electrical PPE and arc flash clothing). **ALWAYS** refer to appropriate Material Safety Data Sheets (MSDS)/Safety Data Sheets (SDS) and OSHA guidelines for proper PPE.
- When working with or around hazardous chemicals, **ALWAYS** refer to the appropriate MSDS/SDS and OSHA/GHS (Global Harmonized System of Classification and Labelling of Chemicals) guidelines for information on allowable personal exposure levels, proper respiratory protection and handling instructions.
- If there is a risk of energized electrical contact, arc, or flash, technicians **MUST** put on all PPE in accordance with OSHA, NFPA 70E, or other country-specific requirements for arc flash protection, **PRIOR** to servicing the unit. **NEVER PERFORM ANY SWITCHING, DISCONNECTING, OR VOLTAGE TESTING WITHOUT PROPER ELECTRICAL PPE AND ARC FLASH CLOTHING. ENSURE ELECTRICAL METERS AND EQUIPMENT ARE PROPERLY RATED FOR INTENDED VOLTAGE.**

Failure to follow instructions could result in death or serious injury.

⚠ WARNING**Proper Field Wiring and Grounding Required!**

All field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses **FIRE** and **ELECTROCUTION** hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in **NEC** and your local/state electrical codes. Failure to follow code could result in death or serious injury.

Factory Warranty Information

Compliance with the following is required to preserve the factory warranty:

All Unit Installations

Startup **MUST** be performed by Trane, or an authorized agent of Trane, to **VALIDATE** this **WARRANTY**. Contractor must provide a two-week startup notification to Trane (or an agent of Trane specifically authorized to perform startup).

Copyright

This document and the information in it are the property of Trane, and may not be used or reproduced in whole or in part without written permission. Trane reserves the right to revise this publication at any time, and to make changes to its content without obligation to notify any person of such revision or change.

Trademarks

All trademarks referenced in this document are the trademarks of their respective owners.

Revision History

RTAE-SVX001B-EN (29 Oct 2014)

- Added transformer option.
- Added harmonic filter option.
- Added 150T and 165T single circuit units.
- Added extreme low ambient option.
- Added seismic isolation option.
- Added CE/PED option.
- Updated unit weights and isolator information.
- Updated drive cooling fluid volumes.
- Modified oil sump check procedure.

RTAE-SVX001A-EN (24 Sep 2013)

New release.



Table of Contents

| | | | |
|---|----|---|----|
| Warnings, Cautions and Notices | 2 | Pressure Relief Valves | 26 |
| Factory Warranty Information | 3 | Evaporator Waterside Pressure Drop | |
| Copyright | 3 | Curves | 27 |
| Trademarks | 3 | Freeze Protection | 29 |
| Revision History | 3 | Low Evaporator Refrigerant Cutout, | |
| Model Number Description | 6 | Glycol Requirements | 30 |
| Outdoor Unit Nameplate | 6 | Installation Electrical | 31 |
| Compressor Nameplate | 6 | General Recommendations | 31 |
| Model Number Descriptions | 7 | Adaptive Frequency™ Drive (AFD ₃) | |
| Unit Model Number | 7 | Capacitor Discharge | 32 |
| Compressor Model Number | 8 | Units with Nitrogen Charge Option | 32 |
| Compressor Serial Number | 8 | Installer-Supplied Components | 32 |
| General Information | 9 | Power Supply Wiring | 33 |
| Unit Description | 9 | Control Power Supply | 34 |
| Accessory/Option Information | 9 | Service Power Connection | 34 |
| General Data | 10 | Heater Power Supply | 34 |
| Drive Cooling System | 11 | Interconnecting Wiring | 35 |
| Pre-Installation | 12 | Chilled Water Pump Control | 35 |
| Unit Inspection | 12 | Programmable Relays | 35 |
| Inspection | 12 | Relay Assignments Using Tracer™ TU | 36 |
| Storage | 12 | Low Voltage Wiring | 36 |
| Installation Requirements | 13 | Emergency Stop | 36 |
| Dimensions and Weights | 14 | External Auto/Stop | 36 |
| Weights | 14 | External Circuit Lockout – | |
| Unit Dimensions | 14 | Circuit #1 and #2 | 36 |
| Service Clearances | 14 | Ice Building Option | 37 |
| Installation Mechanical | 15 | External Chilled Water Setpoint (ECWS) | |
| Location Requirements | 15 | Option | 37 |
| Sound Considerations | 15 | External Demand Limit Setpoint (EDLS) | |
| Foundation | 15 | Option | 37 |
| Clearances | 15 | Chilled Water Reset (CWR) | 38 |
| Center of Gravity | 20 | Transformer Power Rating | 39 |
| Isolation and Sound Emission | 20 | Communications Interface | 39 |
| Unit Isolation and Leveling | 20 | LonTalk Interface (LCI-C) | 39 |
| Compressor Shipping Bolt Removal | 23 | BACnet Interface (BCI-C) | 39 |
| Units with InvisiSound™ Ultimate Option | | Modbus Remote Terminal Unit Interface | 39 |
| (Model Number Digit 12 = 3) | 23 | Operating Principals | 40 |
| Drainage | 23 | Refrigeration Circuits | 40 |
| Evaporator Piping Components | 25 | Refrigeration Cycle | 40 |
| | | Refrigerant R-134a | 40 |

| | | | |
|---|----|--|----|
| Compressor and Lube Oil System | 40 | Running (Lag Compressor/Circuit Start and Run) | 63 |
| Condenser and Fans | 40 | Satisfied Setpoint | 64 |
| Evaporator | 41 | Normal Shutdown to Stopped or Run Inhibit | 65 |
| Drive Cooling System | 41 | Immediate Shutdown to Stopped or Run Inhibit | 65 |
| Controls | 42 | Ice Making (Running to Ice Making to Running) | 66 |
| UC800 Specifications | 42 | Ice Making (Auto to Ice Making to Ice Making Complete) | 67 |
| Wiring and Port Descriptions | 42 | Maintenance | 68 |
| Communication Interfaces | 43 | Recommended Maintenance | 69 |
| Rotary Switches | 43 | Weekly | 69 |
| LED Description and Operation | 43 | Monthly | 69 |
| Tracer AdaptiView TD7 Display | 43 | Annual | 69 |
| Operator Interface | 43 | Refrigerant and Oil Charge Management .69 | |
| Main Display Area/Home Screen | 44 | Lubrication System | 69 |
| Viewing Chiller Operating Modes | 44 | Oil Sump Level Check | 69 |
| Alarms | 46 | Drive Cooling System | 71 |
| Reports | 47 | Service Intervals | 71 |
| Equipment Settings | 49 | Unit Diagnostics | 71 |
| Display Settings | 51 | pH Test | 71 |
| Viewing the Settings Screen | 51 | Pressure Relief Cap | 71 |
| Cleaning the Display | 52 | Drive Cooling Expansion Tank | 71 |
| Security Settings | 52 | Condenser Coils — Cleaning and Inspection | 72 |
| Disabling/Enabling Security | 52 | Coil Cleaning and Inspection Interval | 72 |
| InvisiSound Ultimate - Noise Reduction Mode | 54 | Cleaning Air Side of RTAE Coils | 72 |
| Tracer™ TU | 55 | Cleaning Coated Coils | 72 |
| Pre-Start | 56 | Coil Corrosion Protection Inspection | 72 |
| Start-Up and Shutdown | 57 | Reinstallation of Compressor Shipping Bolts | 72 |
| Unit Start-Up | 57 | Servicing Chiller Roof | 72 |
| Temporary Shutdown And Restart | 57 | Diagnostics | 73 |
| Extended Shutdown Procedure | 57 | AFD Diagnostics | 73 |
| Seasonal Unit Start-Up Procedure | 58 | Main Processor Diagnostics | 76 |
| System Restart After Extended Shutdown | 58 | Communication Diagnostics | 85 |
| Sequence of Operation | 59 | Operator Display Diagnostics and Messages | 88 |
| Software Operation Overview | 59 | Unit Wiring | 89 |
| Timelines | 59 | Log and Check Sheet | 90 |
| Power Up Diagram | 60 | | |
| Power Up to Starting | 61 | | |
| Stopped to Starting | 62 | | |
| Running (Lead Compressor/Circuit Start and Run) | 63 | | |



Model Number Description

Nameplates

The Stealth™ outdoor unit nameplates are applied to the exterior of the Control Panel. A compressor nameplate is located on each compressor. When the unit arrives, compare all nameplate data with ordering, submittal, and shipping information.

Outdoor Unit Nameplate

See [Figure 1](#) for a typical unit nameplate. The outdoor unit nameplate provides the following information:

- Unit model and size description.
- Unit serial number.
- Identifies unit electrical requirements.
- Lists correct operating charges of R-134a and refrigerant oil (Trane OIL00311).
- Lists unit test pressures.
- Identifies installation, operation and maintenance and service data literature.
- Lists drawing numbers for unit wiring diagrams.

Model Number Coding System

The model numbers for the unit and the compressor are composed of numbers and letters that represent features of the equipment. Shown in the following table is a sample

of typical unit model number and the coding system for each.

Each position, or group of positions, in the model number is used to represent a feature. For example, in the first table, position 08 of the unit model number, Unit Voltage, contains the number "4". A 4 in this position means that the unit voltage is 460/60/3.

Unit Model Number. An example of a typical unit model number (M/N) is:

RTAE 200F UA01 AA1F N1X1 A1A0 0CB0 X02X AA03 000

Model number digits are selected and assigned in accordance with the definitions as listed in "[Unit Model Number](#)," p. 7.

Compressor Nameplate

The compressor nameplate provides the following information:

- Compressor model number. See "[Compressor Model Number](#)," p. 8.
- Compressor serial number. See "[Compressor Serial Number](#)," p. 8.
- Compressor electrical characteristics.
- Utilization range.
- Recommended refrigerant.

Figure 1. Typical unit nameplate

Model Number Descriptions

Unit Model Number

Digits 1,2 – Unit Model

RT = Rotary Chiller

Digits 3 – Unit Type

A = Air-cooled

Digits 4 – Development Sequence

E = Development Sequence

Digits 5-7 – Nominal Capacity

149 = 150 Nominal Tons Single Circuit
 164 = 165 Nominal Tons Single Circuit
 150 = 150 Nominal Tons
 165 = 165 Nominal Tons
 180 = 180 Nominal Tons
 200 = 200 Nominal Tons
 225 = 225 Nominal Tons
 250 = 250 Nominal Tons
 275 = 275 Nominal Tons
 300 = 300 Nominal Tons

Digit 8 – Unit Voltage

A = 200/60/3
 B = 230/60/3
 C = 380/50/3
 D = 380/60/3
 E = 400/50/3
 F = 460/60/3
 G = 575/60/3
 H = 400/60/3

Digit 9 – Manufacturing Location

U = Trane Commercial Systems, Pueblo, CO USA

Digits 10, 11 – Design Sequence

** = Factory assigned

Digit 12 – Unit Sound Package

1 = InvisiSound™ Standard Unit
 2 = InvisiSound Superior (Line Wraps, Reduced Fan Speed)
 3 = InvisiSound Ultimate (Compressor Sound Attenuation, Line Wraps, Reduced Fan Speed)

Digit 13 – Agency Listing

0 = No Agency Listing
 A = UL/CUL Listing
 C = CE European Safety Standard

Digit 14 – Pressure Vessel Code

A = ASME Pressure Vessel Code
 D = Australia Pressure Vessel Code
 C = CRN or Canada Equivalent Pressure Vessel Code
 L = Chinese Pressure Vessel Code
 P = PED European Pressure Vessel Code

Digit 15 – Factory Charge

1 = Refrigerant Charge HFC-134a
 2 = Nitrogen Charge

Digit 16 – Evaporator Application

F = Standard Cooling (40 to 68°F/5.5 to 20°C)
 G = Low Temp Process (<40°F Leaving Temp)
 C = Ice-making (20 to 68°F/-7 to 20°C) w/ Hardwired Interface

Digit 17 – Evaporator Configuration

N = 2 Pass Evaporator
 P = 3 Pass Evaporator

Digit 18 – Evaporator Fluid Type

1 = Water
 2 = Calcium Chloride
 3 = Ethylene Glycol
 4 = Propylene Glycol
 5 = Methanol

Digit 19 – Water Connection

X = Grooved Pipe
 F = Grooved Pipe + Flange

Digit 20 – Flow Switch

1 = Factory Installed - Other Fluid (15 cm/s)
 2 = Factory Installed - Water 2 (35 cm/s)
 3 = Factory Installed - Water 3 (45 cm/s)

Digit 21 – Insulation

A = Factory Insulation - All Cold Parts 0.75"
 B = Evaporator-Only Insulation - High Humidity/Low Evap Temp 1.25"

Digit 22 – Unit Application

1 = Standard Ambient (32 to 105°F/0 to 40.6°C)
 2 = Low Ambient (0 to 105°F/-17.7 to 40.6°C)
 3 = Extreme Low Ambient (-20 to 105°F/-28.9 to 40.6°C)
 4 = High Ambient (32 to 125°F/0 to 52°C)
 5 = Wide Ambient (0 to 125°F/-17.7 to 52°C)

Digit 23 – Condenser Fin Options

A = Aluminum Fins with Slits
 D = CompleteCoat™ Epoxy Coated Fins

Digits 24, 25 – Not Used

Digit 26 – Power Line Connection Type

A = Terminal Block
 C = Circuit Breaker
 D = Circuit Breaker w/ High Fault Rated Control Panel

Digit 27 – Short Circuit Current Rating

A = Default A Short Circuit Rating
 B = High A Short Circuit Rating

Digit 28 – Transformer

0 = No Transformer
 1 = Factory Installed Transformer

Digit 29 – Line Voltage Harmonic Mitigation

X = Line Reactors (~30% TDD)
 1 = Filter circuit (IEEE519 Compliant)

Digit 30 – Electrical Accessories

0 = No Convenience Outlet
 C = 15A 115V convenience Outlet (Type B)

Digit 31 – Remote Communication Options

0 = No Remote Digital Communication
 1 = LonTalk® Interface LCI-C (Tracer™ Compatible)
 2 = BACnet® MS/TP Interface (Tracer compatible)
 3 = ModBus™ Interface

Digit 32 – Hard Wire Communication

X = None
 A = Hard Wired Bundle - All
 B = Remote Leaving Water Temp Setpoint
 C = Remote Leaving temp and Demand Limit Setpoints
 D = Programmable Relay
 E = Programmable Relay and Leaving Water and Demand

Limit Setpoint
 F = Percent Capacity
 G = Percent Capacity and Leaving Water and Demand Limit Setpoint
 H = Percent Capacity and Programmable Relay

Digit 33 – Not Used



Model Number Descriptions

Digit 34 – Structural Options

- A = Standard Unit Structure
- B = Seismic to International Building Code (IBC)
- C = California Office of Statewide Health Planning and Development (OSHPD) Certification
- D = Wind Load for Florida Hurricane 175 MPH
- E = Seismic (IBC) and Wind Load
- F = OSHPD and Wind Load

Digit 35 – Appearance Options

- 0 = No Appearance Options
- A = Architectural Louvered Panels

Digit 36 – Unit Isolation

- 0 = No Isolation
- 1 = Elastomeric Isolators
- 3 = Seismic Rated Isopads

Digit 37 – Not Used

- 0 = Not Used

Digit 38 – Not Used

- 0 = Not Used

Digit 39 – Special

- 0 = None
- S = Special

Compressor Model Number

Digits 1-4 – Compressor Type

CHHS= Positive displacement, helical rotary (twin screw) hermetic compressor

Digit 5 – Frame Size

- R = R Frame: 70 - 100 tons
- S = S Frame: 112 - 165 tons

Digit 6 – Motor Length

- B = 145 mm
- C = 170 mm
- E = 165 mm
- F = 190 mm

Digit 7 – Motor Winding Characteristics

- * = Factory assigned

Digit 8 – Volume Ratio

- B = High Volume Ratio

Digit 9 – Refrigerant

- 1 = R-134a

Digits 10-11 – Design Sequence

- ** = Factory assigned

Compressor Serial Number

Digits 1-2 – Year

YY = Last two digits of year of manufacture

Digit 3 – Week

WW= Week of build, from 00 to 52

Digit 5 – Day

- 1 = Monday
- 2 = Tuesday
- 3 = Wednesday
- 4 = Thursday
- 5 = Friday
- 6 = Saturday
- 7 = Sunday

Digits 6-8 – Coded Time Stamp

TTT= Used to ensure uniqueness of serial number

Digit 9 – Assembly Line

Assembly line compressor was built on. Varies with facility

Digit 10 – Build Location

- A = Monterrey

General Information

Unit Description

The 150-300 ton Stealth™ units are helical-rotary type, air-cooled liquid chillers designed for installation outdoors. The compressor circuits are completely assembled, hermetic packages that are factory-piped, wired, leak-tested, dehydrated, and tested for proper control operation before shipment.

Chilled water inlet and outlet openings are covered for shipment. The Stealth features Trane's exclusive Adaptive Control™ logic, which monitors the control variables that govern the operation of the chiller unit. Adaptive Control logic can adjust capacity variables to avoid chiller shutdown when necessary, and keep producing chilled water. All unit sizes are available with two independent refrigerant circuits. A single refrigeration circuit option is available for 150 and 165T units. Each compressor is controlled by a variable speed Adaptive Frequency™ Drive Generation 3 (AFD₃). Each refrigerant circuit is provided with filter, sight glass, electronic expansion valve, and charging valves. The shell-and-tube type evaporator is manufactured in accordance with ASME standards or other international codes. Each evaporator is fully insulated and is equipped with water drain and vent connection. As an option, a convenience outlet can be supplied.

Units are shipped with full oil charge and can be ordered with either a factory refrigerant charge, or optional nitrogen charge.

Figure 2. Typical Stealth RTAE



Accessory/Option Information

Check all the accessories and loose parts which are shipped with the unit against the shipping list. Included in these items will be water vessel drain plugs, electrical diagrams, and service literature, which are placed inside the control panel for shipment.

If optional elastomeric isolators are ordered with unit (model number digit 36 = 1), they are shipped mounted on diagonal supports on the end of the unit opposite control panel. See [Figure 3](#) and [Figure 4](#).

If optional seismic isopads are selected (model number digit 36 = 2), they will be shipped inside the unit control panel.

Figure 3. Elastomeric isolator shipping location

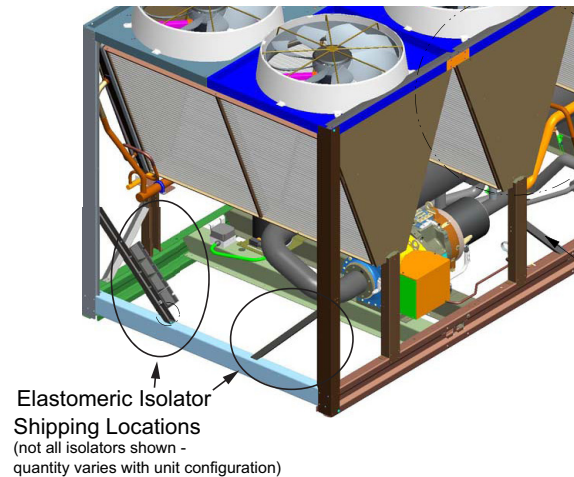


Figure 4. Elastomeric isolators attached for shipping





General Data

General Data

Table 1. General data table

| Unit Size (tons) | | 150 | 165 | 180 | 200 | 225 | 250 | 275 | 300 | 150SC | 165SC |
|----------------------------------|----------|---|---------|---------|---------|---------|---------|---------|---------|---------|---------|
| Compressor Model | | CHHSR | CHHSR | CHHSR | CHHSR | CHHSS | CHHSS | CHHSS | CHHSS | CHHSS | CHHSS |
| Quantity | # | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 2 | 1 | 1 |
| Evaporator | | | | | | | | | | | |
| Water Storage | (gal) | 17.5 | 18.7 | 21.9 | 23.9 | 26.6 | 28.7 | 33.0 | 36.0 | 17.3 | 17.3 |
| | (L) | 66.1 | 70.9 | 82.8 | 90.5 | 100.6 | 108.8 | 125.0 | 136.1 | 65.6 | 65.6 |
| 2 Pass arrangement | | | | | | | | | | | |
| Minimum Flow | (gpm) | 171 | 187 | 202 | 228 | 261 | 288 | 318 | 354 | 169 | 169 |
| | (l/s) | 10.8 | 11.8 | 12.7 | 14.4 | 16.5 | 18.2 | 20.1 | 22.3 | 10.7 | 10.7 |
| Maximum Flow | (gpm) | 626 | 684 | 742 | 835 | 957 | 1055 | 1165 | 1299 | 620 | 620 |
| | (l/s) | 39.5 | 43.1 | 46.8 | 52.7 | 60.4 | 66.5 | 73.5 | 81.9 | 39.1 | 39.1 |
| 3 Pass arrangement | | | | | | | | | | | |
| Minimum Flow | (gpm) | 114 | 124 | 135 | 152 | 174 | 192 | 212 | 236 | 113 | 113 |
| | (l/s) | 7.2 | 7.8 | 8.5 | 9.6 | 11.0 | 12.1 | 13.4 | 14.9 | 7.1 | 7.1 |
| Maximum Flow | (gpm) | 417 | 456 | 495 | 557 | 638 | 703 | 777 | 866 | 414 | 414 |
| | (l/s) | 26.3 | 28.8 | 31.2 | 35.1 | 40.2 | 44.3 | 49.0 | 54.6 | 26.1 | 26.1 |
| Condenser | | | | | | | | | | | |
| Qty of Coils | | 8 | 10 | 10 | 12 | 12 | 12 | 14 | 16 | 8 | 10 |
| Coil Length | (in) | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 | 78.74 |
| | (mm) | 2000 | 2000 | 2000 | 2000 | 2000 | 2000 | 2000 | 2000 | 2000 | 2000 |
| Coil Height | (in) | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| | (mm) | 1270 | 1270 | 1270 | 1270 | 1270 | 1270 | 1270 | 1270 | 1270 | 1270 |
| Fins/Ft | | 192 | 192 | 192 | 192 | 192 | 192 | 192 | 192 | 192 | 192 |
| Rows | | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Condenser Fans | | | | | | | | | | | |
| Quantity | # | 8 | 10 | 10 | 12 | 12 | 12 | 14 | 16 | 8 | 10 |
| Diameter | (in) | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 | 37.5 |
| | (mm) | 953 | 953 | 953 | 953 | 953 | 953 | 953 | 953 | 953 | 953 |
| Total Airflow | (cfm) | 107,392 | 134,240 | 134,240 | 161,088 | 161,088 | 161,088 | 187,936 | 214,784 | 107,392 | 132,240 |
| | (m3/hr) | 182,460 | 228,075 | 228,075 | 273,690 | 273,690 | 273,690 | 319,305 | 364,920 | 182,460 | 228,075 |
| Tip Speed | (ft/min) | 8700 | 8700 | 8700 | 8700 | 8700 | 8700 | 8700 | 8700 | 8700 | 8700 |
| | (M/S) | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 | 44.2 |
| Ambient Temperature Range | | | | | | | | | | | |
| Standard Ambient | °F (°C) | 32 to 105 (0 to 40.6) | | | | | | | | | |
| Low Ambient | °F (°C) | 0 to 105 (-17.7 to 40.6) | | | | | | | | | |
| Extreme Low Ambient | °F (°C) | -20 to 105 (-28.9 to 40.6) | | | | | | | | | |
| High Ambient | °F (°C) | 32 to 125 (0 to 52) | | | | | | | | | |
| Wide Ambient | °F (°C) | 0 to 125 (-17.7 to 52) | | | | | | | | | |
| General Unit | | | | | | | | | | | |
| Refrigerant | | HFC-134a | | | | | | | | | |
| Refrigerant Ckts | # | 2 | | | | | | | | | |
| Minimum Load | % | 20 | 18 | 17 | 15 | 20 | 18 | 16 | 15 | 30 | 27 |
| Refrigerant Charge/ckt | (lbs) | 172 | 181 | 210 | 218 | 265 | 261 | 318 | 325 | 322 | 346 |
| | (kg) | 78 | 82 | 95 | 99 | 120 | 118 | 144 | 148 | 146 | 157 |
| Oil | | Trane OIL00311 (bulk)/OIL00315 (1 gal)/OIL00317 (5 gal) | | | | | | | | | |
| Oil Charge/ckt | (gal) | 3.0 | 3.0 | 3.0 | 3.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 |
| | (L) | 11.4 | 11.4 | 11.4 | 11.4 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 | 15.1 |

Drive Cooling System

Drive cooling fluid volumes are dependent on unit configuration.

- Use [Table 2](#) for units that meet the following criteria:
 - Model number digits 10, 11 = AA
- Use [Table 2](#) for units that meet the following criteria:
 - Model number digits 10, 11 = AB
 - AND Digits 28, 29 = 0X
- Use [Table 2](#) for units that meet the following criteria:
 - Model number digits 10, 11 = AC
 - AND Digits 3-7 = 225, 250, 275 or 300
 - AND Digit 22 = 1 or 2
 - AND Digits 28, 29 = 0X
- Use [Table 3](#) for all other unit configurations.

Table 2. Drive cooling with load inductor

| | Unit Size (tons) | | | | | | | |
|--------------|------------------------------------|-------|---------|-------|---------|-------|---------|-------|
| | Standard Length Unit | | | | | | | |
| | 150 | | 165-200 | | 225-250 | | 275-300 | |
| | gal | l | gal | l | gal | l | gal | l |
| Fluid Type | Trane Heat Transfer Fluid CHM01023 | | | | | | | |
| Fluid Volume | | | | | | | | |
| Ckt 1 | 1.74 | 6.58 | 1.83 | 6.92 | 2.00 | 7.58 | 2.09 | 7.92 |
| Ckt2 | 1.93 | 7.30 | 2.27 | 8.59 | 2.44 | 9.24 | 2.58 | 9.78 |
| Total | 3.67 | 13.88 | 4.10 | 15.51 | 4.44 | 16.82 | 4.67 | 17.69 |

Table 3. Drive cooling without load inductor

| | Unit Size (tons) | | | | | | | | | | | | | | | |
|--------------|------------------------------------|------|------|------|---------|-------|---------|-------|--------------------------------------|------|------|-------|---------|-------|---------|-------|
| | Standard Length Unit | | | | | | | | Extended Length Units ^(a) | | | | | | | |
| | 150S - 165S | | 150 | | 165-250 | | 275-300 | | 150S - 165S | | 150 | | 165-250 | | 275-300 | |
| | gal | l | gal | l | gal | l | gal | l | gal | l | gal | l | gal | l | gal | l |
| Fluid Type | Trane Heat Transfer Fluid CHM01023 | | | | | | | | | | | | | | | |
| Fluid Volume | | | | | | | | | | | | | | | | |
| Ckt 1 | 1.28 | 4.86 | 1.14 | 4.30 | 1.23 | 4.64 | 1.32 | 4.98 | 1.37 | 5.20 | 1.30 | 4.93 | 1.32 | 4.98 | 1.41 | 5.33 |
| Ckt2 | n/a | n/a | 1.32 | 5.01 | 1.67 | 6.31 | 1.81 | 6.84 | n/a | n/a | 1.67 | 6.31 | 1.81 | 6.84 | 1.95 | 7.38 |
| Total | 1.28 | 4.86 | 2.46 | 9.31 | 2.89 | 10.95 | 3.12 | 11.83 | 1.37 | 5.20 | 2.97 | 11.23 | 3.12 | 11.83 | 3.36 | 12.71 |

(a) Units are extended length if either of the following are selected:
 Transformer (model number digit 28 = 1)
 Harmonic Filtration Option (model number digit 29 = 1)
 Units without Harmonic Filtration Option or Transformer (digits 28, 29 = 0X) are standard length.

NOTICE:

Equipment Damage!
 Use only Trane Heat Transfer Fluid P/N CHM01023. This fluid is a direct use concentration and is not to be diluted. Do not top off with water or any other fluid. Use of unapproved fluids, or dilution of approved fluid could result in catastrophic equipment damage.

Non-Trane approved chemicals could react with system components and result in failure. Contact a qualified service technician and your local Trane Parts Center.

Note: The use of incorrect compounds in the drive cooling system may result in scaling, erosion, corrosion or freezing. The Trane Company warranty specifically excludes liability for corrosion, erosion, freezing or deterioration of Trane equipment.

Proper fluid level is important to the operation of the unit. See [“Drive Cooling Expansion Tank,” p. 71](#) for fluid level check instructions. The circuit capacities are shown in tables above.

If the level is below the recommended minimum levels, contact your local Trane office.

Note: Drive cooling fluid service life is 5 years. See [“Drive Cooling System,” p. 71](#).



Pre-Installation

Unit Inspection

When unit is delivered, verify it is the correct unit and is properly equipped. Compare information on the unit nameplate with ordering and submittal information. Inspect all exterior components for visible damage. Report any apparent damage or material shortage to carrier and make a "unit damage" notation on carrier's delivery receipt. Specify extent and type of damage found and notify Trane Sales Office. Do not proceed with installation of a damaged unit without sales office approval.

Inspection

To protect against loss due to damage in transit, complete the following steps upon receipt of unit.

- Inspect the individual pieces of the shipment before accepting the unit. Check for obvious damage to the unit or packing material.
- Inspect the unit for concealed damage as soon as possible after delivery and before it is stored. Concealed damage must be reported within 15 days.
- If concealed damage is discovered, stop unpacking the shipment. Do not remove damaged material from the receiving location. Take photos of the damage, if possible. The owner must provide reasonable evidence that the damage did not occur after delivery.
- Notify the carrier's terminal of the damage immediately, by phone and by mail. Request an immediate, joint inspection of the damage with the carrier and the consignee.

Notify Trane sales representative and arrange for repair. Do not repair unit until damage is inspected by the carrier's representative.

Storage

Extended storage of outdoor unit prior to installation requires these precautionary measures:

- Store the outdoor unit in a secure area.
- For units that have been charged with refrigerant, verify the following valves are closed on each circuit:
 - Suction service valve (butterfly valve)
 - Liquid line angle valve or EXV (EXV is driven closed whenever circuit is powered)
 - Oil line shutoff valves to brazed plate heat exchangers

Note: *Units with factory refrigerant charge (model number digit 15 = 1) are shipped with suction, liquid and oil line shutoff valves closed, isolating most of refrigerant charge in the evaporator. If unit goes directly into long term storage, it is recommended that these valve positions be confirmed.*

- For units with nitrogen charge option (model number digit 15 = 2), units are shipped with valves open. If unit goes directly into storage prior to refrigerant charge, confirm all service valves are open.



- At least every three months (quarterly), check the pressure in the refrigerant circuits to verify that the refrigerant charge is intact. If it is not, contact a qualified service organization and the appropriate Trane sales office.

Installation Requirements

A list of the contractor responsibilities typically associated with the unit installation process is provided in [Table 4](#).

Table 4. Installation requirements

| Type | Trane Supplied Trane Installed | Trane Supplied Field Installed | Field Supplied Field Installed |
|--|--|--|--|
| Foundation | | | <ul style="list-style-type: none"> Meet foundation requirements |
| Rigging | | | <ul style="list-style-type: none"> Safety chains Clevis connectors Lifting beam Spreader bar |
| Disassembly/Reassembly (as required) ^(a) | <ul style="list-style-type: none"> Trane, or an agent of Trane specifically authorized to perform start-up of Trane® products (contact your local Trane office for pricing) | | |
| Isolation | | <ul style="list-style-type: none"> Elastomeric isolators (optional) | <ul style="list-style-type: none"> Elastomeric isolators (optional) |
| Electrical | <ul style="list-style-type: none"> Circuit breakers (optional) Unit mounted starter | | <ul style="list-style-type: none"> Circuit breakers (optional) Electrical connections to unit mounted starter Wiring sizes per submittal and NEC Terminal lugs Ground connection(s) BAS wiring (optional) Control voltage wiring Chilled water pump contactor and wiring Option relays and wiring |
| Water piping | <ul style="list-style-type: none"> Flow switch | | <ul style="list-style-type: none"> Taps for thermometers and gauges Thermometers Water flow pressure gauges Isolation and balancing valves in water piping Vents and drain Waterside pressure relief valves Water strainer |
| Insulation | <ul style="list-style-type: none"> Insulation | | <ul style="list-style-type: none"> Insulation |
| Water Piping Connection Components | <ul style="list-style-type: none"> Grooved pipe | <ul style="list-style-type: none"> Flange kit (optional) | |
| Other Materials | <ul style="list-style-type: none"> R-134a refrigerant Dry nitrogen (optional) | | |
| "Stealth™ RTAE Installation Completion Check Sheet and Request for Trane Service" (RLC-ADF002-EN, see "Log and Check Sheet," p. 90) | | | |
| Chiller Start-up Commissioning ^(b) | <ul style="list-style-type: none"> Trane, or an agent of Trane specifically authorized to perform start-up of Trane® products | | |

(a) Trane, or an agent of Trane specifically authorized to perform start-up and warranty of Trane® products, will perform or have direct on-site supervision of the disassembly and reassembly work.

(b) Start-up must be performed by Trane or an agent of Trane specifically authorized to perform start-up and warranty of Trane® products. Contractor shall provide Trane (or an agent of Trane specifically authorized to perform start-up) with notice of the scheduled start-up at least two weeks prior to the scheduled start-up.



Dimensions and Weights

Weights

Table 5. Weights

| Unit Size (tons) | Standard Length Unit | | | | Extended Length Unit ^(a) | | | |
|--|----------------------|------|-----------|------|-------------------------------------|------|-----------|------|
| | Shipping | | Operating | | Shipping | | Operating | |
| | lbs | kg | lbs | kg | lbs | kg | lbs | kg |
| InvisiSound™ Standard or Superior^(b) | | | | | | | | |
| 150S | 9436 | 4280 | 9596 | 4353 | 11013 | 4995 | 11173 | 5068 |
| 165S | 10451 | 4741 | 10611 | 4813 | 12011 | 5448 | 12171 | 5521 |
| 150 | 11333 | 5141 | 11479 | 5207 | 13492 | 6120 | 13638 | 6186 |
| 165 | 12377 | 5614 | 12533 | 5685 | 14532 | 6592 | 14688 | 6662 |
| 180 | 12698 | 5760 | 12880 | 5843 | 14853 | 6737 | 15035 | 6820 |
| 200 | 13808 | 6263 | 14007 | 6354 | 15991 | 7254 | 16213 | 7354 |
| 225 | 15244 | 6915 | 15466 | 7015 | 17427 | 7905 | 17649 | 8005 |
| 250 | 15622 | 7086 | 15861 | 7195 | 17805 | 8076 | 18044 | 8185 |
| 275 | 16820 | 7630 | 17095 | 7754 | 18975 | 8607 | 19250 | 8732 |
| 300 | 17965 | 8149 | 18265 | 8285 | 20121 | 9127 | 20421 | 9263 |
| InvisiSound Ultimate^(c) | | | | | | | | |
| 150S | 10236 | 4643 | 10396 | 4716 | 11813 | 5358 | 11973 | 5431 |
| 165S | 11251 | 5103 | 11411 | 5176 | 12811 | 5811 | 12971 | 5884 |
| 150 | 12133 | 5504 | 12279 | 5570 | 14292 | 6483 | 14438 | 6549 |
| 165 | 13177 | 5977 | 13333 | 6048 | 15332 | 6955 | 15488 | 7025 |
| 180 | 13498 | 6123 | 13680 | 6205 | 15653 | 7100 | 15835 | 7183 |
| 200 | 14608 | 6626 | 14807 | 6716 | 16791 | 7616 | 17013 | 7717 |
| 225 | 16044 | 7278 | 16266 | 7378 | 18227 | 8268 | 18449 | 8368 |
| 250 | 16422 | 7449 | 16661 | 7557 | 18605 | 8439 | 18844 | 8548 |
| 275 | 17620 | 7992 | 17895 | 8117 | 19775 | 8970 | 20050 | 9095 |
| 300 | 18765 | 8512 | 19065 | 8648 | 20921 | 9490 | 21221 | 9626 |


- (a) Units are extended length if either of the following are selected:
 Transformer (model number digit 28 = 1)
 Harmonic Filtration Option (model number digit 29 = 1)
 Units without Harmonic Filtration Option or Transformer (digits 28, 29 = 0X) are standard length.
 (b) Model number digit 12 = 1 or 2
 (c) Model number digit 12 = 3

Unit Dimensions

See unit submittals for specific unit dimensions and water connection locations.

Service Clearances

Figure 5. RTAE service clearances - top view

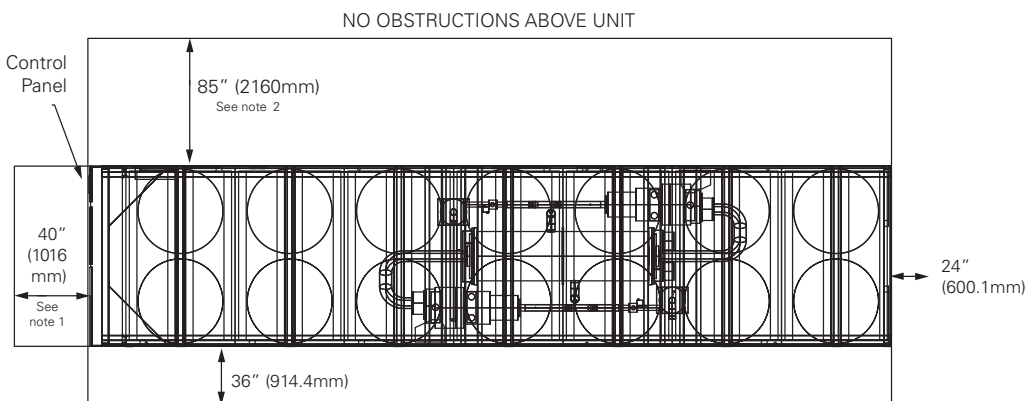

- NOTES:
1. A full 40" clearance is required in front of the control panel. Must be measured from front of panel, not end of unit base.
 2. Clearance of 85" on the side of the unit is required for coil replacement. Preferred side for coil replacement is shown (left side of unit, as facing control panel), however either side is acceptable.

Installation Mechanical

Location Requirements

Sound Considerations

- Refer to *Trane Engineering Bulletin Chiller Sound Ratings and Installation Guide* RLC-PRB035-EN for sound consideration applications.
- Locate the unit away from sound-sensitive areas.
- Install the optional elastomeric isolators under the unit. See “[Isolation and Sound Emission](#),” p. 20.
- Chilled water piping should not be supported by chiller frame.
- Install rubber vibration isolators in all water piping.
- Use flexible electrical conduit.
- Seal all wall penetrations.

Note: Consult an acoustical engineer for critical applications.

Foundation

Provide rigid, non-warping mounting pads or a concrete foundation of sufficient strength and mass to support the applicable operating weight (i.e., including completed piping, and full operating charges of refrigerant, oil and water). See [Table 5, p. 14](#) for unit operating weights. Once in place, the unit must be level within 1/4” (6.4 mm) across the length and width of the unit. The Trane Company is not responsible for equipment problems resulting from an improperly designed or constructed foundation.

Clearances

Provide enough space around the unit to allow the installation and maintenance personnel unrestricted access to all service points. See submittal drawings for the unit dimensions, to provide sufficient clearance for the opening of control panel doors and unit service. See [Figure 5, p. 14](#) for minimum clearances. In all cases, local codes which require additional clearances will take precedence over these recommendations.

For close spacing information, see RLC-PRB037-EN.

Rigging

⚠ WARNING

Improper Unit Lift!

Test lift unit approximately 24 inches to verify proper center of gravity lift point. To avoid dropping of unit, reposition lifting point if unit is not level. Failure to properly lift unit could result in unit dropping and possibly crushing operator/technician which could result in death or serious injury and possible equipment or property-only damage.

⚠ WARNING

Heavy Objects!

Ensure that all the lifting equipment used is properly rated for the weight of the unit being lifted. Each of the cables (chains or slings), hooks, and shackles used to lift the unit must be capable of supporting the entire weight of the unit. Lifting cables (chains or slings) may not be of the same length. Adjust as necessary for even unit lift. Other lifting arrangements could cause equipment or property damage. Failure to follow instructions above or properly lift unit could result in unit dropping and possibly crushing operator/technician which could result in death or serious injury.

⚠ WARNING

Proper Lifting Configuration Required!

Use only lift locations designated with label shown in [Figure 6](#). Do NOT use locations marked with label shown in [Figure 7](#). Use unit lifting configurations as shown in [Table 6](#) and [Figure 8, p. 16](#) thru [Figure 10, p. 17](#). Other lifting arrangements could result in death, serious injury or equipment damage.

Figure 6. Label - lift location




Figure 7. Label - do not lift



Important:

- Do not fork lift unit.
- See unit nameplate and/or unit submittal for total shipping weight.
- See [Table 6](#) and [Figure 8](#) thru [Figure 10](#) for unit lifting configuration.
- See [Table 7, p. 18](#) and [Table 8, p. 19](#) for lift weights and dimensions at each lifting point locations.
- See [Table 9, p. 20](#) for center of gravity information.

Table 6. Lifting configuration selection

| Tons | Unit Length ^(a) | Lift Configuration | See |
|-------------------------|----------------------------|--------------------|------------------|
| 150S, 165S, 150 | Standard and Extended | 4-point | Figure 8, p. 16 |
| 165, 180, 200, 225, 250 | Standard | | |
| 165, 180, 200, 225, 250 | Extended | 6-point | Figure 9, p. 17 |
| 275 | Standard | | |
| 275 | Extended | 8-point | Figure 10, p. 17 |
| 300 | Standard and Extended | | |

(a) Units are extended length if either of the following are selected:
 Transformer (model number digit 28 = 1)
 Harmonic Filtration Option (model number digit 29 = 1)
 Units without Harmonic Filtration Option or Transformer (digits 28, 29 = 0X) are standard length.

Figure 8. 4-point lift configuration

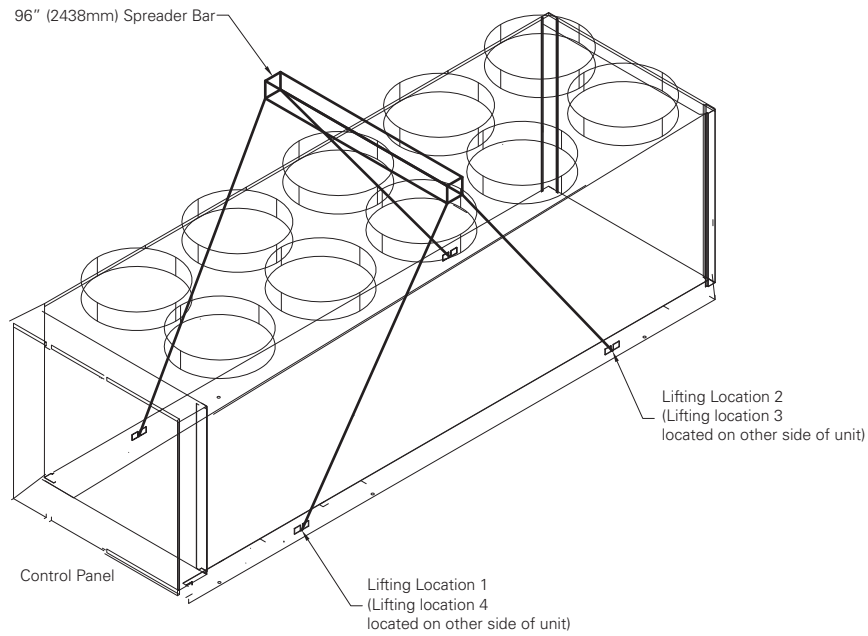


Figure 9. 6-point lift configuration


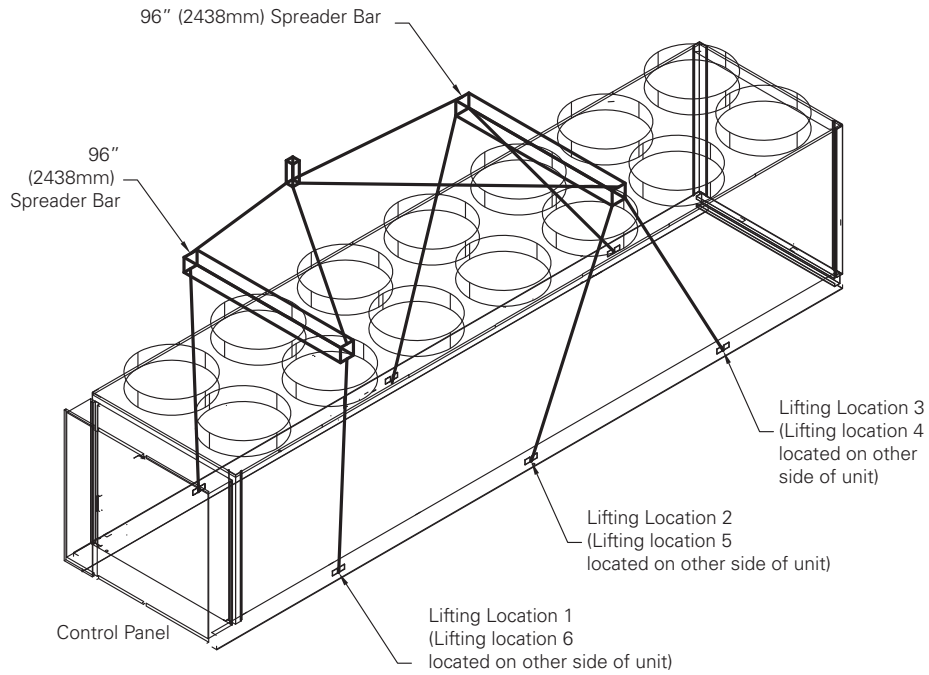


Figure 10. 8-point lift configuration



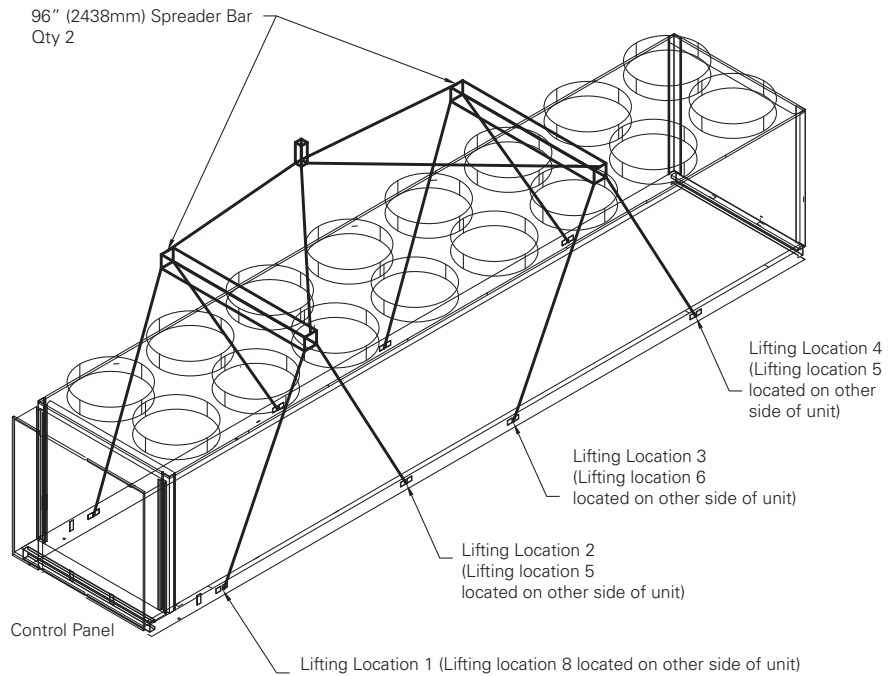

Installation Mechanical

Table 7. Lift weights by location

| Tons | Location | | | | | | | | | | | | | | | |
|---|----------|------|------|------|------|------|------|------|------|------|------|------|------|-----|------|------|
| | 1 | | 2 | | 3 | | 4 | | 5 | | 6 | | 7 | | 8 | |
| | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg |
| Standard Length Unit | | | | | | | | | | | | | | | | |
| 150S | 2540 | 1152 | 2451 | 1112 | 2164 | 981 | 2281 | 1034 | - | - | - | - | - | - | - | - |
| 165S | 2656 | 1205 | 2352 | 1067 | 2730 | 1238 | 2713 | 1230 | - | - | - | - | - | - | - | - |
| 150 | 3426 | 1554 | 2638 | 1197 | 2234 | 1014 | 3035 | 1377 | - | - | - | - | - | - | - | - |
| 165 | 3452 | 1566 | 2876 | 1304 | 2810 | 1275 | 3239 | 1469 | - | - | - | - | - | - | - | - |
| 180 | 3528 | 1600 | 2941 | 1334 | 2896 | 1314 | 3333 | 1512 | - | - | - | - | - | - | - | - |
| 200 | 3586 | 1627 | 3325 | 1508 | 3316 | 1504 | 3581 | 1624 | - | - | - | - | - | - | - | - |
| 225 | 4003 | 1816 | 3551 | 1611 | 3617 | 1641 | 4073 | 1847 | - | - | - | - | - | - | - | - |
| 250 | 4098 | 1859 | 3637 | 1650 | 3711 | 1683 | 4176 | 1894 | - | - | - | - | - | - | - | - |
| 275 | 2484 | 1127 | 1943 | 881 | 3683 | 1671 | 3829 | 1737 | 2255 | 1023 | 2625 | 1191 | - | - | - | - |
| 300 | 2061 | 935 | 2289 | 1038 | 2515 | 1141 | 1682 | 763 | 2729 | 1238 | 3008 | 1364 | 1737 | 788 | 1943 | 881 |
| Extended Length Unit^(a) | | | | | | | | | | | | | | | | |
| 150S | 2698 | 1224 | 2597 | 1178 | 2837 | 1287 | 2881 | 1307 | - | - | - | - | - | - | - | - |
| 165S | 2988 | 1356 | 2841 | 1289 | 3135 | 1422 | 3047 | 1382 | - | - | - | - | - | - | - | - |
| 150 | 3825 | 1735 | 3363 | 1525 | 2920 | 1324 | 3384 | 1535 | - | - | - | - | - | - | - | - |
| 165 | 2653 | 1203 | 2629 | 1192 | 2570 | 1166 | 1959 | 889 | 2046 | 928 | 2675 | 1213 | - | - | - | - |
| 180 | 2685 | 1218 | 2674 | 1213 | 2641 | 1198 | 1946 | 883 | 2100 | 953 | 2807 | 1273 | - | - | - | - |
| 200 | 2919 | 1324 | 2640 | 1198 | 2797 | 1269 | 2846 | 1291 | 2274 | 1032 | 2514 | 1141 | - | - | - | - |
| 225 | 3065 | 1391 | 2705 | 1227 | 3237 | 1468 | 3144 | 1426 | 2406 | 1091 | 2870 | 1302 | - | - | - | - |
| 250 | 3117 | 1414 | 2749 | 1247 | 3322 | 1507 | 3229 | 1465 | 2458 | 1115 | 2930 | 1329 | - | - | - | - |
| 275 | 2145 | 973 | 2668 | 1210 | 3279 | 1487 | 1513 | 686 | 2412 | 1094 | 2482 | 1126 | 1644 | 746 | 2831 | 1284 |
| 300 | 2056 | 933 | 2440 | 1107 | 3452 | 1566 | 2241 | 1017 | 3089 | 1401 | 2993 | 1358 | 1460 | 662 | 2389 | 1084 |

(a) Units are extended length if either of the following are selected:

Low Harmonic Distortion Option (model number digit 29 = 1)

Autotransformer (model number digit 28 = 1 or 2)

Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Table 8. Lifting locations (from control panel end of frame)

| Tons | Location | | | | | | | | | | | | | | | |
|---|----------|------|------|------|-------|------|-------|------|-------|------|-------|------|-------|-------|-------|-------|
| | 1 | | 2 | | 3 | | 4 | | 5 | | 6 | | 7 | | 8 | |
| | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm |
| Standard Length Unit | | | | | | | | | | | | | | | | |
| 150S | 45.5 | 1156 | 45.5 | 1156 | 153.9 | 3909 | 153.9 | 3909 | - | - | - | - | - | - | - | - |
| 165S | 23.5 | 596 | 23.5 | 596 | 189.7 | 4818 | 189.7 | 4818 | - | - | - | - | - | - | - | - |
| 150 | 39.6 | 1006 | 39.6 | 1006 | 171.4 | 4353 | 171.4 | 4353 | - | - | - | - | - | - | - | - |
| 165 | 60.4 | 1534 | 60.4 | 1534 | 224.6 | 5705 | 224.6 | 5705 | - | - | - | - | - | - | - | - |
| 180 | 60.4 | 1534 | 60.4 | 1534 | 224.6 | 5705 | 224.6 | 5705 | - | - | - | - | - | - | - | - |
| 200 | 53.3 | 1355 | 53.3 | 1355 | 258.7 | 6570 | 258.7 | 6570 | - | - | - | - | - | - | - | - |
| 225 | 53.3 | 1355 | 53.3 | 1355 | 258.7 | 6570 | 258.7 | 6570 | - | - | - | - | - | - | - | - |
| 250 | 53.3 | 1355 | 53.3 | 1355 | 258.7 | 6570 | 258.7 | 6570 | - | - | - | - | - | - | - | - |
| 275 | 75.8 | 1926 | 75.8 | 1926 | 190.7 | 4845 | 190.7 | 4845 | 311.9 | 7922 | 311.9 | 7922 | - | - | - | - |
| 300 | 47.6 | 1210 | 47.6 | 1210 | 171.3 | 4350 | 171.3 | 4350 | 242.8 | 6168 | 242.8 | 6168 | 365.1 | 9274 | 365.1 | 9274 |
| Extended Length Unit^(a) | | | | | | | | | | | | | | | | |
| 150S | 23.5 | 596 | 23.5 | 596 | 207.1 | 5261 | 207.1 | 5261 | - | - | - | - | - | - | - | - |
| 165S | 23.5 | 596 | 23.5 | 596 | 242.9 | 6170 | 242.9 | 6170 | - | - | - | - | - | - | - | - |
| 150 | 44.7 | 1136 | 44.7 | 1136 | 224.6 | 5705 | 224.6 | 5705 | - | - | - | - | - | - | - | - |
| 165 | 61.1 | 1552 | 61.1 | 1552 | 171.3 | 4350 | 171.3 | 4350 | 277.8 | 7057 | 277.8 | 7057 | - | - | - | - |
| 180 | 61.1 | 1552 | 61.1 | 1552 | 171.3 | 4350 | 171.3 | 4350 | 277.8 | 7057 | 277.8 | 7057 | - | - | - | - |
| 200 | 47.6 | 1210 | 47.6 | 1210 | 190.7 | 4845 | 190.7 | 4845 | 311.9 | 7922 | 311.9 | 7922 | - | - | - | - |
| 225 | 47.6 | 1210 | 47.6 | 1210 | 190.7 | 4845 | 190.7 | 4845 | 311.9 | 7922 | 311.9 | 7922 | - | - | - | - |
| 250 | 47.6 | 1210 | 47.6 | 1210 | 190.7 | 4845 | 190.7 | 4845 | 311.9 | 7922 | 311.9 | 7922 | - | - | - | - |
| 275 | 75.8 | 1926 | 75.8 | 1926 | 182.0 | 4623 | 182.0 | 4623 | 258.5 | 6565 | 258.5 | 6565 | 365.1 | 9274 | 365.1 | 9274 |
| 300 | 47.6 | 1210 | 47.6 | 1210 | 168.5 | 4280 | 168.5 | 4280 | 296.1 | 7520 | 296.1 | 7520 | 418.3 | 10626 | 418.3 | 10626 |

(a) Units are extended length if either of the following are selected:

Low Harmonic Distortion Option (model number digit 29 = 1)

Autotransformer (model number digit 28 = 1 or 2)

Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Center of Gravity

Figure 11. Center of gravity

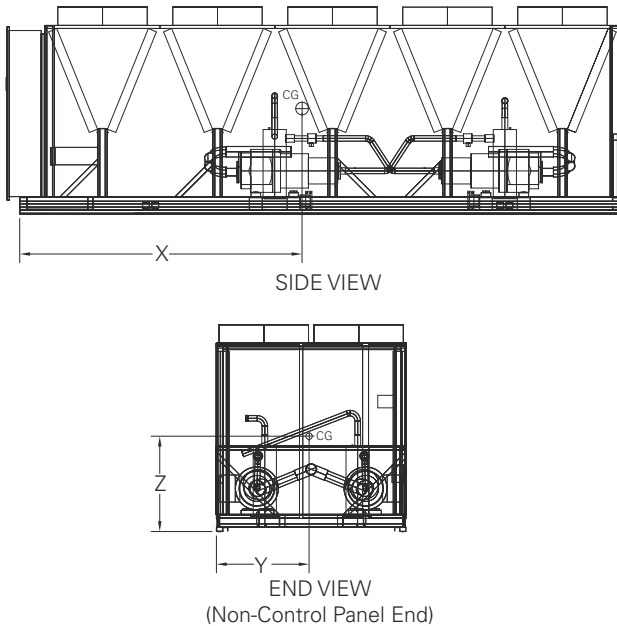


Table 9. Centers of gravity

| Tons | CGx | | CGy | | CGz | |
|-------------------------------------|-------|------|------|------|------|------|
| | in | mm | in | mm | in | mm |
| Standard Length Unit | | | | | | |
| 150S | 96.6 | 2454 | 43.8 | 1112 | 40.4 | 1025 |
| 165S | 110.0 | 2793 | 45.2 | 1149 | 42.8 | 1087 |
| 150 | 105.5 | 2679 | 43.9 | 1115 | 37.5 | 953 |
| 165 | 142.4 | 3617 | 43.9 | 1115 | 39.7 | 1008 |
| 180 | 142.8 | 3628 | 43.9 | 1115 | 39.4 | 1002 |
| 200 | 155.5 | 3951 | 43.9 | 1115 | 41.2 | 1047 |
| 225 | 156.1 | 3964 | 43.9 | 1115 | 39.8 | 1011 |
| 250 | 156.4 | 3973 | 43.9 | 1115 | 39.7 | 1008 |
| 275 | 194.1 | 4930 | 43.9 | 1115 | 41.1 | 1043 |
| 300 | 207.1 | 5260 | 43.9 | 1115 | 42.4 | 1076 |
| Extended Length Unit ^(a) | | | | | | |
| 150S | 118.8 | 3017 | 44.1 | 1121 | 37.2 | 944 |
| 165S | 136.4 | 3464 | 44.7 | 1137 | 39.4 | 1002 |
| 150 | 134.7 | 3421 | 43.9 | 1115 | 33.3 | 846 |
| 165 | 169.1 | 4295 | 43.9 | 1115 | 35.4 | 898 |
| 180 | 169.9 | 4314 | 43.9 | 1115 | 35.2 | 894 |
| 200 | 181.6 | 4613 | 43.9 | 1115 | 36.9 | 937 |
| 225 | 183.6 | 4665 | 43.9 | 1115 | 36.0 | 915 |
| 250 | 184.2 | 4680 | 43.9 | 1115 | 36.0 | 913 |
| 275 | 220.2 | 5594 | 43.9 | 1115 | 37.4 | 950 |
| 300 | 232.3 | 5900 | 43.9 | 1115 | 38.7 | 984 |

(a) Units are extended length if either of the following are selected:
 Low Harmonic Distortion Option (model number digit 29 = 1)
 Autotransformer (model number digit 28 = 1 or 2)
 Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Isolation and Sound Emission

The most effective form of isolation is to locate the unit away from any sound sensitive area. Structurally transmitted sound can be reduced by elastomeric vibration eliminators. Spring isolators are not recommended. Consult an acoustical engineer in critical sound applications.

For maximum isolation effect, isolate water lines and electrical conduit. Wall sleeves and rubber isolated piping hangers can be used to reduce the sound transmitted through water piping. To reduce the sound transmitted through electrical conduit, use flexible electrical conduit.

State and local codes on sound emissions should always be considered. Since the environment in which a sound source is located affects sound pressure, unit placement must be carefully evaluated. Sound power levels for Stealth chillers are available on request.

Unit Isolation and Leveling

For additional reduction of sound and vibration, install the optional elastomeric isolators.

Construct an isolated concrete pad for the unit or provide concrete footings at the unit mounting points. Mount the unit directly to the concrete pads or footings.


Level the unit using the base rail as a reference. The unit must be level within 1/4-in (6 mm) over the entire length and width. Use shims as necessary to level the unit.

Elastomeric Isolators (Optional for units without seismic rating)

Note: See unit submittal, or Table 11, p. 21 thru Table 13, p. 23 for point weights, isolator location and isolator selections.

1. Secure the isolators to the mounting surface using the mounting slots in the isolator base plate. Do not fully tighten the isolator mounting bolts at this time.
2. Align the mounting holes in the base of the unit with the threaded positioning pins on the top of the isolators.
3. Lower the unit onto the isolators and secure the isolator to the unit with a nut.
4. Level the unit carefully. Fully tighten the isolator mounting bolts.

Figure 12. Elastomeric isolator

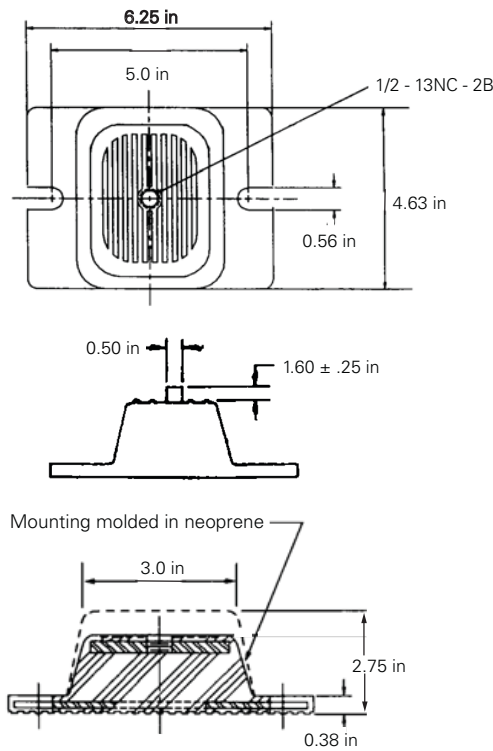

| Max Load (lbs) | Color | Maximum Deflection (in) | Type |
|----------------|-------|-------------------------|-------|
| 2250 | RED | 0.50 | RDP-4 |
| 3000 | GREEN | 0.50 | RDP-4 |

Elastomeric Isolation Pads for Seismic Option

Elastomeric pads ship inside the unit control panel. They are provided with an isolation washer and 3/4" free hole in the center of the plate.

Figure 13. Seismic isolation pad — installed





Table 10. Seismically rated elastomeric isolation pad

| Model | Max Load | Dimension (in) | | |
|-------|----------|----------------|-------|--------|
| | | Length | Width | Height |
| B-36 | 2520 | 6 | 6 | .625 |

Figure 14. Mounting point locations^(a)

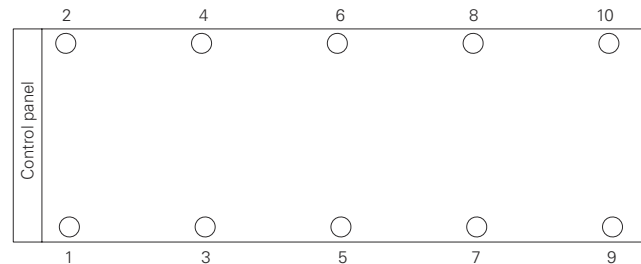

(a) Quantity of isolators varies with unit. Shorter units will not use locations 5 and 6. See submittal for actual number required for specific unit.

Table 11. Point weights

| Tons | Location | | | | | | | | | | | | | | | | | | | |
|------------------------|----------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|------|-----|
| | 1 | | 2 | | 3 | | 4 | | 5 | | 6 | | 7 | | 8 | | 9 | | 10 | |
| | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg |
| Standard Length | | | | | | | | | | | | | | | | | | | | |
| 150S | 1731 | 785 | 1664 | 755 | 1834 | 832 | 1773 | 804 | 1219 | 553 | 1375 | 624 | - | - | - | - | - | - | - | - |
| 165S | 1666 | 756 | 1559 | 707 | 1886 | 855 | 1870 | 848 | 1914 | 868 | 1716 | 778 | - | - | - | - | - | - | - | - |
| 150 | 1452 | 659 | 1543 | 700 | 1326 | 602 | 1446 | 656 | 1464 | 664 | 1350 | 612 | 1490 | 676 | 1262 | 572 | - | - | - | - |
| 165 | 1539 | 698 | 1341 | 608 | 1622 | 736 | 1553 | 704 | 1657 | 752 | 1607 | 729 | 1522 | 690 | 1536 | 697 | - | - | - | - |
| 180 | 1536 | 697 | 1338 | 607 | 1676 | 760 | 1620 | 735 | 1709 | 775 | 1659 | 753 | 1579 | 716 | 1581 | 717 | - | - | - | - |
| 200 | 1442 | 654 | 1764 | 800 | 1696 | 769 | 1810 | 821 | 1836 | 833 | 1694 | 768 | 1986 | 901 | 1580 | 717 | - | - | - | - |
| 225 | 1430 | 649 | 1792 | 813 | 1999 | 907 | 2058 | 933 | 2111 | 958 | 1994 | 905 | 2139 | 970 | 1721 | 781 | - | - | - | - |
| 250 | 1426 | 647 | 1803 | 818 | 2064 | 936 | 2144 | 973 | 2182 | 990 | 2055 | 932 | 2195 | 996 | 1753 | 795 | - | - | - | - |
| 275 | 1624 | 737 | 1627 | 738 | 1802 | 817 | 1746 | 792 | 1795 | 814 | 1530 | 694 | 1653 | 750 | 1831 | 830 | 1577 | 715 | 1634 | 741 |
| 300 | 1634 | 741 | 1850 | 839 | 1871 | 849 | 1925 | 873 | 1898 | 861 | 1938 | 879 | 1887 | 856 | 1695 | 769 | 1752 | 795 | 1515 | 687 |



Installation Mechanical

Table 11. Point weights (continued)

| Tons | Location | | | | | | | | | | | | | | | | | | | |
|---|----------|-----|------|-----|------|-----|------|-----|------|------|------|-----|------|------|------|------|------|-----|------|-----|
| | 1 | | 2 | | 3 | | 4 | | 5 | | 6 | | 7 | | 8 | | 9 | | 10 | |
| | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg | lb | kg |
| Extended Length Unit^(a) | | | | | | | | | | | | | | | | | | | | |
| 150S | 1553 | 704 | 1795 | 814 | 1974 | 895 | 1959 | 889 | 2088 | 947 | 1804 | 818 | - | - | - | - | - | - | - | - |
| 165S | 1344 | 610 | 1236 | 561 | 1537 | 697 | 1494 | 678 | 1686 | 765 | 1668 | 757 | 1636 | 742 | 1570 | 712 | - | - | - | - |
| 150 | 1563 | 709 | 1621 | 735 | 1705 | 773 | 1875 | 850 | 1952 | 885 | 1575 | 714 | 1601 | 726 | 1601 | 726 | - | - | - | - |
| 165 | 1776 | 806 | 1827 | 829 | 1956 | 887 | 1925 | 873 | 2058 | 933 | 1958 | 888 | 1517 | 688 | 1515 | 687 | - | - | - | - |
| 180 | 1774 | 805 | 1822 | 827 | 1990 | 903 | 1975 | 896 | 2128 | 965 | 2030 | 921 | 1577 | 715 | 1557 | 706 | - | - | - | - |
| 200 | 1706 | 774 | 1524 | 691 | 1662 | 754 | 1294 | 587 | 1938 | 879 | 1738 | 788 | 1267 | 575 | 1753 | 795 | 1457 | 661 | 1652 | 749 |
| 225 | 1857 | 842 | 1669 | 757 | 1844 | 836 | 1412 | 640 | 2156 | 978 | 1860 | 844 | 1378 | 625 | 1985 | 900 | 1501 | 681 | 1766 | 801 |
| 250 | 1852 | 840 | 1664 | 755 | 1885 | 855 | 1439 | 653 | 2219 | 1006 | 1936 | 878 | 1438 | 652 | 2046 | 928 | 1530 | 694 | 1795 | 814 |
| 275 | 1874 | 850 | 1860 | 844 | 1626 | 737 | 1700 | 771 | 2204 | 1000 | 2101 | 953 | 2017 | 915 | 2131 | 967 | 1820 | 826 | 1642 | 745 |
| 300 | 1946 | 883 | 1826 | 828 | 1854 | 841 | 1795 | 814 | 2143 | 972 | 2106 | 955 | 2408 | 1092 | 2338 | 1060 | 1808 | 820 | 1898 | 861 |

(a) Units are extended length if either of the following are selected:
 Low Harmonic Distortion Option (model number digit 29 = 1)
 Autotransformer (model number digit 28 = 1 or 2)
 Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Table 12. Isolator locations^(a)

| Tons | Location | | | | | | | | | | | | | | | | | | | |
|---|----------|-----|------|-----|-------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|-------|-------|-------|
| | 1 | | 2 | | 3 | | 4 | | 5 | | 6 | | 7 | | 8 | | 9 | | 10 | |
| | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm | in | mm |
| Standard Length | | | | | | | | | | | | | | | | | | | | |
| 150S | 23.6 | 600 | 27.6 | 700 | 102.4 | 2600 | 94.5 | 2400 | 187.0 | 4750 | 187.0 | 4750 | - | - | - | - | - | - | - | - |
| 165S | 15.7 | 400 | 23.0 | 585 | 98.4 | 2500 | 102.2 | 2595 | 196.9 | 5000 | 204.7 | 5200 | - | - | - | - | - | - | - | - |
| 150 | 24.4 | 620 | 11.8 | 300 | 47.2 | 1200 | 82.7 | 2100 | 100.4 | 2550 | 153.5 | 3900 | 188.2 | 4780 | 188.2 | 4780 | - | - | - | - |
| 165 | 17.7 | 450 | 23.0 | 585 | 98.6 | 2505 | 102.2 | 2595 | 155.5 | 3950 | 190.6 | 4840 | 242.1 | 6150 | 242.9 | 6170 | - | - | - | - |
| 180 | 17.7 | 450 | 23.0 | 585 | 98.6 | 2505 | 102.2 | 2595 | 155.5 | 3950 | 190.6 | 4840 | 242.1 | 6150 | 242.9 | 6170 | - | - | - | - |
| 200 | 23.6 | 600 | 23.6 | 600 | 102.4 | 2600 | 137.8 | 3500 | 155.5 | 3950 | 198.8 | 5050 | 255.9 | 6500 | 263.8 | 6700 | - | - | - | - |
| 225 | 23.6 | 600 | 23.6 | 600 | 102.4 | 2600 | 137.8 | 3500 | 155.5 | 3950 | 198.8 | 5050 | 255.9 | 6500 | 263.8 | 6700 | - | - | - | - |
| 250 | 23.6 | 600 | 23.6 | 600 | 102.4 | 2600 | 137.8 | 3500 | 155.5 | 3950 | 198.8 | 5050 | 255.9 | 6500 | 263.8 | 6700 | - | - | - | - |
| 275 | 21.7 | 550 | 18.9 | 480 | 141.3 | 3590 | 125.2 | 3180 | 196.1 | 4980 | 236.2 | 6000 | 236.2 | 6000 | 259.8 | 6598 | 328.0 | 8330 | 324.4 | 8240 |
| 300 | 19.7 | 500 | 27.6 | 700 | 143.1 | 3634 | 143.1 | 3634 | 202.4 | 5142 | 235.6 | 5984 | 257.9 | 6551 | 296.6 | 7534 | 347.8 | 8834 | 339.5 | 8624 |
| Extended Length Unit^(b) | | | | | | | | | | | | | | | | | | | | |
| 150S | 19.7 | 500 | 15.7 | 400 | 102.4 | 2600 | 133.9 | 3400 | 204.7 | 5200 | 208.7 | 5300 | - | - | - | - | - | - | - | - |
| 165S | 23.6 | 600 | 23.6 | 600 | 86.6 | 2200 | 78.7 | 2000 | 149.6 | 3800 | 157.5 | 4000 | 259.8 | 6600 | 259.8 | 6600 | - | - | - | - |
| 150 | 25.0 | 635 | 23.6 | 600 | 84.6 | 2150 | 98.4 | 2500 | 147.6 | 3750 | 190.9 | 4850 | 240.2 | 6100 | 240.2 | 6100 | - | - | - | - |
| 165 | 19.7 | 500 | 19.7 | 500 | 129.9 | 3300 | 129.9 | 3300 | 204.7 | 5200 | 234.3 | 5950 | 293.3 | 7450 | 299.2 | 7600 | - | - | - | - |
| 180 | 19.7 | 500 | 19.7 | 500 | 129.9 | 3300 | 129.9 | 3300 | 204.7 | 5200 | 234.3 | 5950 | 293.3 | 7450 | 299.2 | 7600 | - | - | - | - |
| 200 | 25.6 | 650 | 19.7 | 500 | 118.1 | 3000 | 98.4 | 2500 | 208.7 | 5300 | 196.9 | 5000 | 255.9 | 6500 | 255.9 | 6500 | 315.0 | 8000 | 315.0 | 8000 |
| 225 | 25.6 | 650 | 19.7 | 500 | 118.1 | 3000 | 98.4 | 2500 | 208.7 | 5300 | 196.9 | 5000 | 255.9 | 6500 | 255.9 | 6500 | 315.0 | 8000 | 315.0 | 8000 |
| 250 | 25.6 | 650 | 19.7 | 500 | 118.1 | 3000 | 98.4 | 2500 | 208.7 | 5300 | 196.9 | 5000 | 255.9 | 6500 | 255.9 | 6500 | 315.0 | 8000 | 315.0 | 8000 |
| 275 | 6.3 | 160 | 9.8 | 250 | 177.2 | 4500 | 139.8 | 3550 | 198.8 | 5050 | 242.1 | 6150 | 309.1 | 7850 | 313.0 | 7950 | 354.3 | 9000 | 370.1 | 9400 |
| 300 | 9.8 | 250 | 9.8 | 250 | 177.2 | 4500 | 139.8 | 3550 | 206.7 | 5250 | 242.1 | 6150 | 311.8 | 7920 | 313.4 | 7960 | 393.7 | 10000 | 393.7 | 10000 |

(a) Dimensions are referenced from end of frame on the control panel side.
 (b) Units are extended length if either of the following are selected:
 Low Harmonic Distortion Option (model number digit 29 = 1)
 Autotransformer (model number digit 28 = 1 or 2)
 Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Table 13. Isolator selections

| Tons | Location | | | | | | | | | |
|---|----------|--------|----------|----------|----------|----------|----------|----------|--------|--------|
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 | 9 | 10 |
| Standard Length Unit | | | | | | | | | | |
| 150S | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | - | - | - | - |
| 165S | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | - | - | - | - |
| 150 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 165 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 180 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 200 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 225 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 250 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 275 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| 300 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| Extended Length Unit^(a) | | | | | | | | | | |
| 150S | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Red 62 | - | - | - | - |
| 165S | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | Red 62 | - | - |
| 150 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 165 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 180 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 | - | - |
| 200 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| 225 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| 250 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| 275 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |
| 300 | Red 62 | Red 62 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Green 63 | Red 62 | Red 62 |

(a) Units are extended length if either of the following are selected:
 Low Harmonic Distortion Option (model number digit 29 = 1)
 Autotransformer (model number digit 28 = 1 or 2)
 Units without Low Harmonic Distortion Option or Autotransformer (digits 28, 29 = X0) are standard length.

Compressor Shipping Bolt Removal

Units with InvisiSound™ Ultimate Option (Model Number Digit 12 = 3)

For chillers built with InvisiSound Ultimate option, compressor shipping bolts must be removed to assure minimum noise during operation. Use a 24mm socket to remove the (3) M15 x 75mm shipping bolts for each compressor. They are located under compressor mounting feet. See [Figure 15](#).


Important:

- **DO NOT DISCARD SHIPPING BOLTS.** Store bolts in the control panel for future use.
- All shipping bolts **MUST** be reinstalled prior to compressor removal or unit move.

NOTICE:

Equipment Damage!
 Do not remove compressor or move unit without reattaching compressor shipping bolts. Failure to reinstall bolts could cause shifting of parts and result in equipment damage.

Figure 15. Compressor shipping bolt removal

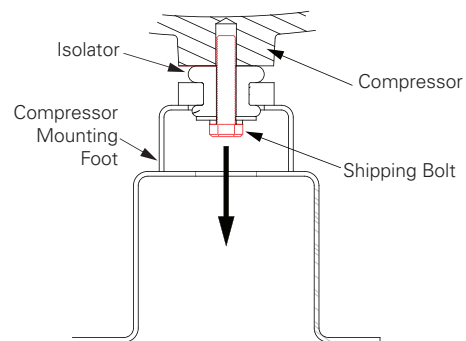


Drainage

Locate the unit near a large capacity drain for water vessel drain-down during shutdown or repair. Evaporators are provided with drain connections. A vent on top of evaporator waterbox prevents vacuum by allowing air into evaporator for complete drainage. All local and national codes apply.

Evaporator Piping

RTAE units are available with 2 or 3 pass configurations. See Figure 16.

Figure 16. Evaporator pass configurations

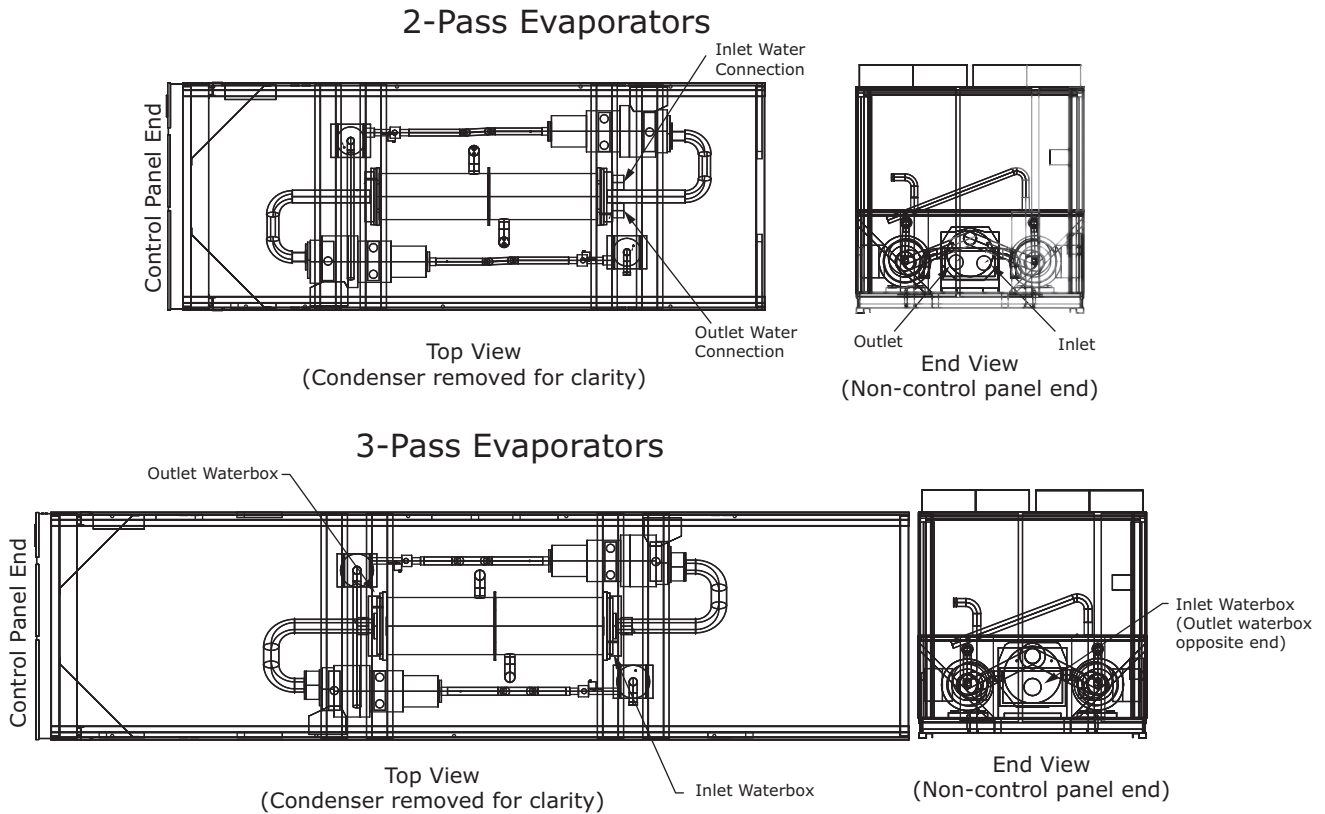

NOTICE:

Proper Water Treatment!

The use of untreated or improperly treated water could result in scaling, erosion, corrosion, algae or slime. It is recommended that the services of a qualified water treatment specialist be engaged to determine what water treatment, if any, is required. Trane assumes no responsibility for equipment failures which result from untreated or improperly treated water, or saline or brackish water.

NOTICE:

Evaporator Damage!

The chilled water connections to the evaporator are to be "victaulic" type connections. Do not attempt to weld these connections, as the heat generated from welding can cause microscopic and macroscopic fractures on the cast iron waterboxes that can lead to premature failure of the waterbox. To prevent damage to chilled water components, do not allow evaporator pressure (maximum working pressure) to exceed 150 psig (10.5 bar).

Evaporator water connections are grooved. Thoroughly flush all water piping to the unit before making the final piping connections to the unit.

Components and layout will vary slightly, depending on the location of connections and the water source.

A vent is provided on the top of the evaporator at the chilled water inlet. Be sure to provide additional vents at high points in the piping to bleed air from the chilled water system. Install necessary pressure gauges to monitor the entering and leaving chilled water pressures.

Provide shutoff valves in lines to the gauges to isolate them from the system when they are not in use. Use rubber vibration eliminators to prevent vibration transmission through the water lines.

If desired, install thermometers in the lines to monitor entering and leaving water temperatures. Install a balancing valve in the leaving water line to control water flow balance. Install shutoff valves on both the entering and leaving water lines so that the evaporator can be isolated for service

Evaporator Piping Components

Piping components include all devices and controls used to provide proper water system operation and unit

operating safety. See These components and their general locations are given below.

Figure 17. Typical Stealth™ water piping

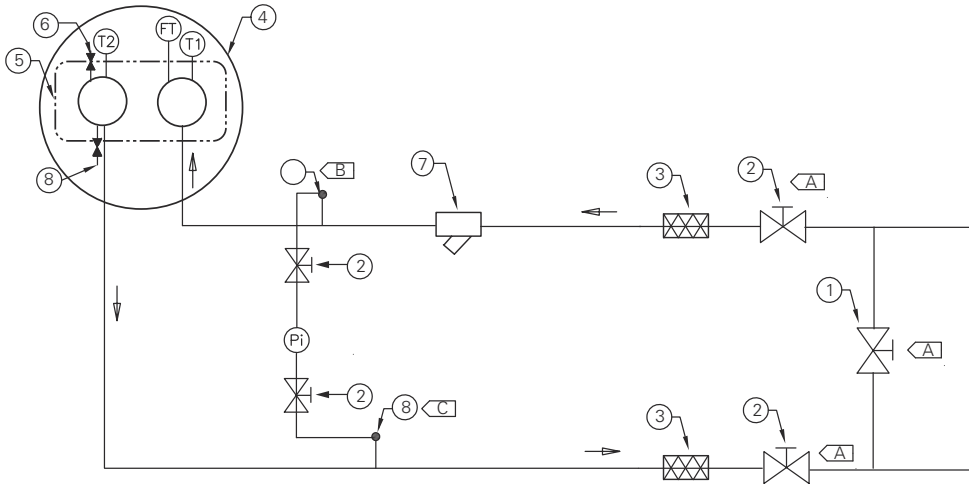


Table 14. Water piping components

| Item | Description | Item | Description |
|------|--------------------------------|--------------|--|
| 1 | Bypass Valve | Pi | Pressure Gauge |
| 2 | Isolation Valve | FT | Water Flow Switch |
| 3 | Vibration Eliminator | T1 | Evap Water Inlet Temp Sensor |
| 4 | Evaporator - End View (2-pass) | T2 | Evap Water Outlet Temp Sensor |
| 5 | Evaporator Waterbox (2-pass) | NOTES | |
| 6 | Vent | A | Isolate unit for initial water loop cleaning |
| 7 | Strainer | B | Vent must be installed at the high point of the line |
| 8 | Drain | C | Drain must be installed at the low point of the line |

Entering Chilled Water Piping

- Air vents (to bleed air from system).
- Water pressure gauges with shutoff valves.
- Vibration eliminators.
- Shutoff (isolation) valves. Thermometers (if desired).
- Clean-out tees.
- Pipe strainer.

Leaving Chilled Water Piping

- Air vents (to bleed air from system).
- Water pressure gauges with shutoff valves.
- Vibration eliminators.
- Shutoff (isolation) valves.
- Thermometers.
- Clean-out tees.
- Balancing valve.

Drains

A 1/2" drain connection is located under outlet end of evaporator waterbox for drainage during unit servicing. A shutoff valve must be installed on drain line.

Pressure Gauges

Install field-supplied pressure components as shown in [Figure 17, p. 25](#). Locate pressure gauges or taps in a straight run of pipe; avoid placement near elbows, etc. Be sure to install the gauges at the same elevation on each shell if the shells have opposite-end water connections.

To read manifolded pressure gauges, open one valve and close the other (depending upon the reading desired). This eliminates errors resulting from differently calibrated gauges installed at unmatched elevations.

Pressure Relief Valves
NOTICE:
Evaporator Damage!

To prevent shell damage, install pressure relief valves in the evaporator water system.

Install a water pressure relief valve in the evaporator inlet piping between the evaporator and the inlet shutoff valve, as shown in [Figure 17, p. 25](#). Water vessels with close-coupled shutoff valves have a high potential for hydrostatic pressure buildup on a water temperature increase. Refer to applicable codes for relief valve installation guidelines.

Evaporator Flow Switch
NOTICE:
Equipment Damage!

Flow switch is on a 24V circuit. Do NOT apply 120V to the flow switch. Incorrect voltage application could cause damage to the flow switch.

The flow switch is factory-installed and programmed based on the operating conditions submitted with the order. The leaving evaporator temperature, fluid type and fluid concentration affect the selected flow switch. If the operating conditions on the job site change, the flow switch may need to be replaced. Contact your local Trane Sales office for more information.

The sensor head includes 3 LEDs, two yellow and one green. Wait 15 seconds after power is applied to the sensor before evaluating LEDs for flow status. When wired correctly and flow is established, only the green LED should be lit. Following are the LED indicators:

- Green ON, both yellow OFF — Flow
- Green and outside yellow ON — No Flow
- Center yellow ON continuously — Miswire

Factory installed jumper wire W11 must be removed if using auxiliary contacts and/or additional proof of flow. See schematics in RTAE-SVE01*-EN for more details.

NOTICE:
Equipment Damage!

Incorrect wiring of auxiliary contacts could cause equipment damage.


If using auxiliary flow sensing, both yellow LEDs come on initially when flow is stopped. The center yellow LED will turn off after approximately 7 seconds. The LED indicators are otherwise the same as indicated above.

Indexing Flow Switch

To properly index the flow switch, the following requirements must be met:

- The dot must be at a position no greater than 90° off Index.
- The torque must be between 22 ft-lb minimum and 74 ft-lb maximum.
- A minimum distance of 5x pipe diameter must be maintained between flow switch and any bends, valves, changes in cross sections, etc.

Figure 18. Proper flow switch indexing

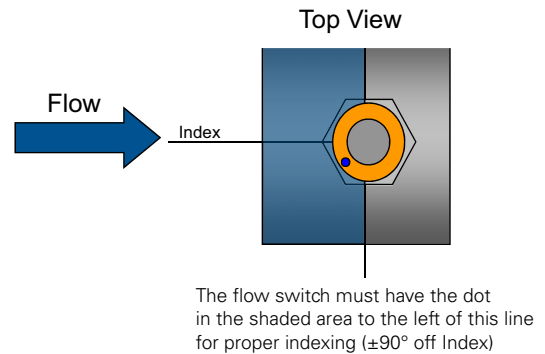

Evaporator Waterside Pressure Drop Curves

Figure 19. Evaporator waterside pressure drop curve – 2-pass


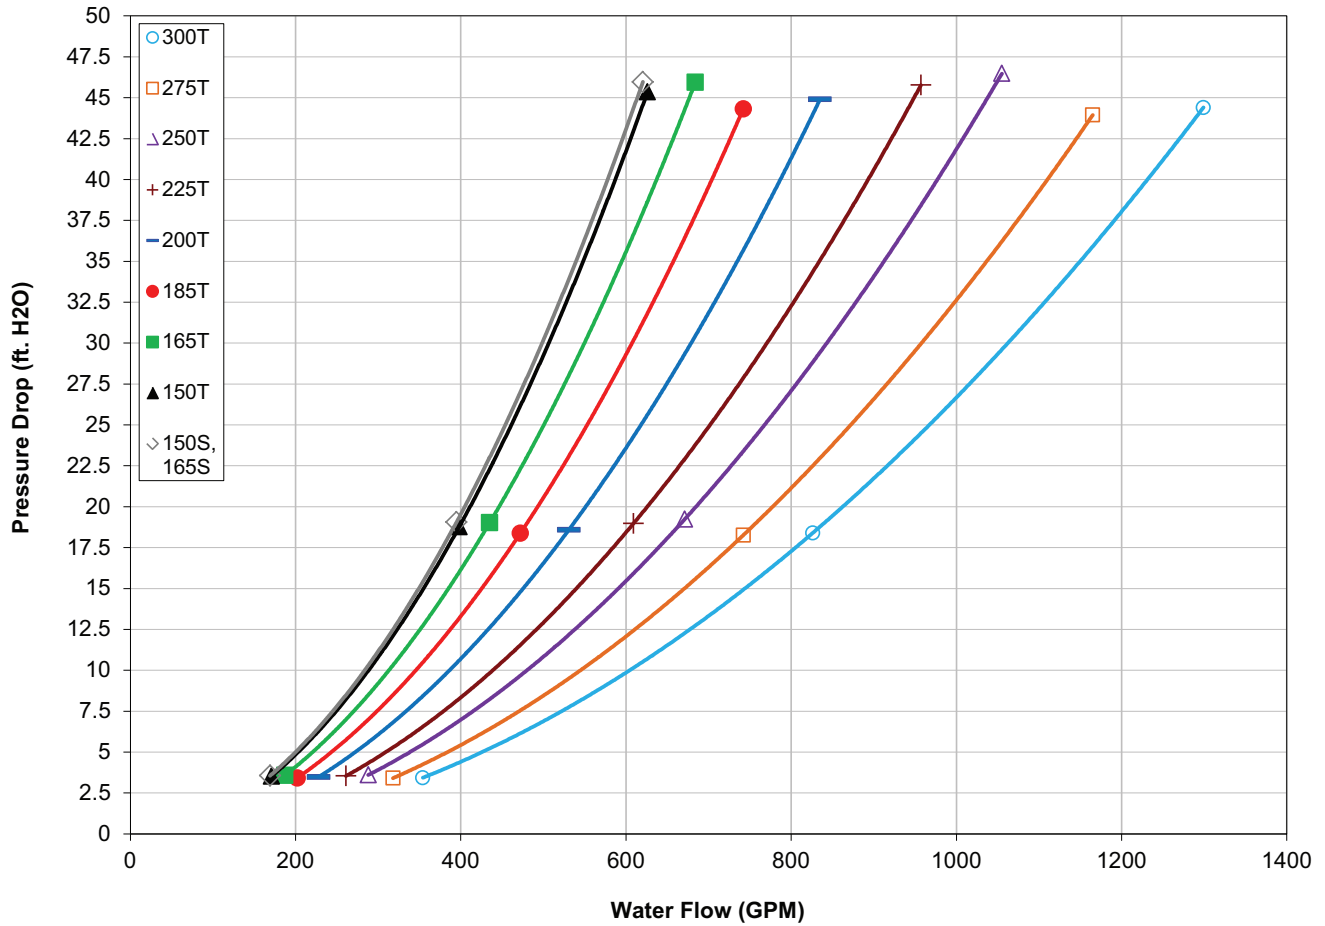


Figure 20. Evaporator waterside pressure drop curve — 3-pass

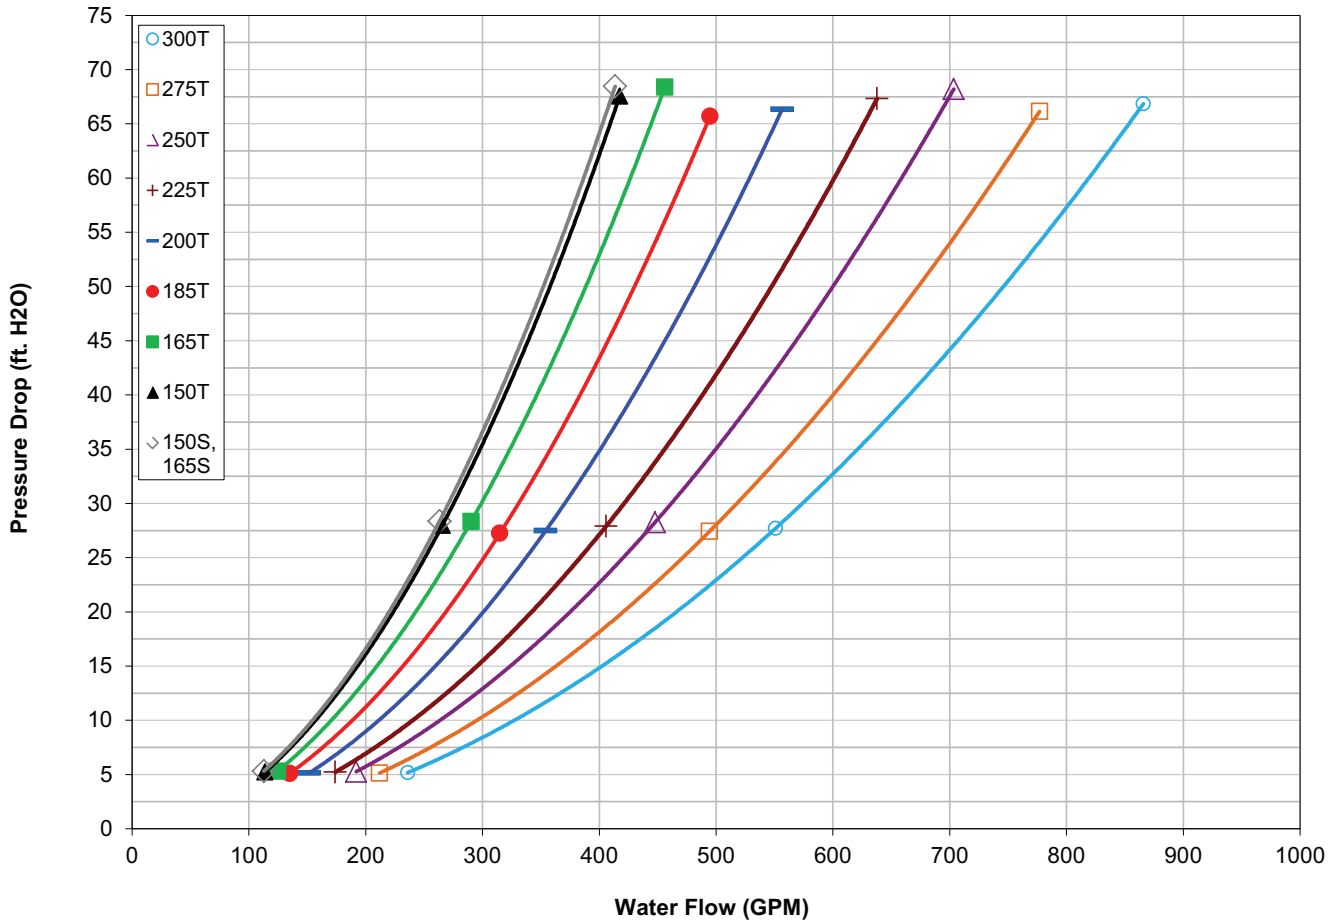

Freeze Protection

One or more of the ambient freeze avoidance methods in [Table 15](#) must be used to protect the Stealth chiller from ambient freeze damage.

Table 15. RTAC freeze avoidance methods

| Method | Protects to ambient temperature | Notes |
|--------------------------------|---|---|
| Water Pump Control AND Heaters | Down to -20°F | <ul style="list-style-type: none"> • Heaters alone will provide low ambient protection down to -20°F (-29°C), but will NOT protect the evaporator from freezing as a result of charge migration. Therefore, it is required that water pump control be used in conjunction with heaters. • Heaters are factory-installed on the evaporator and water piping and will protect them from freezing • Install heat tape on all water piping, pumps, and other components that may be damaged if exposed to freezing temperatures. Heat tape must be designed for low ambient temperature applications. Heat tape selection should be based on the lowest expected ambient temperature. • Tracer™ UC800 controller can start the pump when freezing conditions are detected. For this option the pump must be controlled by the Stealth unit and this function must be validated. • Water circuit valves need to stay open at all times. • Water pump control and heater combination will protect the evaporator down to any ambient temperature provided power is available to the pump and the controller. This option will NOT protect the evaporator in the event of a power failure to the chiller unless backup power is supplied to the necessary components. • When no chiller operation is possible and the pump is already off, UC800 pump control for freeze protection will command the pump to turn: <ul style="list-style-type: none"> ON if average of the evaporator entering water temperature, the evaporator leaving water temperature, and the evaporator refrigerant pool temperature is less than Low Evaporator Refrigerant Temperature Cutout (LERTC) + 4°F for a period of time. OFF again if the evaporator refrigerant pool temperature rises above the LERTC + 6°F for a period of time. <p><i>Note: Time period referenced for ON and Off conditions above is dependent on past running conditions and present temperatures measured.</i></p> <ul style="list-style-type: none"> ON if entering OR leaving water temperature < LWTC for 30°F-sec (17°C-sec) OFF again if water temperature > LWTC for 30 min |
| Freeze Inhibitor | Varies. See "Low Evaporator Refrigerant Cutout, Glycol Requirements," p. 30 | <ul style="list-style-type: none"> • Freeze protection can be accomplished by adding sufficient glycol to protect against freezing below the lowest ambient expected. • Use of glycol type antifreeze reduces the cooling capacity of the unit and must be considered in the design of the system specifications. |
| Drain Water Circuit | Below -20°F | <ul style="list-style-type: none"> • Shut off the power supply to the unit and to all heaters. • Purge the water circuit. • Blow out the evaporator to ensure no liquid is left in the evaporator. |

NOTICE:

Evaporator Damage!

If insufficient concentration or no glycol is used, the evaporator water flow must be controlled by the UC800 AND heaters must be used to avoid catastrophic damage to the evaporator due to freezing. It is the responsibility of the installing contractor and/or the customer to ensure that a pump will start when called upon by the chiller controls. Refer to RLC-PRB012-EN. Even with water pump control, a power loss of as little as 15 minutes under freezing conditions can damage the evaporator. Only the proper addition of freeze inhibitor or complete drainage of the water circuit can ensure no evaporator damage in the event of a power failure.



Low Evaporator Refrigerant Cutout, Glycol Requirements

The table below shows the low evaporator temperature cutout for different glycol levels. Additional glycol beyond the recommendations will adversely effect unit performance. The unit efficiency will be reduced and the saturated evaporator temperature will be reduced. For some operating conditions this effect can be significant.

If additional glycol is used, then use the actual percent glycol to establish the low refrigerant cutout setpoint.

Note: Table below is not a substitute for full unit simulation for proper prediction of unit performance for specific operating conditions. For information on specific conditions, contact Trane product support.

Table 16. Low evaporator refrigerant temperature cutout (LERTC) and low water temperature cutout (LWTC)

| Ethylene Glycol | | | | Propylene Glycol | | | |
|-----------------------|----------------------------|--------------------------------|-------------------------------|-----------------------|----------------------------|--------------------------------|-------------------------------|
| Glycol Percentage (%) | Solution Freeze Point (°F) | Minimum Recommended LERTC (°F) | Minimum Recommended LWTC (°F) | Glycol Percentage (%) | Solution Freeze Point (°F) | Minimum Recommended LERTC (°F) | Minimum Recommended LWTC (°F) |
| 0 | 32.0 | 28.6 | 35.0 | 0 | 32.0 | 28.6 | 35.0 |
| 2 | 31.0 | 27.6 | 34.0 | 2 | 31.0 | 27.6 | 34.0 |
| 4 | 29.7 | 26.3 | 32.7 | 4 | 29.9 | 26.5 | 32.9 |
| 5 | 29.0 | 25.6 | 32.0 | 5 | 29.3 | 25.9 | 32.3 |
| 6 | 28.3 | 24.9 | 31.3 | 6 | 28.7 | 25.3 | 31.7 |
| 8 | 26.9 | 23.5 | 29.9 | 8 | 27.6 | 24.2 | 30.6 |
| 10 | 25.5 | 22.1 | 28.5 | 10 | 26.4 | 23.0 | 29.4 |
| 12 | 23.9 | 20.5 | 26.9 | 12 | 25.1 | 21.7 | 28.1 |
| 14 | 22.3 | 18.9 | 25.3 | 14 | 23.8 | 20.4 | 26.8 |
| 15 | 21.5 | 18.1 | 24.5 | 15 | 23.1 | 19.7 | 26.1 |
| 16 | 20.6 | 17.2 | 23.6 | 16 | 22.4 | 19.0 | 25.4 |
| 18 | 18.7 | 15.3 | 21.7 | 18 | 20.9 | 17.5 | 23.9 |
| 20 | 16.8 | 13.4 | 19.8 | 20 | 19.3 | 15.9 | 22.3 |
| 22 | 14.7 | 11.3 | 17.7 | 22 | 17.6 | 14.2 | 20.6 |
| 24 | 12.5 | 9.1 | 15.5 | 24 | 15.7 | 12.3 | 18.7 |
| 25 | 11.4 | 8.0 | 14.4 | 25 | 14.8 | 11.4 | 17.8 |
| 26 | 10.2 | 6.8 | 13.2 | 26 | 13.8 | 10.4 | 16.8 |
| 28 | 7.7 | 4.3 | 10.7 | 28 | 11.6 | 8.2 | 14.6 |
| 30 | 5.1 | 1.7 | 8.1 | 30 | 9.3 | 5.9 | 12.3 |
| 32 | 2.3 | -1.1 | 5.3 | 32 | 6.8 | 3.4 | 9.8 |
| 34 | -0.7 | -4.1 | 5.0 | 34 | 4.1 | 0.7 | 7.1 |
| 35 | -2.3 | -5.0 | 5.0 | 35 | 2.7 | -0.7 | 5.7 |
| 36 | -3.9 | -5.0 | 5.0 | 36 | 1.3 | -2.1 | 5.0 |
| 38 | -7.3 | -5.0 | 5.0 | 38 | -1.8 | -5.0 | 5.0 |
| 40 | -10.8 | -5.0 | 5.0 | 40 | -5.2 | -5.0 | 5.0 |
| 42 | -14.6 | -5.0 | 5.0 | 42 | -8.8 | -5.0 | 5.0 |
| 44 | -18.6 | -5.0 | 5.0 | 44 | -12.6 | -5.0 | 5.0 |
| 45 | -20.7 | -5.0 | 5.0 | 45 | -14.6 | -5.0 | 5.0 |
| 46 | -22.9 | -5.0 | 5.0 | 46 | -16.7 | -5.0 | 5.0 |
| 48 | -27.3 | -5.0 | 5.0 | 48 | -21.1 | -5.0 | 5.0 |
| 50 | -32.1 | -5.0 | 5.0 | 50 | -25.8 | -5.0 | 5.0 |

Installation Electrical

General Recommendations

As you review this manual, keep in mind that:

- All field-installed wiring must conform to National Electric Code (NEC) guidelines, and any applicable state and local codes. Be sure to satisfy proper equipment grounding requirements per NEC.
- Compressor motor and unit electrical data (including motor kW, voltage utilization range, rated load amps) is listed on the chiller nameplate.
- All field-installed wiring must be checked for proper terminations, and for possible shorts or grounds.
- All electrical enclosures on CE marked chillers (unit model number digit 13 = C) have an environmental rating of IP53.

Note: Always refer to wiring diagrams shipped with chiller or unit submittal for specific electrical schematic and connection information.

⚠ WARNING

Hazardous Voltage w/Capacitors!

Disconnect all electric power, including remote disconnects and discharge all motor start/run and AFD (Adaptive Frequency™ Drive) capacitors before servicing. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized.

- For variable frequency drives or other energy storing components provided by Trane or others, refer to the appropriate manufacturer's literature for allowable waiting periods for discharge of capacitors. Verify with an appropriate voltmeter that all capacitors have discharged.
- DC bus capacitors retain hazardous voltages after input power has been disconnected. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized. After disconnecting input power, wait five (5) minutes for the DC capacitors to discharge, then check the voltage with a voltmeter. Make sure DC bus capacitors are discharged (0 VDC) before touching any internal components.

Failure to follow these instructions could result in death or serious injury.

For additional information regarding the safe discharge of capacitors, see "Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge," p. 32 and PROD-SVB06A-EN.

⚠ WARNING

Hazardous Voltage - Pressurized Burning Fluid!

The motors in the compressors have strong permanent magnet motors and have the capability to generate voltage during situations when the refrigerant charge is being migrated. This potential will be present at the motor terminals and at the output of the variable speed drives in the power panel.

Before removing compressor terminal box cover for servicing, or servicing power side of control panel, **CLOSE COMPRESSOR DISCHARGE SERVICE VALVE** and disconnect all electric power including remote disconnects. Discharge all motor start/run capacitors. Follow lockout/tagout procedures to ensure the power cannot be inadvertently energized. Verify with an appropriate voltmeter that all capacitors have discharged.

The compressor contains hot, pressurized refrigerant. Motor terminals act as a seal against this refrigerant. Care should be taken when servicing NOT to damage or loosen motor terminals.

Do not operate compressor without terminal box cover in place.

Failure to follow all electrical safety precautions could result in death or serious injury.

For additional information regarding the safe discharge of capacitors, see "Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge," p. 32 and PROD-SVB06A-EN.

⚠ WARNING

Proper Field Wiring and Grounding Required!

All field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses **FIRE** and **ELECTROCUTION** hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in NEC and your local/state electrical codes. Failure to follow code could result in death or serious injury.

NOTICE:

Use Copper Conductors Only!

Unit terminals are not designed to accept other types of conductors. Failure to use copper conductors could result in equipment damage.

Important: To prevent control malfunctions, do not run low voltage wiring (<30 V) in conduit with conductors carrying more than 30 volts.

Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge

After disconnecting input power, wait five (5) minutes for the DC capacitors to discharge.

Using voltmeter, measure voltage on bus at bus indicator module tabs 1 and 2, accessed through slots in protective cover on drive. See [Figure 21, p. 32](#) for location of bus indicator module on the AFD drive. See [Figure 22, p. 32](#) for details of bus indicator module. Capacitors are fully discharged when voltage across these tabs measures 0 VDC.

Figure 21. AFD board - indicator location


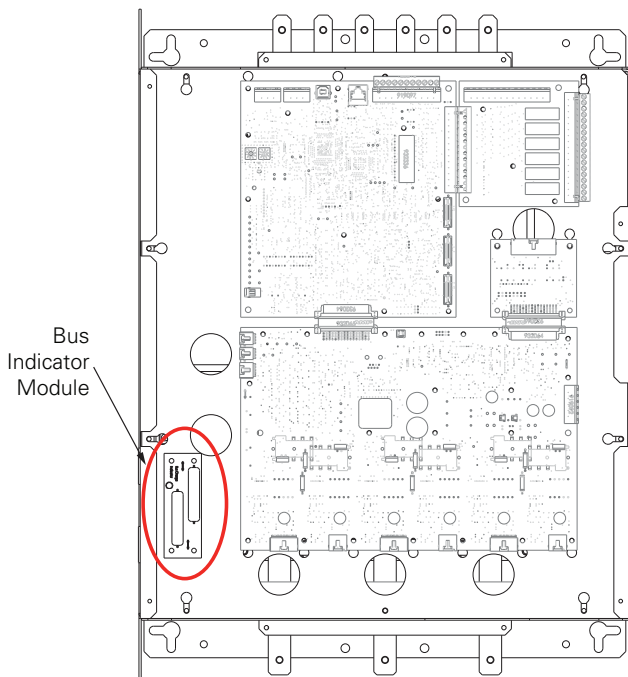


Figure 22. Bus indicator module detail



Units with Nitrogen Charge Option

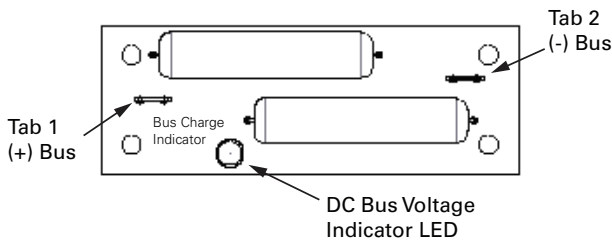

For units with nitrogen charge option (model number digit 15 = 2), the unit must NOT have shore power, or unit power applied until the unit has been charged. Applying power will drive EXV valves closed, and will inhibit sufficient vac for unit charging.

Installer-Supplied Components

Customer wiring interface connections are shown in the electrical schematics and connection diagrams that are shipped with the unit. The installer must provide the following components if not ordered with the unit:

- Power supply wiring (in conduit) for all field-wired connections.
- All control (interconnecting) wiring (in conduit) for field supplied devices.
- Fused-disconnect switches or circuit breakers.

Power Supply Wiring

⚠ WARNING

Proper Field Wiring and Grounding Required!

All field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses **FIRE** and **ELECTROCUTION** hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in **NEC** and your local/state electrical codes. Failure to follow code could result in death or serious injury.

⚠ WARNING

Hazardous Voltage w/Capacitors!

Disconnect all electric power, including remote disconnects and discharge all motor start/run capacitors before servicing. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized. For variable frequency drives or other energy storing components provided by Trane or others, refer to the appropriate manufacturer's literature for allowable waiting periods for discharge of capacitors. Verify with an appropriate voltmeter that all capacitors have discharged. Failure to disconnect power and discharge capacitors before servicing could result in death or serious injury.

DC bus capacitors retain hazardous voltages after input power has been disconnected. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized. After disconnecting input power, wait five (5) minutes for the DC capacitors to discharge and then check the voltage with a voltmeter to ensure the dc bus capacitors are discharged before touching any internal components. Failure to observe this precaution could result in death or serious injury.

For additional information regarding the safe discharge of capacitors, see **"Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge," p. 32 and PROD-SVB06A-EN.**

All power supply wiring must be sized and selected accordingly by the project engineer in accordance with NECTable 310-16.

All wiring must comply with local codes and the National Electrical Code. The installing (or electrical) contractor must provide and install the system interconnecting wiring, as well as the power supply wiring. It must be properly sized and equipped with the appropriate fused disconnect switches.

The type and installation location(s) of the fused disconnects must comply with all applicable codes.

NOTICE:

Use Copper Conductors Only!

Unit terminals are not designed to accept other types of conductors. Failure to use copper conductors could result in equipment damage.

Incoming customer power location varies with unit configurations.

- Control Panel (see [Figure 23](#))
 - Standard length units (model number digits 28, 29 = 0X)
 - Units with optional harmonic filtration (model number digit 29 = 1)
- Transformer (see [Figure 24, p. 34](#))
 - 200, 230 or 575 V units with transformer (model number digit 28 = 1)

Figure 23. Incoming customer power - control panel


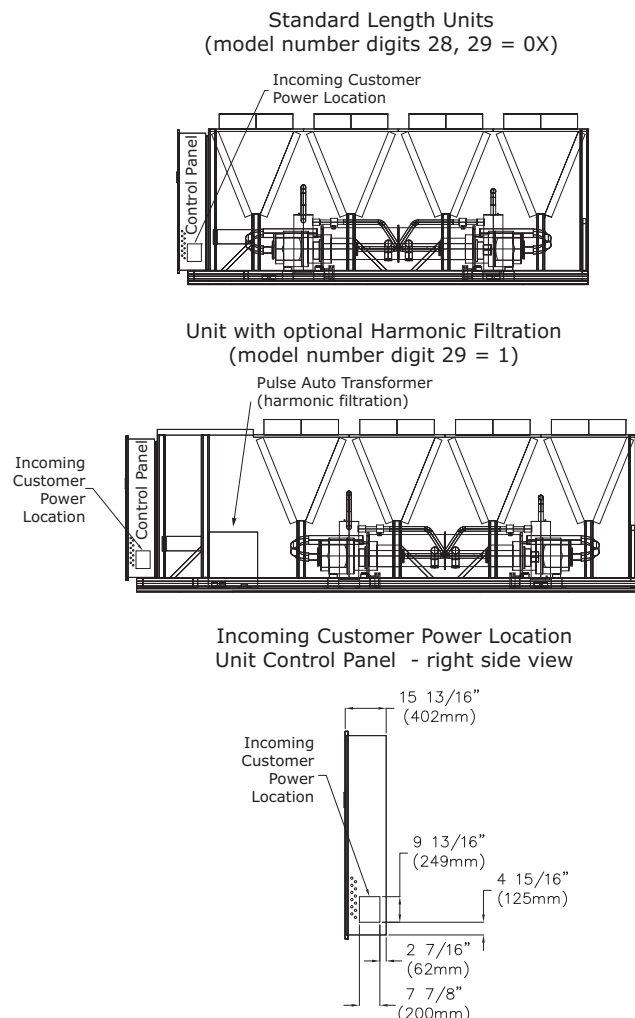


Figure 24. Incoming customer power - transformer

200V, 230V and 575V units
(Includes optional Transformer
model number digit 28 = 1)

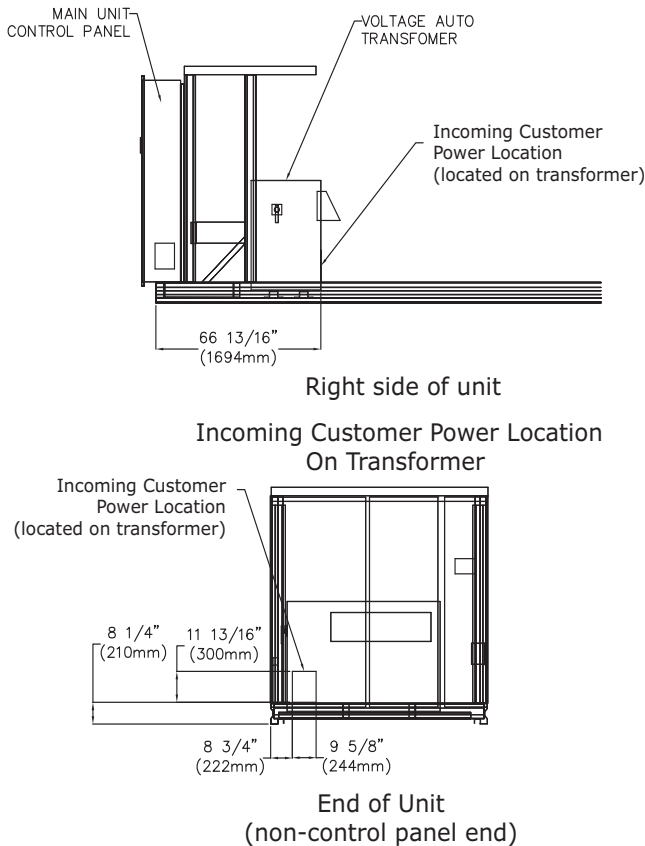

Cut holes into the location shown above for the appropriately-sized power wiring conduits. The wiring is passed through these conduits and connected to the terminal blocks, optional unit-mounted disconnects, or HACR type breakers.

The high voltage field-provided connections are made through patch plate on the right side of the main control panel or on the right side of the voltage autotransformer panel.

The low voltage connections are made through knockouts provided on the left side of the control panel. Additional grounds may be required for each 115 volt power supply to the unit. Green lugs are provided for 115V customer wiring.

Control Power Supply

The unit is equipped with a control power transformer. It is not necessary to provide additional control power voltage to the unit. No other loads should be connected to the control power transformer.

All units are factory-connected for appropriate labeled voltages.

Service Power Connection

The service power connection is a touch safe procedure to allow for binding the control system and LLIDs. Service power connection allows for a NEMA 5-15 style extension cord to power on Class 2 devices (i.e. UC800, LLIDs, EXVs, and TD7 display) with an external power source, without the need of line voltage applied to the unit. This connection is to be made at 1XJ50. The extension cord power source is required to have upstream current protection rated at no more than 10A. The required voltage for the service power connection is 115V at 60Hz and 110V at 50Hz.

Heater Power Supply

The evaporator shell is insulated from ambient air and protected from freezing temperatures by thermostatically-controlled immersion heaters. See Table 17 for evaporator heater summary. Whenever the water temperature drops to approximately 37°F (2.8°C), the thermostat energizes the heaters. The heaters will provide protection from ambient temperatures down to -20°F (-29°C).

NOTICE:

Equipment Damage!

Control panel main processor does not verify thermostat operation. A qualified technician must confirm operation of the thermostat to avoid catastrophic damage to the evaporator.

Table 17. Evaporator heater summary

| Unit Size (tons) | Waterboxes | |
|--------------------------|--------------|--------|
| | Supply | Return |
| 2-pass Evaporator | | |
| 150-165 | 400W | 400W |
| 180-200 | 400W (Qty 2) | 400W |
| 225-300 | 600W | 600W |
| 3-pass Evaporator | | |
| All sizes | 400W (Qty 2) | 400W |

Interconnecting Wiring

Chilled Water Pump Control

NOTICE:

Equipment Damage!

If the microprocessor calls for a pump to start and water does not flow, the evaporator may be damaged catastrophically. It is the responsibility of the installing contractor and/or the customer to ensure that a pump will always be running when called upon by the chiller controls.

An evaporator water pump output relay closes when the chiller is given a signal to go into the Auto mode of operation from any source. The contact is opened to turn off the pump in the event of most machine level diagnostics to prevent the build up of pump heat.

The relay output is required to operate the Evaporator Water Pump (EWP) contactor. Contacts should be compatible with 115/240 VAC control circuit. Normally, the EWP relay follows the AUTO mode of the chiller. Whenever the chiller has no diagnostics and is in the AUTO mode, regardless of where the auto command is coming from, the normally open relay is energized. When the chiller exits the AUTO mode, the relay is timed to open in an adjustable (using TechView) 0 to 30 minutes. The non-AUTO modes in which the pump is stopped, include Reset, Stop, External Stop, Remote Display Stop, Stopped by Tracer, Start Inhibited by Low Ambient Temp, and Ice Building complete.

Table 18. Pump Relay Operation

| Chiller Mode | Relay Operation |
|---|----------------------------------|
| Auto | Instant Close |
| Ice Building | Instant Close |
| Tracer Override | Close |
| Stop | Timed Open |
| Ice Complete | Instant Open |
| Diagnostics | Instant Operation ^(a) |
| Chiller Shutdown Diagnostics (except freeze protection) | Instant Open |
| Freeze Protection related chiller shutdown diagnostics | Delayed/Dependent Open |
| Chiller Off Cycle Freeze Diagnostics | Instant Close – Dependent Open |

(a) Operation can be instant open or instant close, depending on diagnostic.

When going from Stop to Auto, the EWP relay is energized immediately. If evaporator water flow is not established in 20 minutes (for normal transition) or 4 minutes, 15 seconds (for pump commanded ON due to an override safety), the UC800 de-energizes the EWP relay and generates a non-latching diagnostic. If flow returns (e.g. someone else is controlling the pump), the diagnostic is

cleared, the EWP is re-energized, and normal control resumed.

If evaporator water flow is lost once it had been established, the EWP relay remains energized and a non-latching diagnostic is generated. If flow returns, the diagnostic is cleared and the chiller returns to normal operation.

In general, when there is either a non-latching or latching diagnostic, the EWP relay is turned off as though there was a zero time delay. Exceptions whereby the relay continues to be energized occur with:

- **Low Chilled Water Temperature diagnostic** (non-latching unless also accompanied by an Evap Leaving Water Temperature Sensor Diagnostic)
- or
- **Interrupt Failure – AFDxA diagnostic** (where x is either 1 or 2 to indicate which drive is affected), in which a compressor continues to draw current even after commanded to have shutdown.
- or
- **Loss of Evaporator Water Flow diagnostic** (non-latching) and the unit is in the AUTO mode, after initially having proven evaporator water flow.

Programmable Relays

A programmable relay concept provides for enunciation of certain events or states of the chiller, selected from a list of likely needs, while only using four physical output relays, as shown in the field wiring diagram. The four relays are provided (generally with a Quad Relay Output LLID) as part of the Programmable Relay Option. The relay's contacts are isolated Form C (SPDT), suitable for use with 120 VAC circuits drawing up to 2.8 amps inductive, 7.2 amps resistive, or 1/3 HP and for 240 VAC circuits drawing up to 0.5 amp resistive.

The list of events/states that can be assigned to the programmable relays can be found in Table 19. The relay will be energized when the event/state occurs.

Table 19. Alarm and status relay output configuration table

| | Description |
|---------------------|---|
| Alarm - Latching | This output is true whenever there is any active latching shutdown diagnostic that targets the Unit, Circuit, or any of the Compressors on a circuit. |
| Alarm - NonLatching | This output is true whenever there is any active non-latching shutdown diagnostic that targets the Unit, Circuit, or any of the Compressors on a circuit. |
| Alarm | This output is true whenever there is any active latching or non-latching shutdown diagnostic that targets the Unit, Circuit, or any of the Compressors on a circuit. |



Installation Electrical

Table 19. Alarm and status relay output configuration table (continued)

| | Description |
|------------------------------|--|
| Alarm Ckt 1 | This output is true whenever there is any active latching or non-latching shutdown diagnostic that targets Circuit 1, or any of the Compressors on Circuit |
| Alarm Ckt 2 | This output is true whenever there is any active latching or non-latching shutdown diagnostic that targets Circuit 2, or any of the Compressors on Circuit 2. |
| Unit Limit Mode | This output is true whenever a circuit on the unit has been running in one of the limit modes continuously for the Limit Relay debounce time. A given limit or overlapping of different limits must be in effect continuously for the debounce time prior to the output becoming true. It will become false if no limits are present for the debounce time. |
| Compressor Running | The output is true whenever any compressor is running. |
| Circuit 1 Running | The output is true whenever any compressor of Circuit 1 is running. |
| Circuit 2 Running | The output is true whenever any compressor of Circuit 2 is running. |
| Maximum Capacity | The output is true whenever the unit has reached maximum capacity continuously for the Max Capacity Relay debounce time. The output is false when the unit is not at maximum capacity continuously for the filter debounce time. |
| Head Pressure Relief Request | This relay output is energized anytime the chiller or a single circuit on the chiller is running in one of the following modes; Ice Making Mode, or Condenser Pressure Limit continuously for the duration specified by the Chiller Head Relief Relay Filter Time. The Chiller Head Relief Relay Filter Time is a service setpoint. The relay output is de-energized anytime the chiller exits all above modes continuously for the duration specified by the same Chiller Head Relief Relay Filter Time |

Relay Assignments Using Tracer™ TU

Tracer™ TU Service Tool is used to install the Programmable Relay Option package and assign any of the above list of events or status to each of the four relays provided with the option. (See “Tracer™ TU,” p. 55 for more information on the Tracer TU service tool.) The relays to be programmed are referred to by the relay’s terminal numbers on the LLID board 1K13.

The default assignments for the four available relays of the Programmable Relay option are:

Table 20. Default assignments

| Relay | |
|---------|--|
| Relay 0 | Terminals J2-1,2,3: Unit Limit Mode |
| Relay 1 | Terminals J2-4,5,6: Maximum Capacity |
| Relay 2 | Terminals J2 - 7,8,9: Compressor Running |
| Relay 3 | Terminals J2 -10,11,12: Alarm |

If any of the Alarm/Status relays are used, provide electrical power, 115 VAC with fused-disconnect to the panel and wire through the appropriate relays (terminals on 1K13 (EUR=A4-5)). Provide wiring (switched hot, neutral, and ground connections) to the remote annunciation devices. Do not use power from the chiller’s control panel transformer to power these remote devices. Refer to the field diagrams which are shipped with the unit.

Low Voltage Wiring

The remote devices described below require low voltage wiring. All wiring to and from these remote input devices to the Control Panel must be made with shielded, twisted pair conductors. Be sure to ground the shielding only at the panel.

Important: To prevent control malfunctions, do not run low voltage wiring (<30 V) in conduit with conductors carrying more than 30 volts.

Emergency Stop

UC800 provides auxiliary control for a customer specified/ installed latching trip out. When this customer-furnished remote contact 5K35 is provided, the chiller will run normally when the contact is closed. When the contact opens, the unit will trip on a manually resettable diagnostic. This condition requires manual reset at the front of the control panel.

Connect low voltage leads to terminal strip locations on 1K2. Refer to the field diagrams that are shipped with the unit.

Silver or gold-plated contacts are recommended. These customer-furnished contacts must be compatible with 24 VDC, 12 mA resistive load.

External Auto/Stop

If the unit requires the external Auto/Stop function, the installer must provide leads from the remote contacts 5K34 to the proper terminals of the LLID 1K2 on the control panel.

The chiller will run normally when the contacts are closed. When either contact opens, the compressor(s), if operating, will go to the RUN:UNLOAD operating mode and cycle off. Unit operation will be inhibited. Closure of the contacts will permit the unit to return to normal operation.

Field-supplied contacts for all low voltage connections must be compatible with dry circuit 24 VDC for a 12 mA resistive load. Refer to the field diagrams that are shipped with the unit.

External Circuit Lockout – Circuit #1 and #2

UC800 provides auxiliary control of a customer specified or installed contact closure, for individual operation of either Circuit #1 or #2. If the contact is closed, the refrigerant circuit will not operate 5K32 and 5K33.

Upon contact opening, the refrigerant circuit will run normally. This feature is used to restrict total chiller operation, e.g. during emergency generator operations.

Connections to 1K3 are shown in the field diagrams that are shipped with the unit.

These customer-supplied contact closures must be compatible with 24 VDC, 12 mA resistive load. Silver or gold plated contacts are recommended.

Ice Building Option

UC800 provides auxiliary control for a customer specified/ installed contact closure for ice building if so configured and enabled. This output is known as the Ice Building Status Relay. The normally open contact will be closed when ice building is in progress and open when ice building has been normally terminated either through Ice Termination setpoint being reached or removal of the Ice Building command. This output is for use with the ice storage system equipment or controls (provided by others) to signal the system changes required as the chiller mode changes from “ice building” to “ice complete”. When contact 5K36 is provided, the chiller will run normally when the contact is open.

UC800 will accept either an isolated contact closure (External Ice Building command) or a Remote Communicated input (Tracer) to initiate and command the Ice Building mode.

UC800 also provides a “Front Panel Ice Termination Setpoint”, settable through Tracer™ TU, and adjustable from 20 to 31°F (-6.7 to -0.5°C) in at least 1°F (1°C) increments.

Note: *When in the Ice Building mode, and the evaporator entering water temperature drops below the ice termination setpoint, the chiller terminates the Ice Building mode and changes to the Ice Building Complete Mode.*

NOTICE:

Equipment Damage!

Freeze inhibitor must be adequate for the leaving water temperature. Failure to do so will result in damage to system components.

Tracer™ TU must also be used to enable or disable Ice Machine Control. This setting does not prevent the Tracer from commanding Ice Building mode.

Upon contact closure, the UC800 will initiate an ice building mode, in which the unit runs fully loaded at all times. Ice building shall be terminated either by opening the contact or based on the entering evaporator water temperature. UC800 will not permit the ice building mode to be reentered until the unit has been switched out of ice building mode (open 5K36 contacts) and then switched back into ice building mode (close 5K36 contacts.)

In ice building, all limits (freeze avoidance, evaporator, condenser, current) will be ignored. All safeties will be enforced.

If, while in ice building mode, the unit gets down to the freeze stat setting (water or refrigerant), the unit will shut down on a manually resettable diagnostic, just as in normal operation.

Connect leads from 5K36 to the proper terminals of 1K8. Refer to the field diagrams which are shipped with the unit.

Silver or gold-plated contacts are recommended. These customer furnished contacts must be compatible with 24 VDC, 12 mA resistive load.

External Chilled Water Setpoint (ECWS) Option

The UC800 provides inputs that accept either 4-20 mA or 2-10 VDC signals to set the external chilled water setpoint (ECWS). This is not a reset function. The input defines the setpoint. This input is primarily used with generic BAS (building automation systems). The chilled water setpoint set via the Tracer AdaptiView™ TD7 or through digital communication with Tracer (Comm3). The arbitration of the various chilled water setpoint sources is described in the flow charts at the end of the section.

The chilled water setpoint may be changed from a remote location by sending either a 2-10 VDC or 4-20 mA signal to the 1K14, terminals 5 and 6 LLID. 2-10 VDC and 4-20 mA each correspond to a 10 to 65°F (-12 to 18°C) external chilled water setpoint.

The following equations apply:

Voltage Signal

As generated from external source $VDC = 0.1455 * (ECWS) + 0.5454$
 As processed by UC800 $ECWS = 6.875 * (VDC) - 3.75$

Current Signal

As generated from external source $mA = 0.2909 * (ECWS) + 1.0909$
 As processed by UC800 $ECWS = 3.4375 * (mA) - 3.75$

If the ECWS input develops an open or short, the LLID will report either a very high or very low value back to the main processor. This will generate an informational diagnostic and the unit will default to using the Front Panel (TD7) Chilled Water Setpoint.

Tracer TU Service Tool is used to set the input signal type from the factory default of 2-10 VDC to that of 4-20 mA. Tracer TU is also used to install or remove the External Chilled Water Setpoint option as well as a means to enable and disable ECWS.

External Demand Limit Setpoint (EDLS) Option

Similar to the above, the UC800 also provides for an optional External Demand Limit Setpoint that will accept either a 2-10 VDC (default) or a 4-20 mA signal. The Demand Limit Setting can also be set via the Tracer AdaptiView™ TD7 or through digital communication with

Tracer (Comm 3). The arbitration of the various sources of demand limit is described in the flow charts at the end of this section. The External Demand Limit Setpoint may be changed from a remote location by hooking up the analog input signal to the 1K14 LLID terminals 2 and 3. Refer to the following paragraph on Analog Input Signal Wiring Details. The following equations apply for EDLS:

| | Voltage Signal | Current Signal |
|-----------------------------------|----------------------------|----------------------------|
| As generated from external source | $VDC + 0.133 * (\%) - 6.0$ | $mA = 0.266 * (\%) - 12.0$ |
| As processed by UCM | $\% = 7.5 * (VDC) + 45.0$ | $\% = 3.75 * (mA) + 45.0$ |

If the EDLS input develops an open or short, the LLID will report either a very high or very low value back to the man processor. This will generate an informational diagnostic and the unit will default to using the Front Panel (Tracer AdaptiView™ TD7) Current Limit Setpoint.

The Tracer™ TU Service Tool must be used to set the input signal type from the factory default of 2-10 VDC to that of 4-20 mA current. Tracer TU must also be used to install or remove the External Demand Limit Setpoint Option for field installation, or can be used to enable or disable the feature (if installed).


EDLS and ECWS Analog Input Signal Wiring Details:

Both the ECWS and EDLS can be connected and setup as either a 2-10 VDC (factory default), 4-20 mA, or resistance input (also a form of 4-20mA) as indicated below. Depending on the type to be used, the Tracer TU Service Tool must be used to configure the LLID and the MP for the proper input type that is being used. This is accomplished by a setting change on the Custom Tab of the Configuration View within Tracer TU.

Important: For proper unit operation, BOTH the EDLS and ECWS settings MUST be the same (2-10 VDC or 4-20mA), even if only one input is to be used.

The J2-3 and J2-6 terminal is chassis grounded and terminal J2- 1 and J2-4 can be used to source 12VDC. The ECLS uses terminals J2-2 and J2-3. ECWS uses terminals J2-5 and J2-6. Both inputs are only compatible with high-side current sources.

Figure 25. Wiring examples for EDLS and ECWS

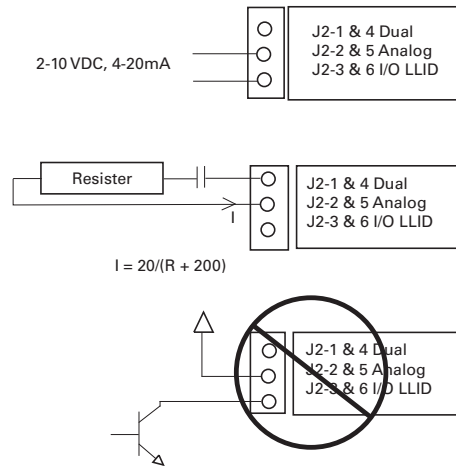

Chilled Water Reset (CWR)

UC800 resets the chilled water temperature set point based on either return water temperature, or outdoor air temperature. Return Reset is standard, Outdoor Reset is optional.

The following shall be selectable:

- One of three Reset Types: None, Return Water Temperature Reset, Outdoor Air Temperature Reset, or Constant Return Water Temperature Reset.
- Reset Ratio Set Points.
For outdoor air temperature reset there shall be both positive and negative reset ratio's.
- Start Reset Set Points.
- Maximum Reset Set Points.

The equations for each type of reset are as follows:

Return

$$CWS' = CWS + \text{RATIO} (\text{START RESET} - (TWE - TWL))$$

$$\text{and } CWS' > \text{ or } = CWS$$

$$\text{and } CWS' - CWS < \text{ or } = \text{Maximum Reset}$$

Outdoor

$$CWS' = CWS + \text{RATIO} * (\text{START RESET} - \text{TOD})$$

$$\text{and } CWS' > \text{ or } = CWS$$

$$\text{and } CWS' - CWS < \text{ or } = \text{Maximum Reset}$$

where

CWS' is the new chilled water set point or the "reset CWS"

CWS is the active chilled water set point before any reset has occurred, e.g. normally Front Panel, Tracer, or ECWS

RESET RATIO is a user adjustable gain

START RESET is a user adjustable reference

TOD is the outdoor temperature

TWE is entering evap. water temperature

TWL is leaving evap. water temperature

MAXIMUM RESET is a user adjustable limit providing the maximum amount of reset. For all types of reset, $CWS' - CWS < \text{or} = \text{Maximum Reset}$.

| Reset Type | Range | | Increment | | | |
|------------|-------------|-------------------------------|------------------------------|----------|----------|-----------------|
| | Reset Ratio | Start Reset | Max Reset | IP Units | SI Units | Factory Default |
| Return | 10 to 120% | 4 to 30 F (2.2 to 16.7 C) | 0 to 20 F (0.0 to 11.1 C) | 1% | 1% | 50% |
| Outdoor | 80 to -80% | 50 to 130 F (10 to 54.4 C) | 0 to 20 F (0.0 to 11.1 C) | 1% | 1% | 10% |

In addition to Return and Outdoor Reset, the MP provides a menu item for the operator to select a Constant Return Reset. Constant Return Reset will reset the leaving water temperature set point so as to provide a constant entering water temperature. The Constant Return Reset equation is the same as the Return Reset equation except on selection of Constant Return Reset, the MP will automatically set Ratio, Start Reset, and Maximum Reset to the following.

$$\text{RATIO} = 100\%$$

$$\text{START RESET} = \text{Design Delta Temp.}$$

$$\text{MAXIMUM RESET} = \text{Design Delta Temp.}$$

The equation for Constant Return is then as follows:

$$CWS' = CWS + 100\% (\text{Design Delta Temp.} - (\text{TWE} - \text{TWL}))$$

and $CWS' > \text{or} = CWS$

$$\text{and } CWS' - CWS < \text{or} = \text{Maximum Reset}$$

When any type of CWR is enabled, the MP will step the Active CWS toward the desired CWS' (based on the above equations and setup parameters) at a rate of 1 degree F every 5 minutes until the Active CWS equals the desired CWS'. This applies when the chiller is running.

When the chiller is not running, CWS is reset immediately (within one minute) for Return Reset and at a rate of 1 degree F every 5 minutes for Outdoor Reset. The chiller will start at the Differential to Start value above a fully reset CWS or CWS' for both Return and Outdoor Reset.

Transformer Power Rating

See table below for power rating of optional transformer (unit model number digit 28 = 1).

Table 21. Transformer power ratings

| Unit Size | Power Rating |
|----------------|--------------|
| 150 - 200 tons | 340 kVA |
| 225-300 tons | 470 kVA |

Communications Interface

LonTalk Interface (LCI-C)

UC800 provides an optional LonTalk™ Communication Interface (LCI-C) between the chiller and a Building Automation System (BAS). An LCI-C LLID shall be used to provide "gateway" functionality between a LonTalk compatible device and the Chiller. The inputs/outputs include both mandatory and optional network variables as established by the LonMark Functional Chiller Profile 8040.

Note: For more information see ACC-SVN100*-EN.

BACnet Interface (BCI-C)

Optional BACnet™ Communication Interface for Chillers (BCI-C) is comprised of a Tracer UC800 controller with interface software. It is a non-programmable communications module that allows units to communicate on a BACnet communications network.

Note: For more information, see BAS-SVP01*-EN.

Modbus Remote Terminal Unit Interface

Modicon Communication Bus (Modbus™) enables the chiller controller to communicate as a slave device on a Modbus network. Chiller setpoints, operating modes, alarms and status can be monitored and controlled by a Modbus master device.

Note: For more information, see BAS-SVP01*-EN.



Operating Principals

This section contains an overview of the operation and maintenance of Stealth RTAE units equipped with UC800 control systems. It describes the overall operating principles of the RTAE design.


Refrigeration Circuits

Each unit has two refrigerant circuits, with one rotary screw compressor per circuit. Each refrigerant circuit includes a compressor suction and discharge service valve, liquid line shutoff valve, removable core filter, liquid line sight glass with moisture indicator, charging port and an electronic expansion valve. Fully modulating compressors and electronic expansion valves provide variable capacity modulation over the entire operating range. Lower condensing temperatures and higher suction temperatures along with more efficient compressors and fans result in the premium efficiency level of Stealth Air Cooled chillers

Refrigeration Cycle

The refrigeration cycle of the RTAE chiller is represented in the pressure enthalpy diagram shown in Figure 26. Key state points are indicated on the figure. The cycle for the full load AHRI design point is represented in the plot.

Figure 26. Pressure enthalpy (P-h) diagram - RTAE

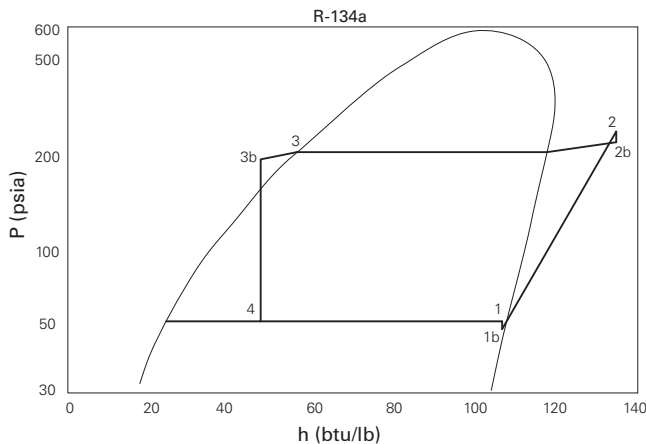

The RTAE chiller uses a shell and tube evaporator design with refrigerant evaporating on the shell side and water flowing inside tubes having enhanced surfaces (states 4 to 1). The suction lines are designed to minimize pressure drop.(states 1 to 1b).The compressor is a twin-rotor helical rotary compressor designed similarly to the compressors offered in other Trane Screw Compressor Based Chillers (states 1b to 2). The discharge lines include a highly efficient oil separation system that removes 99.8% of the oil from the refrigerant stream going to the heat exchangers (states 2 to 2b). De-superheating, condensing and sub-cooling is accomplished in a fin and tube air

cooled heat exchanger where refrigerant is condensed in the tube (states 2b to 3b). Refrigerant flow through the system is balanced by an electronic expansion valve (states 3b to 4).

Refrigerant R-134a

The RTAE chiller uses environmentally friendly R-134a. Trane believes that responsible refrigerant practices are important to the environment, our customers, and the air conditioning industry. All technicians who handle refrigerants must be certified. The Federal Clean Air Act (Section 608) sets forth the requirements for handling, reclaiming, recovering and recycling of certain refrigerants and the equipment that is used in these service procedures. In addition, some states or municipalities may have additional requirements that must also be adhered to for responsible management of refrigerants. Know the applicable laws and follow them.

R-134a is a medium pressure refrigerant. It may not be used in any condition that would cause the chiller to operate in a vacuum without a purge system. RTAE is not equipped with a purge system. Therefore, the RTAE chiller may not be operated in a condition that would result in a saturated condition in the chiller of -15°F (-26°C) or lower.

R-134a requires the use of specific POE oils as designated on the unit nameplate.

Important: Use only R-134a and Trane Oil 00311 (bulk)/00315 (1gal)/00317 (5gal) in Stealth chillers.

Compressor and Lube Oil System

The rotary screw compressor is semi-hermetic, direct drive with capacity control via a variable speed drive, rolling element bearings, differential refrigerant pressure oil pump and oil heater. The motor is a suction gas cooled, hermetically sealed, permanent magnet motor. An oil separator is provided separately from the compressor. Oil filtration is provided internal to the compressor. Check valves in the compressor discharge and lube oil system are also provided.

Condenser and Fans

Air-cooled condenser coils have aluminum fins mechanically bonded to internally finned seamless aluminum tubing. The tubing is a long life alloy designed to deliver corrosion performance that meets or exceeds microchannel coils. The condenser coil has an integral subcooling circuit. Condensers are factory proof tested at 525 psig and leak tested with helium in a mass spectrometer chamber at 150 psig. All tube connections are mechanical except the brazed copper to aluminum inlet and outlet connections. Condenser fans are direct-drive vertical discharge. The condenser fan motors are permanent magnet motors with an integrated drive to

provide variable speed fan control for all fans and are designed with permanently lubricated ball bearings, internal temperature and current overload protection, and fault feedback as a standard product offering. The fan impeller is a nine bladed-shrouded fan made from heavy-duty molded plastic. Standard units will start and operate between 32 to 105°F (0 to 40°C) ambient.

The UC800 controls calculate optimum fan speed for maximum efficiency based on compressor load and outdoor air, resulting in high IPLV values.

Evaporator

The evaporator is a tube-in-shell heat exchanger design constructed from carbon steel shells and tubesheets with internally and externally finned seamless copper tubes mechanically expanded into the tube sheets. The evaporator is designed, tested and stamped in accordance with the ASME Boiler and Pressure Vessel Code for a refrigerant side working pressure of 200 psig. The evaporator is designed for a water side working pressure of 150 psig. Standard water connections are grooved for Victaulic style pipe couplings, with flange style connections optionally available. Waterboxes are available in 2 and 3 pass configurations and include a vent, a drain and fittings for temperature control sensors. Evaporators are insulated with 3/4 inch closed cell insulation. Evaporator water heaters with thermostat are provided to help protect the evaporator from freezing at ambient temperatures down to -20°F (-29°C). A factory installed flow switch is installed on the supply water box in the evaporator inlet connection.

Drive Cooling System

Each refrigeration circuit has a compressor drive cooling circuit. Each drive cooling circuit includes a wet rotor circulation pump that circulates a secondary heat transfer fluid in a closed system between the adaptive frequency drive components between the heat sinks of the adaptive frequency drive and a brazed plate heat exchanger. The pump is fed from a thermal expansion tank with a vented-pressure cap which is also used as the circuit pressure relief. The circuit also includes a particulate strainer and a drain valve for servicing.



Controls

Overview

Stealth™ RTAE units utilize the following control/interface components:

- Tracer™ UC800 Controller
- Tracer AdaptiView™ TD7 Operator Interface


UC800 Specifications

This section covers information pertaining to the UC800 controller hardware.

Wiring and Port Descriptions

Figure 27 illustrates the UC800 controller ports, LEDs, rotary switches, and wiring terminals. The numbered list following Figure 27 corresponds to the numbered callouts in the illustration.

Figure 27. Wiring locations and connection ports

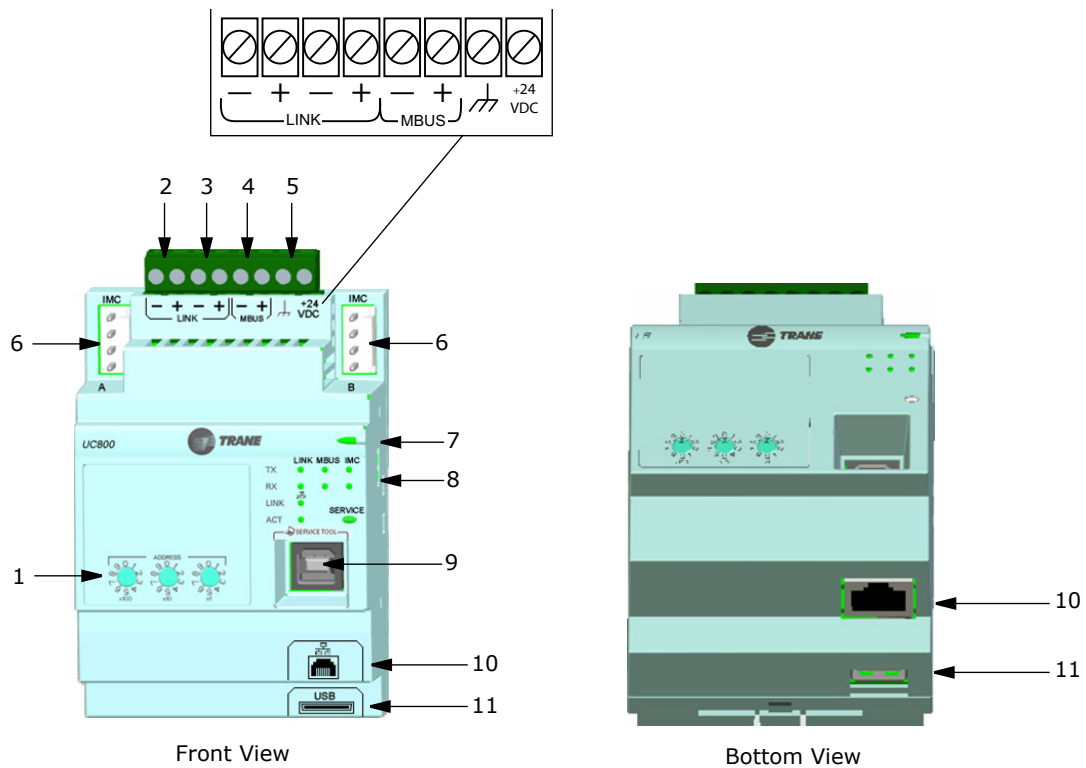

1. Rotary Switches for setting BACnet® MAC address or MODBUS ID.
2. LINK for BACnet MS/TP, or MODBUS Slave (two terminals, ±). Field wired if used.
3. LINK for BACnet MS/TP, or MODBUS Slave (two terminals, ±). Field wired if used.
4. Machine bus for existing machine LLIDs (IPC3Tracer bus 19.200 baud). *IPC3 Bus: used for Comm4 using TCI or LonTalk® using LCI-C.*
5. Power (210 mA at 24 Vdc) and ground terminations (same bus as item 4). Factory wired.
6. Not used.
7. Marquee LED power and UC800 Status indicator (Table 22, p. 43).
8. Status LEDs for the BAS link, MBus link, and IMC link.
9. USB device type B connection for the service tool (TracerTU).
10. The Ethernet connection can *only* be used with the Tracer AdaptiView display.
11. USB Host (not used).

Communication Interfaces

There are four connections on the UC800 that support the communication interfaces listed. See [Figure 27, p. 42](#) for the locations of each of these ports.

- BACnet[®] MS/TP
- MODBUS[™] Slave
- LonTalk[™] using LCI-C (from the IPC3 bus)
- Comm 4 using TCI (from the IPC3 bus)

Rotary Switches

There are three rotary switches on the front of the UC800 controller. Use these switches to define a three-digit address when the UC800 is installed in a BACnet or MODBUS system (e.g., 107, 127, etc.).

Note: Valid addresses are 001 to 127 for BACnet and 001 to 247 for MODBUS.

LED Description and Operation

There are 10 LEDs on the front of the UC800. [Figure 28](#) shows the locations of each LED and [Table 22](#) describes their behavior in specific instances.

Figure 28. LED locations

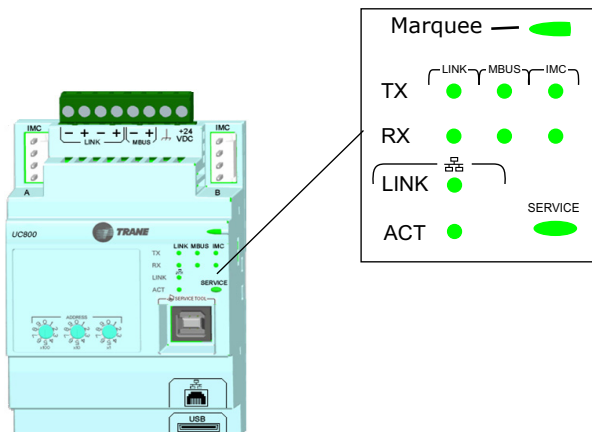


Table 22. LED behavior

| LED | UC800 Status |
|-----------------|---|
| Marquee LED | Powered. If the Marquee LED is green solid, the UC800 is powered and no problems exist. |
| | Low power or malfunction. If the Marquee LED is red solid, the UC800 is powered, but there are problems present. |
| | Alarm. The Marquee LED blinks Red when an alarm exists. |
| LINK, MBUS, IMC | The TX LED blinks green at the data transfer rate when the UC800 transfers data to other devices on the link. |
| | The Rx LED blinks yellow at the data transfer rate when the UC800 receives data from other devices on the link. |
| Ethernet Link | The LINK LED is solid green if the Ethernet link is connected and communicating. |
| | The ACT LED blinks yellow at the data transfer rate when data flow is active on the link. |
| Service | The Service LED is solid green when pressed. For qualified service technicians only. Do not use. |

NOTICE:

Electrical Noise!

Maintain at least 6 inches between low-voltage (<30V) and high voltage circuits. Failure to do so could result in electrical noise that could distort the signals carried by the low-voltage wiring, including IPC.

Tracer AdaptiView TD7 Display

Operator Interface

Information is tailored to operators, service technicians, and owners. When operating a chiller, there is specific information you need on a day-to-day basis—setpoints, limits, diagnostic information, and reports. Day-to-day operational information is presented at the display. Logically organized groups of information—chiller modes of operation, active diagnostics, settings and reports put information conveniently at your fingertips.

Figure 29. TD7 screens



Operator Display Boot Screen



Display Loading Data



Home Screen, Auto Mode

Main Display Area/Home Screen

All screens appear within the main display area (shown as location in Table 30).

Home screen: Chiller status information

The home screen (Table 30) provides the most frequently needed chiller status information on “touch targets” (the entire white rectangular areas) for each chiller component. Touching any touch target displays a screen containing more chiller status information related to each component.

Figure 30. Main screen

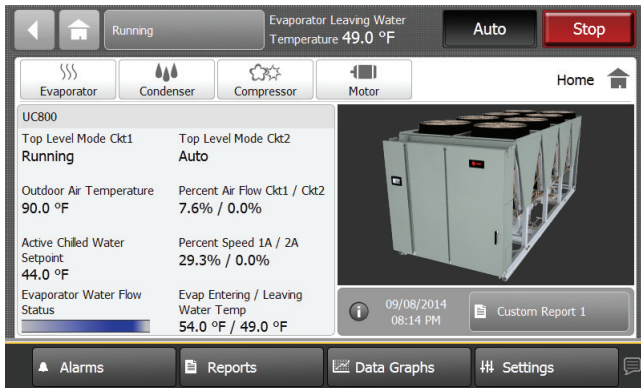


Table 23. Main screen items

| Description | Resolution | Units |
|----------------------------------|------------|--------|
| Active Chilled Water Setpoint | X.X | °F /°C |
| Active Current Limit Setpoint | X.X | %RLA |
| Average Motor Current %RLA | X.X | %RLA |
| Evap Entering/Leaving Water Temp | X.X | °F /°C |
| Cond Entering/Leaving Water Temp | X.X | °F /°C |
| Frequency Command | X.X | Hz |
| Evaporator Water Flow Status | X.X | |
| Condenser Water Flow Status | | |

Table 24. Operating modes

| Chiller Modes | Description |
|------------------------------------|---|
| MP Resetting | |
| Stopped | The chiller is not running and cannot run without intervention. Further information is provided by the sub-mode: |
| Local Stop | Chiller is stopped by TD7 Stop button command– cannot be remotely overridden. |
| Immediate Stop | Chiller is stopped by the TD7 Panic Stop (by pressing Stop button twice in succession) – previous shutdown was manually commanded to shutdown immediately without a run-unload or pumpdown cycle - cannot be remotely overridden. |
| Diagnostic Shutdown – Manual Reset | The chiller is stopped by a diagnostic that requires manual intervention to reset. |
| Run Inhibit | The chiller is currently being inhibited from starting (and running*), but may be allowed to start if the inhibiting or diagnostic condition is cleared. Further information is provided by the sub-mode: |
| Diagnostic Shutdown – Auto Reset | The entire chiller is stopped by a diagnostic that may automatically clear. |

Viewing Chiller Operating Modes

On the Reports screen, touch Chiller Operating Modes to view the current operating status of the chiller in terms of the top-level operating mode and submodes.

Note: You can also access the Chiller Operating Modes screen from the chiller status button in the upper left corner of the screen.

Figure 31. Chiller operating modes

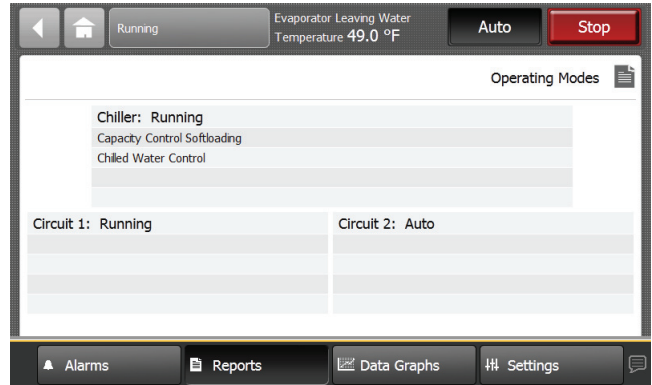


Table 24. Operating modes (continued)

| Chiller Modes | Description |
|---|--|
| Starting is Inhibited by External Source | The chiller is inhibited from starting (and running) by the "external stop" hardwired input. |
| Start Inhibited by BAS | The chiller is inhibited from starting (and running) by command from a Building Automation System via the digital communication link (com 4 or com 5). |
| Waiting for BAS Communications | This is a transient mode - 15-min. max, and is only possible if the chiller is in the Auto - Remote command mode. After a power up reset, it is necessary to wait for valid communication from a Building Automation System (Tracer) to know whether to run or stay inhibited. Either valid communication will be received from the Building Automation System (e.g. Tracer), or a communication diagnostic ultimately will result. In the latter case the chiller will revert to Local control. |
| Power Up Delay Inhibit min:sec | The compressor is currently being inhibited from starting as part of the power up start delay (or staggered start) feature. This feature is intended to prevent multiple chillers from all starting simultaneously if power is restored to all chillers simultaneously. |
| Low Differential Refrigerant Pressure Cool-Down Timemin:sec | Contact your local Trane service office. |
| Auto | The chiller is not currently running but can be expected to start at any moment given that the proper conditions and interlocks are satisfied. Further information is provided by the sub-mode: |
| Waiting For Evap Water Flow | The chiller will wait up to 20 minutes in this mode for evaporator water flow to be established per the flow switch hardwired input. |
| Waiting for A Need to Cool | The chiller will wait indefinitely in this mode, for an evaporator leaving water temperature higher than the Chilled Water Setpoint plus the Differential to Start. |
| Waiting to Start | The chiller is not currently running and there is a call for cooling but start is delayed by certain interlocks or proofs. Further information is provided by the sub-mode: |
| Waiting For Cond Water Flow | The chiller will wait up to 20 minutes in this mode for condenser water flow to be established per the flow switch hardwired input. |
| Start Inhibited Waiting for Oil | The chiller will wait up to 2 minutes in this mode for oil level to appear in the oil tank. |
| Condenser Water Pump Pre-Run Timemin:sec | The chiller will wait up to 30 minutes (user adjustable) in this mode for to allow the condenser water loop to equalize in temperature |
| Restart Inhibit min:sec | The compressor is currently unable to start due to its restart inhibit timer. A given compressor is not allowed to start until 5 minutes (adj) has expired since its last start, once a number of "free starts" have been used up. |
| Waiting For EXV Preposition | The Chiller will wait for the time it takes the EXV to get to its commanded pre-position prior to starting the compressor. This is typically a relatively short delay and no countdown timer is necessary (less than 15 seconds) |
| Minimum Condenser Watermin:sec | Only possible when Condenser Head Pressure Control option is enabled, this wait may be necessary due to the Head Pressure control device's stroke time. |
| Condenser Water Regulating Control min:sec | Only possible when Condenser Head Pressure Control option is enabled, this wait may be necessary due to the Head Pressure control device's stroke time |
| Running | The chiller, circuit, and compressor are currently running. Further information is provided by the sub-mode: |
| High Discharge Temp Limit | The compressor is running and is being forced loaded to its step load point, without regard to the leaving water temperature control, to prevent tripping on high compressor discharge temperature. |
| Base Loaded | Chiller is running in "Base Load" operation where the capacity of the chiller is controlled to maintain a given current per an adjustable set point. The chiller is forced to run without regard to the chilled water temperatures and the differential to start and stop |
| Capacity Control Softloading | The chiller is running, but loading is influenced by a gradual "pulldown" filter on the chilled water temperature setpoint. The settling time of this filter is user adjustable as part of the softload control feature. |
| Current Control Softloading | The chiller is running, but loading is influenced by a gradual filter on the current limit setpoint. The starting current and the settling time of this filter is user adjustable as part of the softload control feature. |
| EXV Controlling Differential Pressure | Liquid level control of the Electronic Expansion Valve has temporarily been suspended. The EXV is being modulated to control for a minimum differential pressure. This control implies low liquid levels and higher approach temperatures, but is necessary to provide minimum oil flow for the compressor until the condenser water loop can warm up to approx 50F. |
| Chilled Water Control | Unit is running in the Cooling Mode of operation and is attempting to control to the active Chilled Water Setpoint. |
| Running - Limited | The chiller, circuit, and compressor are currently running, but the operation of the chiller/compressor is being actively limited by the controls. Further information is provided by the sub-mode.* See the section below regarding criteria for annunciation of limit modes |

Table 24. Operating modes (continued)

| Chiller Modes | Description |
|---|--|
| Condenser Pressure Limit | The circuit is experiencing condenser pressures at or near the condenser limit setting. Compressors on the circuit will be unloaded to prevent exceeding the limits.* |
| Low Evaporator Refrigerant Temperature Inhibit | The circuit is experiencing saturated evaporator temperatures at or near the Low Refrigerant Temperature Cutout setting. Compressors on the circuit will be unloaded to prevent tripping. * |
| Capacity Limited by Low Liquid Level | The circuit is experiencing low refrigerant liquid levels and the EXV is at or near full open. The compressors on the circuit will be unloaded to prevent tripping.* |
| Current Limit | The compressor is running and its capacity is being limited by high currents. The current limit setting is 100% RLA (to avoid overcurrent trips) or lower as set by the compressor's "share" of the active current limit (demand limit) setting for the entire chiller.* |
| Phase Unbalance Limit | The compressor is running and its capacity is being limited by excessive phase current unbalance.* |
| Low Discharge Superheat Limit | This is limit control that acts to prevent chiller shutdown when the discharge superheat approaches the limit setpoint by reducing the liquid level and unloading the slide valve. |
| Oil Loss Avoidance | This is limit control that acts to prevent chiller shutdown when the estimated refrigerant flow approaches the calculated minimum flow by increasing the slide valve capacity and/or VFD frequency |
| Note: Other normal running modes (see above) may also appear under this top level mode | |
| Shutting Down | The chiller is still running but shutdown is imminent. The chiller is going through a compressor run-unload sequence. Shutdown is necessary due to one (or more) of the following sub-modes: |
| Local Stop | Chiller is in the process of being stopped by TD7 Stop button command |
| immediate Stop | Chiller is in the process of being stopped by TD7 Panic Stop command |
| Diagnostic Shutdown – Manual Reset | Chiller is in the process of being stopped by a Latching Diagnostic shutdown – Manual Reset is required to clear |
| Diagnostic Shutdown – Auto Reset | Chiller is in the process of being stopped by a Diagnostic shutdown – Automatic clearing of the diagnostic is possible if condition clears. |
| Compressor Unloading (min:sec) | The compressor is in its "run – unload" state in which it is being continuously unloaded for 40 sec prior to shutdown. |
| Starting is Inhibited by External Source | Chiller is in the process of being stopped by the External Stop hardwired input |
| Start Inhibited by BAS | The Chiller is in the process of shutdown due to a command from the Building Automation System (e.g. Tracer) |
| Evaporator Water Pump Off Delay min:sec | |
| Service Override | The Chiller is in a Service Override mode |
| Service Pumpdown | The chiller, circuit, and compressor is running via a manual command to perform a Service Pumpdown. Both evap and condenser water pumps are commanded to be running. The EXV is being held wide open, but the manual liquid line service valve should be closed. |

Alarms


You can use the display to view alarms and to reset them. Alarms are communicated to the display immediately upon detection.

Viewing the Alarms Screen

Touch the Alarms button in the main menu area (Figure 30, p. 44) to view the Alarms screen. A table of active alarms appears that is organized chronologically with the most recent at the top of the list, as shown in Figure 32. This example shows the default view, which appears each time you return to the screen.

Note: A page number appears in the lower right corner of the screen. If a screen contains more than one page, up/down arrows also appear for viewing the other pages

Figure 32. Alarm screen

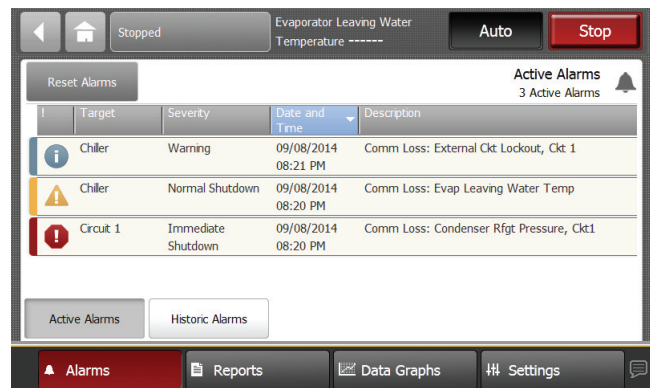

The Alarms screen is accessible by depressing the Alarms enunciator. A verbal description will be provided.

A scrollable list of the last active Alarms is presented. Performing a "Reset Alarms" will reset all active Alarms

regardless of type, machine or circuit. The scrollable list will be sorted by time of occurrence.

If a informational warning is present, the “Alarms” key will be present but not flashing. If a Alarm shutdown (normal or immediate) has occurred, the “Alarm” key will display that is flashing. If no Alarms exist, the “Alarm” key will not be present.

Reports

You can use the Tracer display to view a variety of reports and to create and edit a custom report. All reports contain live data that refreshes every 2–5 seconds.


Viewing the Reports Screen

Touch the Reports button in the main menu area (Figure 4) to view the Reports screen. The Reports screen contains the following buttons:

- Custom Report1
- Custom Report2
- Custom Report3
- Evaporator
- Condenser
- Compressor
- Motor
- About
- Operating Modes
- Log Sheet
- ASHRAE Chiller Log

Each button links to the report named on the button.

Figure 33. Report screen

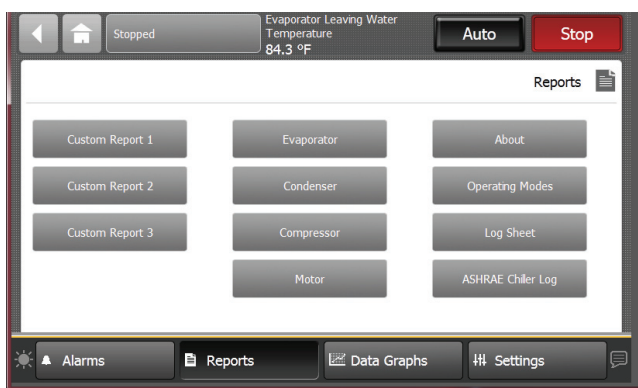

The Reports tab allows a user to select from a list of reports headings. Each report will generate a list of status items as defined in the tables that follow.

Editing a Custom Report

You can edit the custom report by adding, removing, or re-order data as follows:

1. On the Custom Report screen, touch Edit. The Edit Custom Report screen appears.
2. Add, remove, or re-order as follows:
 - a. To add an item to the custom report, touch it. It responds by changing to blue. You can use the arrows to scroll through the rest of the items that can be added to the custom report. Then touch Add to move the selected item to the box on the right side of the screen. To add all of the remaining items in the left box to the custom report, touch Add All.
 - b. To remove an item from the custom report, touch it. It responds by changing to blue. You can use the arrows to scroll through the rest of the items that can be removed from the custom report. Then touch Remove to move the selected item to the box on the left side of the screen.
 - c. To re-order items in the custom report, touch it. It responds by changing to blue. Use the arrows to change the order of a highlighted item.
3. To save and view your edited custom report, touch Save.

Figure 34. Edit custom report screen

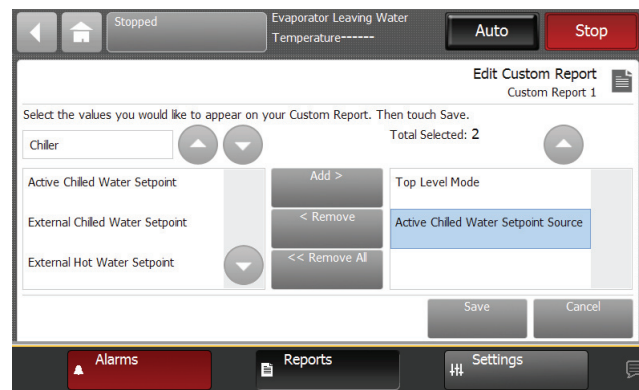


Figure 35. Report evaporator screen

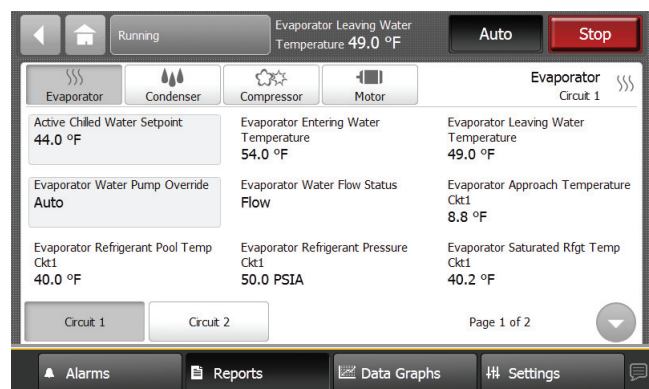


Table 25. Report evaporator screen items

| Description | Resolution | Units |
|---------------------------------------|---------------|----------|
| Active Chilled Water Setpoint | X.X | °F / °C |
| Evaporator Entering Water Temperature | X.X | °F / °C |
| Evaporator Leaving Water Temperature | X.X | °F / °C |
| Evaporator Water Flow Status | Flow, No Flow | Text |
| Evaporator Water Pump Override | Auto, On | Text |
| Evaporator Approach Temperature | X.X | °F / °C |
| EXV Position Percent | X.X | % |
| Evaporator Refrigerant Pressure | XXX.X | PSIA/kPa |
| Evaporator Saturated Rfght Temp | X.X | °F / °C |
| Evaporator Refrigerant Liquid Level | X.XX | in/mm |

Figure 36. Report condenser screen

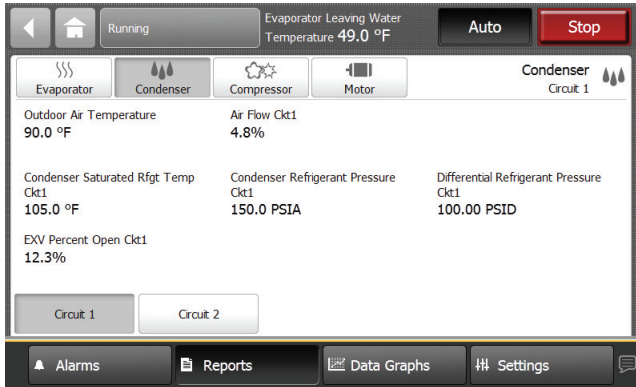


Table 26. Report condenser screen items

| Description | Resolution | Units |
|--------------------------------------|---------------|----------|
| Condenser Entering Water Temperature | X.X | F / C |
| Condenser Leaving Water Temperature | X.X | F / C |
| Condenser Water Flow Status | Flow, No Flow | Text |
| Condenser Water Pump Override | Auto, On | Text |
| Condenser Approach Temperature | X.X | F / C |
| EXV Position Percent | X.X | % |
| Condenser Refrigerant Pressure | XXX.X | PSIA/kPa |
| Condenser Saturated Rfght Temp | X.X | F / C |
| Differential Refrigerant Pressure | XXX.X | PSIA/kPa |
| Outdoor Air Temperature | X.X | F / C |

Figure 37. Report compressor screen

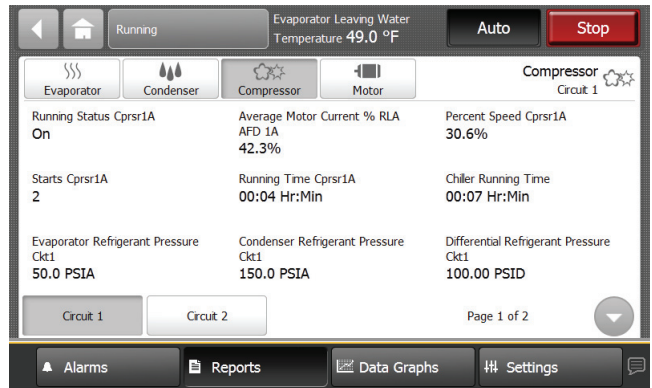


Table 27. Report compressor screen items

| Description | Resolution | Units |
|-----------------------------------|------------|----------|
| Compressor Running Status | On,Off | Text |
| Average Motor Current %RLA | XX.X% | %RLA |
| Compressor Starts | XX | Text |
| Compressor Running Time | XX:XX | Hr:Min |
| Oil Loss Level Sensor | Wet, Dry | Text |
| Discharge Temperature | X.X | °F / °C |
| Discharge Temperature | X.X | °F / °C |
| Compressor Oil Pressure | XXX.X | PSIA/kPa |
| Evaporator Refrigerant Pressure | XXX.X | PSIA/kPa |
| Condenser Refrigerant Pressure | XXX.X | PSIA/kPa |
| Differential Refrigerant Pressure | XXX.X | PSIA/kPa |
| Frequency Command | XX.X | Hz |

Figure 38. Report motor screen

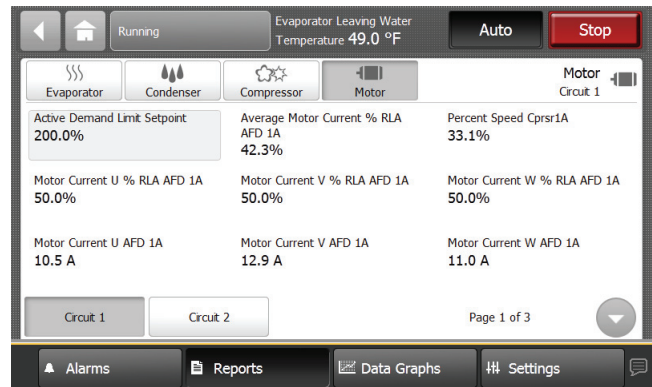


Table 28. Report motor screen items

| Description | Resolution | Units |
|-------------------------------|------------|-------|
| Active Current Limit Setpoint | X.X | %RLA |
| Average Motor Current %RLA | X.X | %RLA |
| Starter Motor Current L1 %RLA | X.X | %RLA |
| Starter Motor Current L2 %RLA | X.X | %RLA |
| Starter Motor Current L3 %RLA | X.X | %RLA |
| Starter Motor Current L1 | X.X | A |
| Starter Motor Current L1 | X.X | A |
| Starter Motor Current L1 | X.X | A |
| Starter Input Voltage AB | XXX.X | V |
| Starter Input Voltage BC | XXX.X | V |
| Starter Input Voltage CA | XXX.X | V |
| Average Motor Current | X.X | A |
| Average Phase Voltage | XXX.X | V |
| Frequency Command | XX.X | Hz |

Equipment Settings

You can use the TD7 display to monitor and change a variety of equipment settings.


Viewing the Settings Screen

Touch the Settings button in the main menu area (see [Figure 30, p. 44](#)) to view the Settings screen. Equipment Settings identifies a column of buttons located on the screen (see the outlined column in [Figure 39](#)). The buttons are:

- Chiller Settings
- Feature Settings
- Chiller Water Reset
- Manual Control Settings

Each of these buttons provide access to a screen that contains additional buttons related to each topic. This section provides detailed information about these screens.

Figure 39. Setting screen

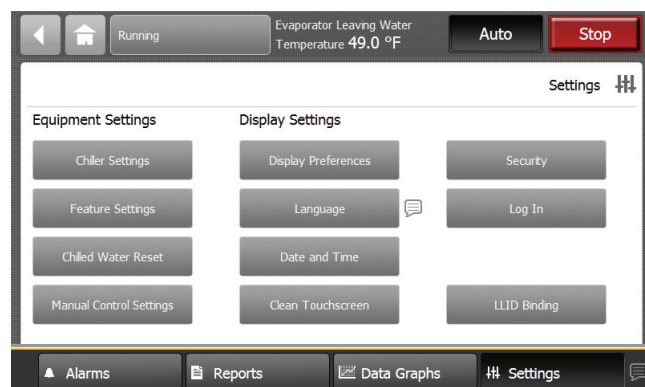


Viewing and Changing Equipment Settings

Each button in the Equipment Settings column on the Settings screen takes you to a menu screen that contains a group of buttons. Each button displays the name of a setting and its current value ([Figure 40](#)). Touch any button to view a screen where you can change the setting for the feature shown on the button.

Note: A page number appears in the lower right corner of the screen. If a screen contains more than one page, up/down arrows also appear for viewing the other pages, as in [Figure 40](#).


Figure 40. Equipment setting screen (Chiller setting shown)

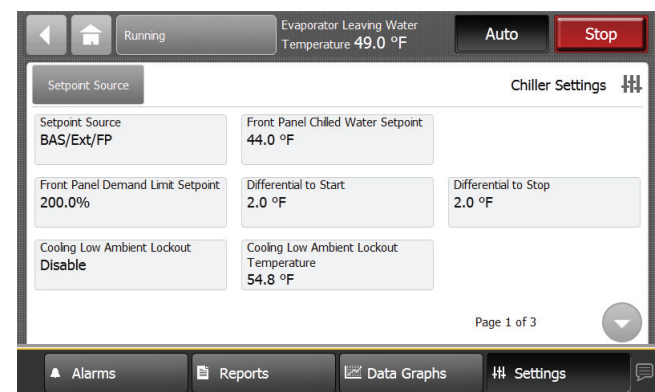

To change an equipment setting, follow this procedure:

1. Touch one of the button in the Equipment Settings column on the Settings screen, such as Chiller Settings. The corresponding screen appears (in this case, the Chiller Settings screen).
2. Touch the button that shows the equipment setting you want to change. A screen that allows you to change the equipment setting appears. There are two types of these screens:
 - a. For screens with button selections ([Figure 41](#)), touch the button that represents the setting you want. The button becomes shaded, and a Save button appears at the bottom of the screen.
 - b. For screens with numerical keypads ([Figure 42](#)), touch the appropriate numbers to change the current value. The new value appears above the keypad.
3. Touch Save to complete the change. The current value is updated in the upper left side of the screen, demonstrating that the change has been communicated to the Tracer UC800 controller. The screen you were previously viewing appears.

Figure 41. Chilled water setpoint screen

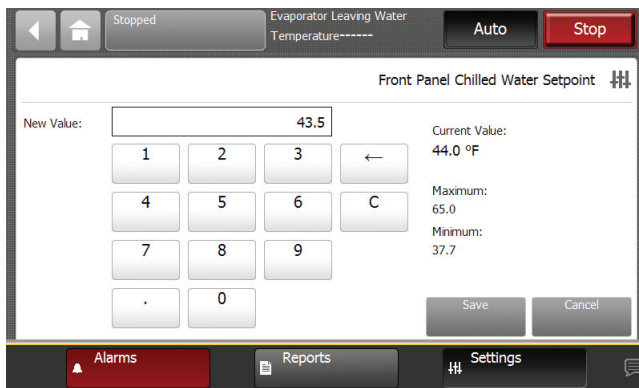Figure 42. Changed chilled water setpoint screen

Keypad features:

- When you enter a new number, the value in the New value field is deleted and replaced with the new entry.
- The backspace (arrow) key deletes the characters you previously entered.
- If the keypad is used to enter a setpoint that is out of range, an error dialog will appear when you touch the Save button.
- Keypads that allow negative numbers have positive and negative number (+/-) keys.

Table 29. Settings screen items

| Description | Resolution | Units |
|--|--------------|---------|
| Chiller Settings | | |
| Active Chilled Water Setpoint | ± XXX.X | °F / °C |
| Active Current Limit Setpoint | XXX % | %RLA |
| Active Panel Base Load Cmd | On/Auto | Text |
| Active Base Loading Setpoint | XXX | % |
| Active Base Loading Command | On/Auto | Text |
| Differential to Start | XXX.X | °F / °C |
| Differential to Stop | XXX.X | °F / °C |
| Setpoint Source (BAS/Ext/FP, Ext/Front Panel, Front Panel) | BAS/Ext/FP | Text |
| Evaporator Water Pump Off Delay | XX | Min |
| Condenser Pump Prestart Time | XX | Min |
| High Evap Water Temp Cutout | XXX.X | °F / °C |
| Evaporator Leaving Water Temp Cutout | XX.X | °F / °C |
| Low Refrigerant Temperature Cutout | XX.X | °F / °C |
| Current Limit Softload Start Point | XXX.X | % |
| Current Limit Control Softload Time | XXXX | Sec |
| Capacity Control Softload Time | XXXX | Sec |
| Local Atmospheric Pressure | XXX.X | psi/kPa |
| Power Up Start Delay | XXX | Min |
| Feature Settings | | |
| External Chilled/Hot Water Setpoint (Enable/Disable) | | Text |
| External Current Limit Setpoint (Enable/Disable) | | Text |
| LCI-C Diagnostic Encoding (Enable/Disable) | | Text |
| Chilled Water Reset (Constant, Outdoor, Return, Disable), | Disable | Text |
| Return Reset Ratio | XXX | % |
| Return Start Reset | XXX.X | °F / °C |
| Return Maximum Reset | XXX.X | °F / °C |
| Outdoor Reset Ratio | XXX | % |
| Outdoor Start Reset | XXX.X | °F / °C |
| Outdoor Maximum Reset | XXX.X | °F / °C |
| Mode Overrides | | |
| Evap Water Pump (Auto, On) | Auto | Text |
| Cond Water Pump (Auto, On) | Auto | Text |
| Display Reference | | |
| Date Format (mmm dd, yyyy, dd-mmm-yyyy) | mmm dd, yyyy | Text |
| Data Separator | | Text |
| Time Format (12-hour, 24-hour) | 12-hour | Text |
| Unit System (SI, English) | English | Text |
| Pressure Units (Absolute, Gauge) | Absolute | Text |
| Number Format | | Text |

Display Settings

You can use the Tracer AdaptiView display to change the format of the information that appears on the display, and to clean the touch screen.

Viewing the Settings Screen

Touch the Settings button in the main menu area (Figure 39, p. 49) to view the Settings screen. Display Settings identifies a column of buttons located on the screen (see Figure 43). The buttons are:

- Display Preferences
- Language
- Date and Time
- Clean Display


Each button provides access to a screen that is related to the button name.

Viewing and Changing Display Preferences

On the Settings screen, touch Display Preferences to view a screen containing these buttons (see Figure 43):


- Date Format
- Date Separator
- Time Format
- Unit System
- Pressure Units
- Number Format

Figure 43. Display reference screen

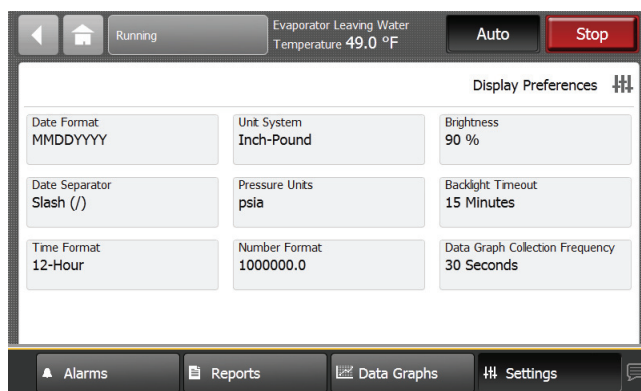

Each of the buttons shows the name of a display preference and its format (current value). Touch any of these buttons to view a screen where you can change the format. The button representing the format currently used is shaded (see the "MMDDYYYY" button).

Figure 44. Date format page

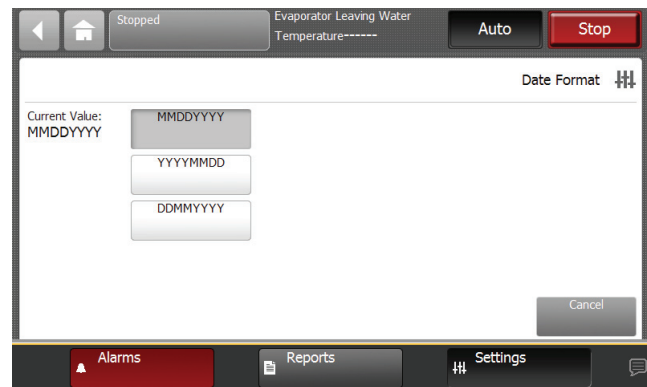

To change the format:

1. Touch the button that shows that format you prefer.
2. Touch Save to confirm your selection and to return to the Display Preferences screen.

Date Format . Use the Date Format screen to choose from the following date formats:

- MMDDYYYY (default)
- YYYYMMDD
- DDMMYYYY

Date Separator . Use the Date Separator screen to choose from the following date formats:

- None
- Slash (default)
- Hyphen

Time Format . Use the Time Format screen to choose from the following time formats:

- 12 hour (default)
- 24 hour

Units System . Use the Display Units screen to choose from the following display units:

- SI
- Inch-Pounds (default)

Pressure Units . Use the Pressure Units screen to choose from the following pressure units:

- kPaA (default if "SI" is chosen for display units)
- kPaG
- PSIA (default if "Inch-Pound" is chosen for display units)
- PSIG

Number Format .

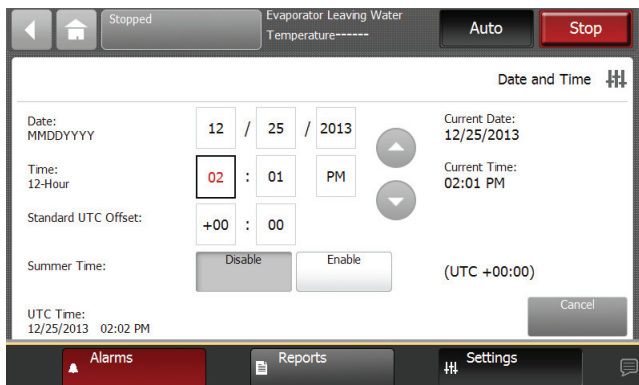
- 1000000.0
- 1000000,0

Figure 45. Language page


The language that is currently in use on the display is expressed as the current value on the Language screen. The button that displays the current value is shaded (see the “English” button in Figure 19 as an example).

To change the language:

1. Touch the button that identifies the language you prefer.
2. Touch Save to confirm your selection and to return to the Settings screen.

Figure 46. Date and time screen


The current date and time for the display is expressed as the current value. The current value appears below the center line on the screen.

Above the center line, the following date and time attributes appear:


- Month
- Day
- Year
- Hour
- Minute
- AM/PM

To change the date or time:

1. Touch the square presenting the attribute you want to change. The square becomes highlighted.
2. Touch the up or down arrow key on the screen until the your desired selection appears. Repeat the process for any other attributes you want to change.
3. Touch Save to confirm your selection and return to the Settings screen.

Cleaning the Display

On the Settings screen, touch Clean Display to disable the Tracer AdaptiView display screen for 15 seconds so that you can clean the screen without it responding to touch. During this time, the screen is black with a number in the center that counts down the seconds. After 15 seconds, the Settings screen re-appears.

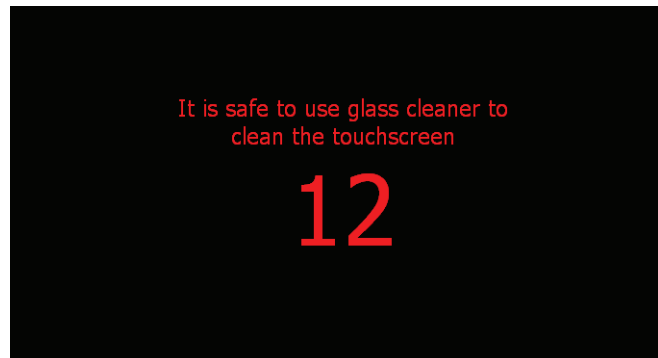Figure 47. Countdown screen


Security Settings

If security is enabled, the Tracer AdaptiView display requires that you log in with a four-digit security PIN to make setting changes that are protected by security. This feature prevents unauthorized personnel from doing so. There are two levels of security, each allowing specific changes to be made.

You can view all data without logging in. The log-in screen appears only when you try to change a setting that is protected by security, or when you touch the Log in button from the Settings screen.

Disabling/Enabling Security

The Tracer AdaptiView display gives you the ability to disable or enable the security feature that allows a user to log in and log out.

To disable security, you must be logged in:

1. From the Settings screen, touch the Security button. The Security screen appears (Figure 48).

Note: If you are logged out, the Log in screen appears.

2. Touch the Disable button. The button becomes shaded.

3. Touch Save. The Settings screen appears with only the Security button visible. The Log in/Logout button is gone.

To enable security:

1. From the Settings screen, touch the Security button. The Security screen appears (Figure 48).
2. Touch the Enable button. The button becomes shaded.
3. Touch Save. The Settings screen appears with a Log out button, in addition to the Security button.

Figure 48. Security screen - disable


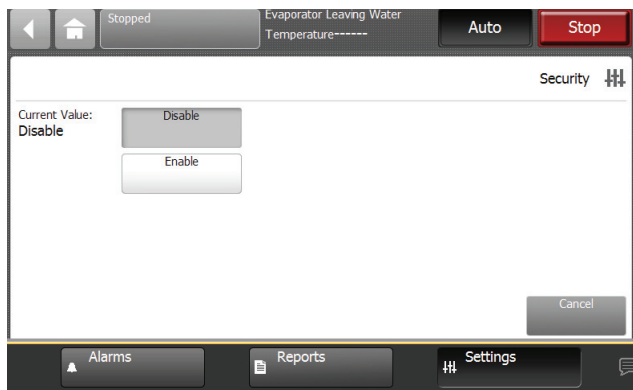


Figure 49. Security settings screen

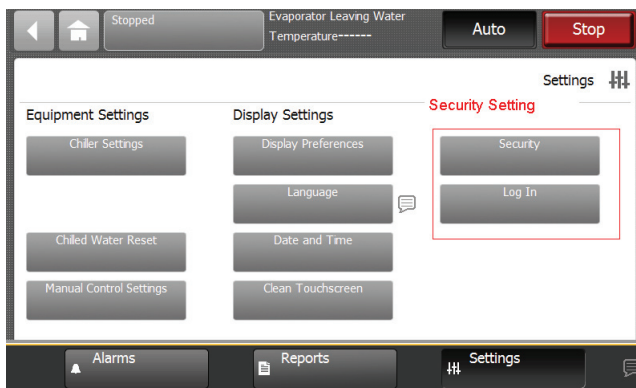

Logging In

There are two levels of security:

- Security Level 1 allows users to change a limited group of secure settings. The default security PIN is 1111.
- Security Level 2 allows users to change all secure settings. The default security PIN is 7123.

A technician must use the TracerTU service tool to define a different PIN, or to recall a PIN that has been forgotten. When defining a PIN in TracerTU, the technician enters a 4-digit PIN that corresponds with the desired level of security.

To log in:

1. Touch the Log in button. The Log in screen appears (Figure 49).


2. Use the keypad to enter your PIN.
 - a. The PIN is a four-digit number, which was configured for your system with the TracerTU service tool.
 - b. As you enter the number, the PIN remains hidden by asterisks.

Note: If you enter an invalid PIN, an error message appears on the Log in screen.

3. Touch Save.
 - a. If you viewed the Log in screen from touching Log in on the Settings screen, the Settings screen appears with a Log out button on it.
 - b. If the Log in screen appeared when you tried to change a setting, you return to that setting screen.

Note: The PIN is valid until 30 minutes of inactivity passes, or until you log out.

Figure 50. Log in screen

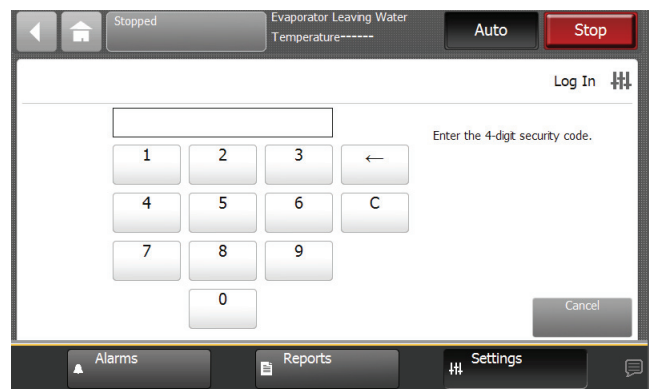


Logging Out

To log out:

1. Touch the Log out button. A confirmation screen appears (Figure 51).
2. Touch Yes to confirm that you want to log out. The Settings screen appears with a Log in button on it.

Figure 51. Log out confirmation screen

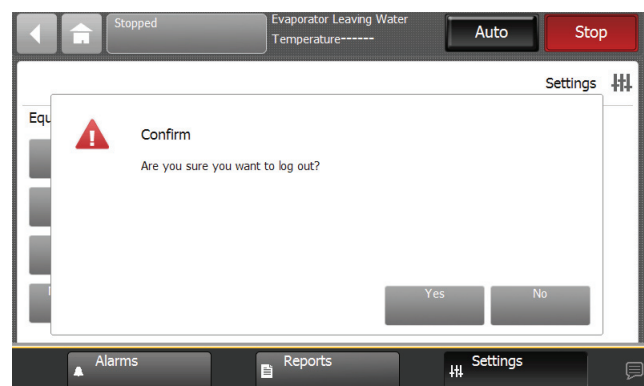


InvisiSound Ultimate - Noise Reduction Mode

When the InvisiSound Ultimate option is selected (model number digit 12=3), noise reduction mode can be enabled to adjust fan speed and lower maximum sound levels. Reduced acoustic noise levels can be set for certain times, or on a schedule. The noise reduction feature can be requested by local time of day scheduling, external input or building automation system.

To enable this function at the external display:

- Access the Settings screen on the Tracer AdaptiView. See [Figure 52](#).

Figure 52. Noise reduction mode settings

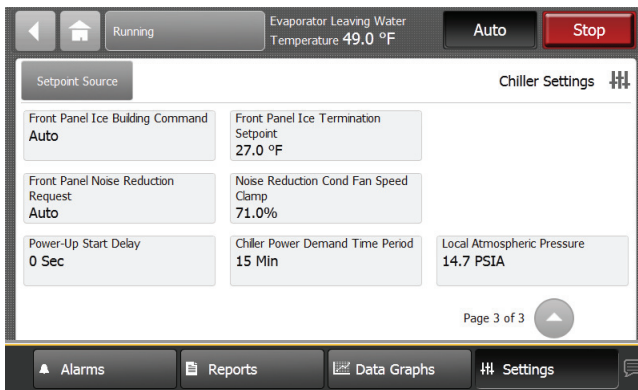

- Set the Front Panel Noise Reduction Request to ON.
- Adjust the Noise Reduction Condenser Fan Speed Clamp to desired value.
 - Setting for fan speed is as a percentage of 920 rpm maximum fan speed
Example:
For fan speed of 700 rpm, enter a value of 76%
 - Acceptable inputs are 60% (552 rpm) to 100% (920 rpm) in 1% increments

Tracer™ TU

The AdaptiView™ TD7 operator interface allows for daily operational tasks and setpoint changes. However, to adequately service Stealth chillers Tracer™ TU service tool is required. (Non-Trane personnel, contact your local Trane office for software purchase information.) Tracer TU adds a level of sophistication that improves service technician effectiveness and minimizes chiller downtime. This portable PC-based service-tool software supports service and maintenance tasks, and is required for software upgrades, configuration changes and major service tasks.

Tracer TU serves as a common interface to all Trane® chillers, and will customize itself based on the properties of the chiller with which it is communicating. Thus, the service technician learns only one service interface.

The panel bus is easy to troubleshoot using LED sensor verification. Only the defective device is replaced. Tracer TU can communicate with individual devices or groups of devices.

All chiller status, machine configuration settings, customizable limits, and up to 100 active or historic diagnostics are displayed through the service-tool software interface.

LEDs and their respective Tracer TU indicators visually confirm the availability of each connected sensor, relay, and actuator.


Figure 53. Tracer TU

Tracer TU is designed to run on a customer's laptop, connected to the Tracer AdaptiView control panel with a USB cable. Your laptop must meet the following hardware and software requirements:

- 1 GB RAM (minimum)
- 1024 x 768 screen resolution
- CD-ROM drive
- Ethernet 10/100 LAN card
- An available USB 2.0 port
- Microsoft® Windows® XP Professional operation system with Service Pack 3 (SP3) or Windows 7 Enterprise or Professional operating system (32-bit or 64-bit)
- Microsoft .NET Framework 4.0 or later

Notes:

- *Tracer TU is designed and validated for this minimum laptop configuration. Any variation from this configuration may have different results. Therefore, support for Tracer TU is limited to only those laptops with the configuration previously specified.*
- *For more information, see TTU-SVN01A-EN Tracer TU Getting Started Guide*

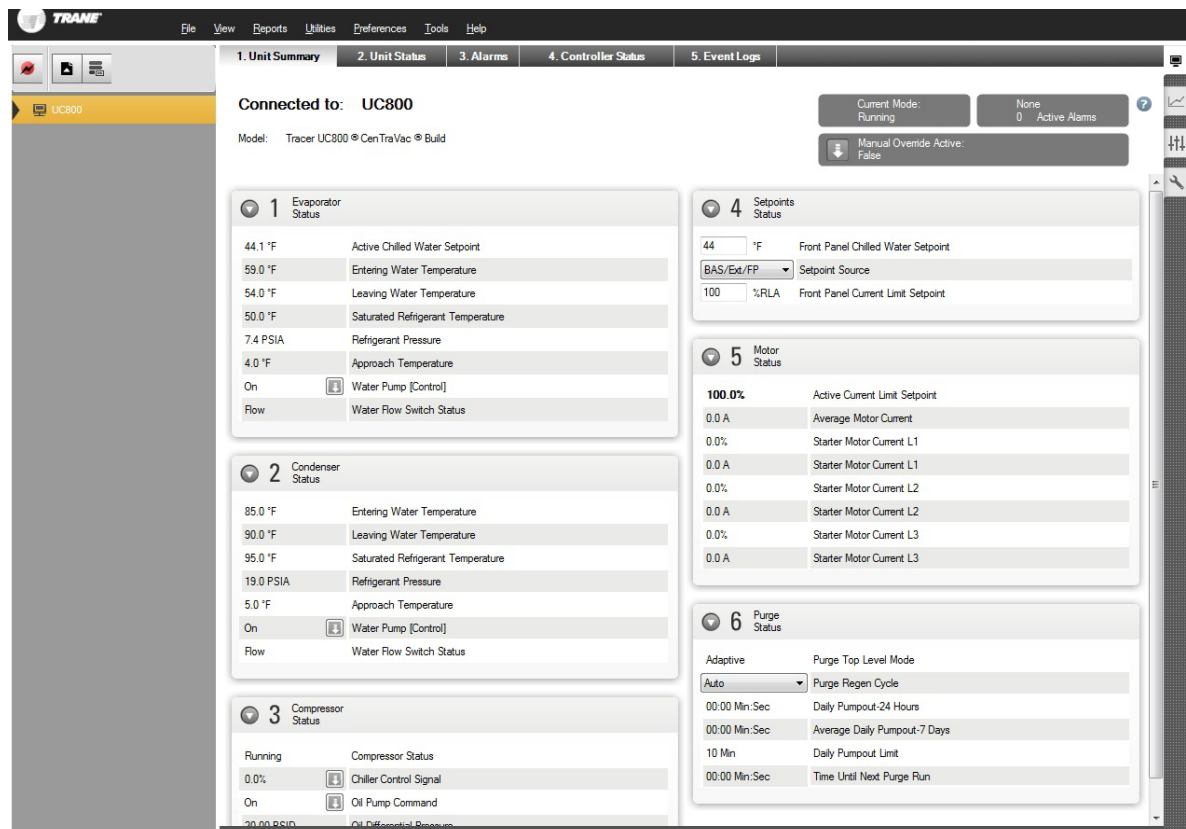



Pre-Start

Upon completion of installation, complete the Stealth™ RTAE Installation Completion Check Sheet and Request for Trane Service checklist in chapter [“Log and Check Sheet,”](#) p. 90.

Important: *Start-up must be performed by Trane or an agent of Trane specifically authorized to perform start-up and warranty of Trane products. Contractor shall provide Trane (or an agent of Trane specifically authorized to perform start-up) with notice of the scheduled start-up at least two weeks prior to the scheduled start-up.*

Start-Up and Shutdown

Important: Initial unit commissioning start-up must be performed by Trane or an agent of Trane specifically authorized to perform start-up and warranty of Trane products. Contractor shall provide Trane (or an agent of Trane specifically authorized to perform start-up) with notice of the scheduled start-up at least two weeks prior to the scheduled start-up.

Unit Start-Up

NOTICE:

Equipment Damage!

Ensure that the compressor and oil sump heaters have been operating properly for a minimum of 24 hours before starting. Failure to do so could result in equipment damage.

If required, once the system has been operating for approximately 30 minutes and has become stabilized, complete the remaining start-up procedures, as follows:

1. Check the evaporator refrigerant pressure and the condenser refrigerant pressure under Refrigerant Report on the AdaptiView™ TD7. The pressures are referenced to sea level (14.6960 psia).
2. Check the EXV sight glasses after sufficient time has elapsed to stabilize the chiller. The refrigerant flow past the sight glasses should be clear. Bubbles in the refrigerant indicate either low refrigerant charge or excessive pressure drop in the liquid line or a stuck open expansion valve. A restriction in the line can sometimes be identified by a noticeable temperature differential between the two sides of the restriction. Frost will often form on the line at this point. Proper refrigerant charges are shown in the General Information Section.

Important: A clear sight glass alone does not mean that the system is properly charged. Also check system subcooling, liquid level control and unit operating pressures.

If chiller is limited by any limiting conditions, contact local Trane service organization for more information.

Temporary Shutdown And Restart

To shut the unit down for a short time, use the following procedure:

1. Press the STOP key on the Adaptiview TD7. The compressors will continue to operate and an operational pumpdown cycle will be initiated..
2. UC800 pump control will turn off the pump (after a minimum 1 min. delay) when the STOP key is pressed

and automatically restart the pump when the unit starts normally.

3. The unit will start normally, provided the following conditions exist:
 - a. The UC800 receives a call for cooling and the differential-to-start is above the setpoint.
 - b. All system operating interlocks and safety circuits are satisfied.

Extended Shutdown Procedure

The following procedure is to be followed if the system is to be taken out of service for an extended period of time, e.g. seasonal shutdown:

1. Test the unit for refrigerant leaks and repair as necessary.
2. Open the electrical disconnect for the chilled water pump. Lock the switches in the "OPEN" position.

NOTICE:

Equipment Damage!

To prevent pump damage, lock the chilled water pump disconnects open and verify pump is off before draining water.

3. Close all chilled water supply valves. Drain the water from the evaporator.
4. With the water drained from evaporator, disconnect 115 power from evaporator heaters at terminals 1X4-1 and 1X4-2.

NOTICE:

Equipment Damage!

Applying power to the evaporator heaters when no water is present could result in damage to heaters.

5. Open the main electrical disconnect and lock in the "OPEN" position.

NOTICE:

Equipment Damage!

Lock the disconnect in the "OPEN" position to prevent accidental start-up and damage to the system when it has been shut down for extended periods.

6. At least every three months (quarterly), check the refrigerant pressure in the unit to verify that the refrigerant charge is intact.



Start-Up and Shutdown

Seasonal Unit Start-Up Procedure

1. Close all valves and re-install the drain plugs in the evaporator.
2. Service the auxiliary equipment according to the start-up/maintenance instructions provided by the respective equipment manufacturers.
3. Close the vents in the evaporator chilled water circuits.
4. Open all the valves in the evaporator chilled water circuits.
5. Open all refrigerant valves to verify they are in the open condition.
6. If the evaporator was previously drained, vent and fill the evaporator and chilled water circuit. When all air is removed from the system (including each pass), install the vent plugs in the evaporator water boxes.
7. Check the adjustment and operation of each safety and operating control.
8. Refer to the sequence for daily unit startup for the remainder of the seasonal startup.

System Restart After Extended Shutdown

NOTICE:

Equipment Damage!

Ensure that the compressor and oil sump heaters have been operating properly for a minimum of 24 hours before starting. Failure to do so could result in equipment damage.

Follow the procedures below to restart the unit after extended shutdown:

1. Verify that the liquid line service valves, oil line, compressor discharge service valves and suction service valves are open (backseated).

NOTICE:

Compressor Damage!

Catastrophic damage to the compressor will occur if the oil line shut off valve or the isolation valves are left closed on unit start-up.

2. Check the oil sump level (see [“Oil Sump Level Check,”](#) p. 69).
3. Fill the evaporator water circuit. Vent the system while it is being filled. Open the vent on the top of the evaporator and condenser while filling and close when filling is completed.

NOTICE:

Proper Water Treatment!

The use of untreated or improperly treated water in this equipment could result in scaling, erosion, corrosion, algae or slime. It is recommended that the services of a qualified water treatment specialist be engaged to determine what water treatment, if any, is required. Trane assumes no responsibility for equipment failures which result from untreated or improperly treated water, or saline or brackish water.

4. Close the fused-disconnect switches that provides power to the chilled water pump.
5. Start the evaporator water pump and, while water is circulating, inspect all piping for leakage. Make any necessary repairs before starting the unit.
6. While the water is circulating, adjust the water flows and check the water pressure drops through the evaporator. See [“Evaporator Waterside Pressure Drop Curves,”](#) p. 27 and water flow rates in [Table 1, p. 10](#).
7. Verify proper operation of flow switch on the evaporator waterbox.
8. Stop the water pump. The unit is now ready for start-up as described previously.

Sequence of Operation


This section will provide basic information on chiller operation for common events. With microelectronic controls, ladder diagrams cannot show today's complex logic, as the control functions are much more involved than older pneumatic or solid state controls.

Adaptive control algorithms can also complicate the exact sequence of operations. This section illustrates common control sequences.

Software Operation Overview

The Software Operation Overview shown in [Figure 54, p. 59](#) is a diagram of the five possible software states. This diagram can be thought of as a state chart, with the arrows and arrow text depicting the transitions between states.

Figure 54. Software operation overview

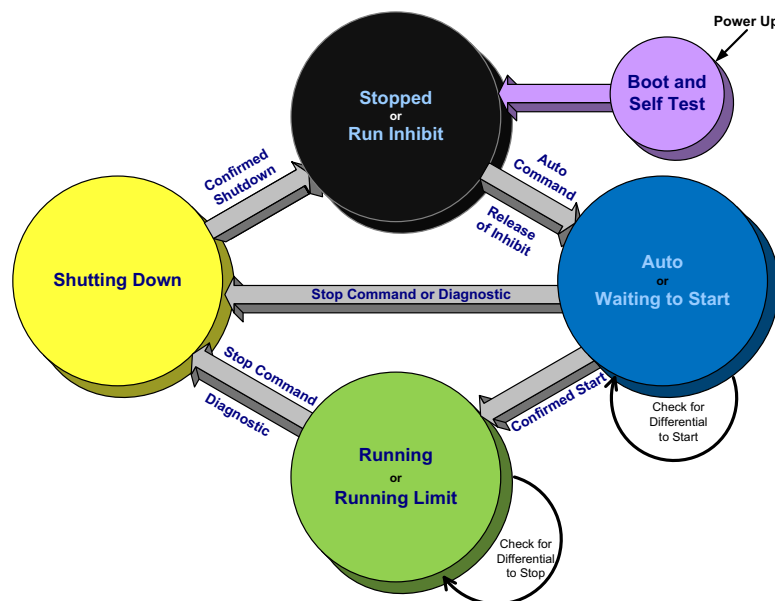

- The text in the circles is the visible top level operating modes that are displayed on Tracer™ AdaptiView.
- The shading of each software state circle corresponds to the shading on the time lines that show the state the chiller is in.

There are five generic states that the software can be in:

- Power Up
- Stopped
- Starting
- Running
- Stopping

Timelines


- The time line indicates the upper level operating mode, as it would be viewed on the Tracer™ AdaptiView.
- The shading color of the cylinder indicates the software state.
- Text in parentheses indicates sub-mode text as viewed on Tracer AdaptiView.
- Text above the time line cylinder is used to illustrate inputs to the Main Processor. This may include user input to the Tracer AdaptiView Touch screen, control inputs from sensors, or control inputs from a Generic BAS.
- Boxes indicate control actions such as turning on relays, or pulsing compressor load or unload solenoids.
- Smaller cylinders under the main cylinder indicate diagnostic checks.
- Text outside a box or cylinder indicates time based functions.
- Solid double arrows indicate fixed timers.
- Dashed double arrows indicate variable timers.

Power Up Diagram

Figure 55, p. 60 shows the respective TD-7 AdaptiView screens during a power up of the UC800 and display. This process takes 25 seconds for the UC800 and 90 seconds for the display. On all power ups, the software model always

will transition through the 'Stopped' Software state independent of the last mode. If the last mode before power down was 'Auto', the transition from 'Stopped' to 'Starting' occurs, but it is not apparent to the user.

Figure 55. Sequence of operation: power up diagram

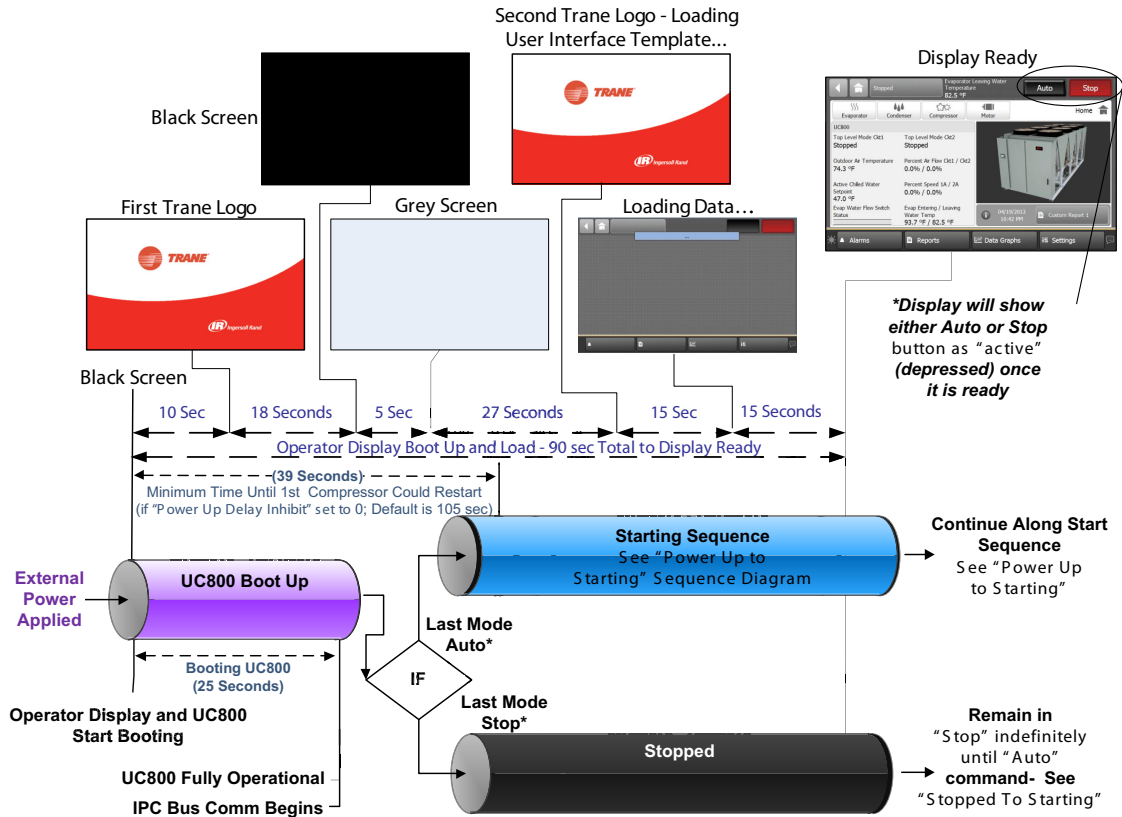

Power Up to Starting


Figure 56, p. 61 diagram shows the timing from a power up event to energizing the 1st compressor. The shortest allowable time would be under the following conditions:

- No motor restart inhibit time left from subsequent starts
- Evaporator Water flow occurs quickly with pump on command
- Power up Start Delay set to 0 minutes

- Need to cool (differential to start) already exists
- Oil level is detected immediately

The above conditions would allow for a minimum power up to starting the 1st compressor time of about 45 seconds (variations may exist due to options installed). Note that it is not advisable to start a chiller “cold”; the oil heaters should be in operation for a sufficient length of time prior to first start. Consult the chiller’s IOM for specifics.

Figure 56. Sequence of events: power up to starting

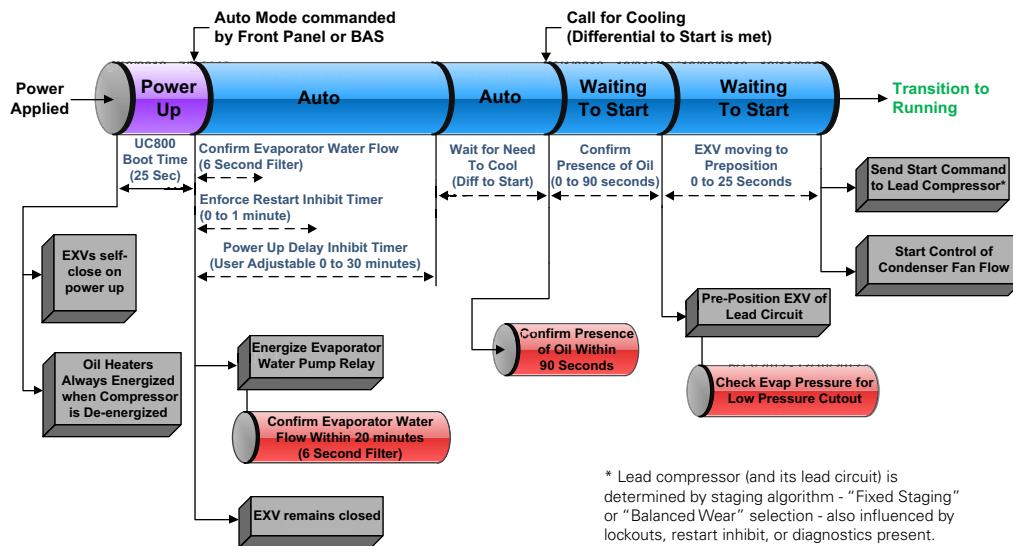

Stopped to Starting


Figure 57 shows the timing from a stopped mode to energizing the 1st compressor. The shortest allowable time would be under the following conditions:

- No motor restart inhibit time left from subsequent starts

- Evaporator Water flow occurs quickly with pump on command
- Need to cool (differential to start) already exists

The above conditions would allow a compressor to start in about 20 seconds.


Figure 57. Sequence of events: stopped to starting

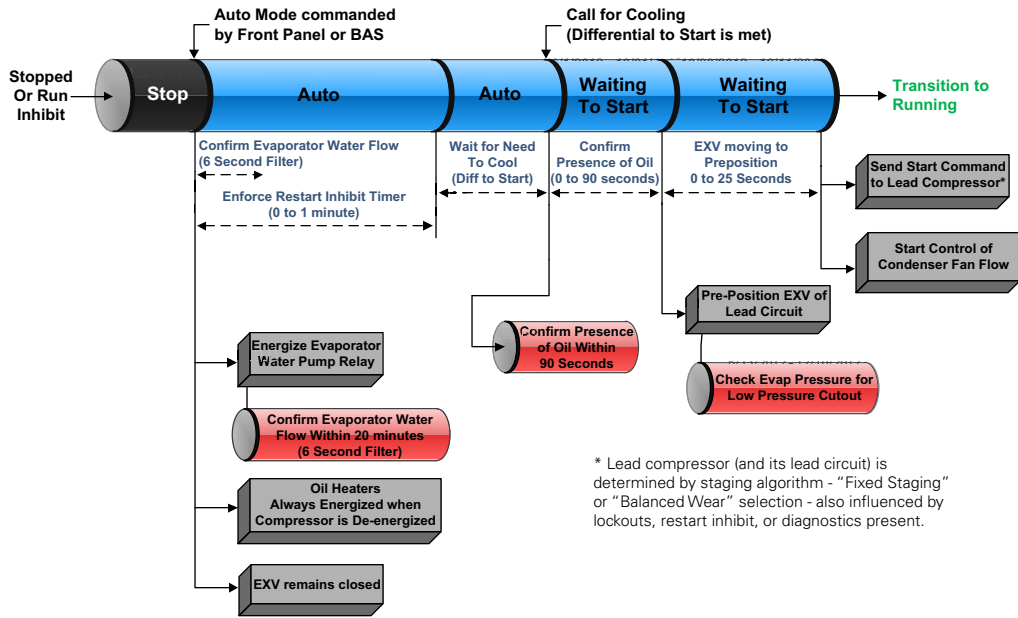

Running (Lead Compressor/Circuit Start and Run)

Figure 58 shows a typical start and run sequence for the lead compressor and its circuit.

Figure 58. Sequence of operation: running (lead compressor/circuit start and run)

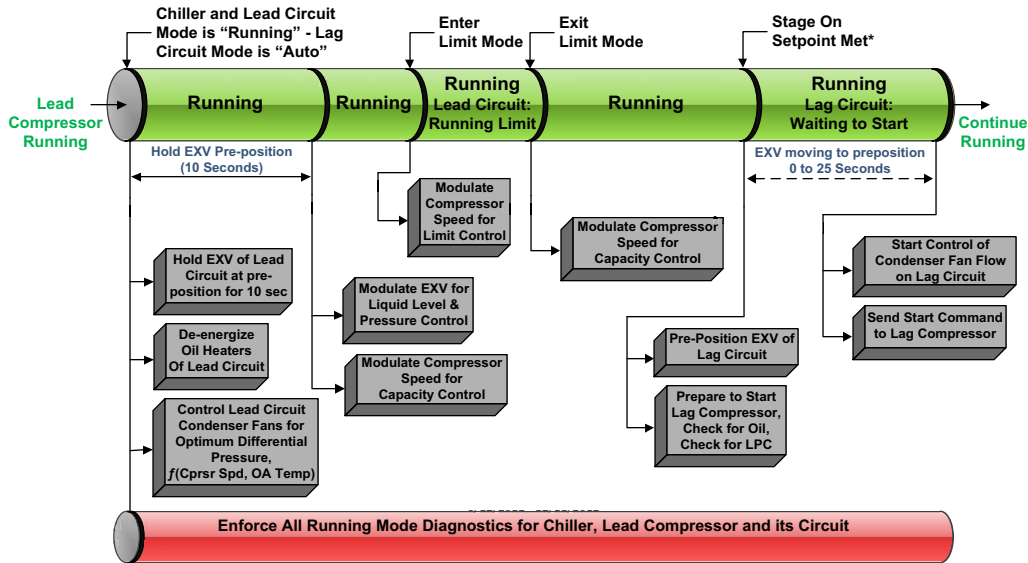


*Note: The decision to stage on or off another compressor is determined by the Average Running Compressor Load Command, Water Temperature Error, and Time Since Last Stage

Running (Lag Compressor/Circuit Start and Run)

Figure 59 shows a typical start and run sequence for the lag compressor and its circuit.

Figure 59. Sequence of operation: running (lag compressor/circuit start and run)

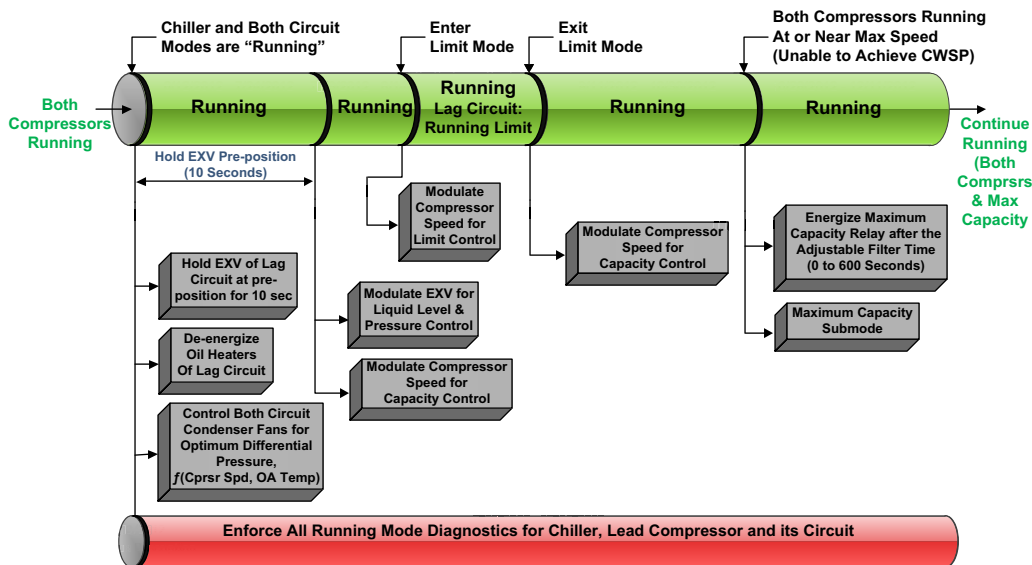


*Note: The decision to stage on or off another compressor is determined by the Average Running Compressor Load Command, Water Temperature Error, and Time Since Last Stage

Satisfied Setpoint

Figure 60 shows the normal transition from Running to shutting down due to the Evap Leaving water temp falling below the differential to stop setpoint.

Figure 60. Sequence of events: satisfied setpoint

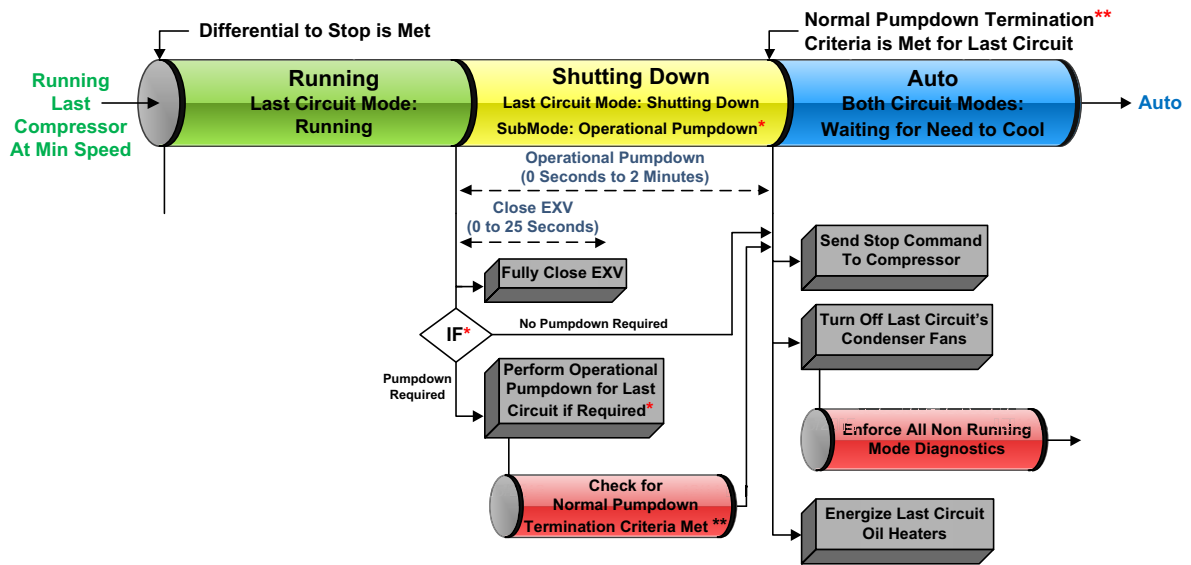


* Note: Operational Pumpdown is required if the Outdoor Air Temperature is less than 50F.

** Note: Operational Pumpdown is Terminated Normally when the Evaporator Refrigerant Pressure is at or below 20 PSIA. The Maximum Allowed Time for Operational Pumpdown is 2 Minutes.

Normal Shutdown to Stopped or Run Inhibit

Figure 61 shows the Transition from Running through a Normal (friendly) Shutdown. The Dashed lines on the top attempt to show the final mode if you enter the stop via various inputs.


Figure 61. Sequence of events: normal shutdown to stopped or run inhibit

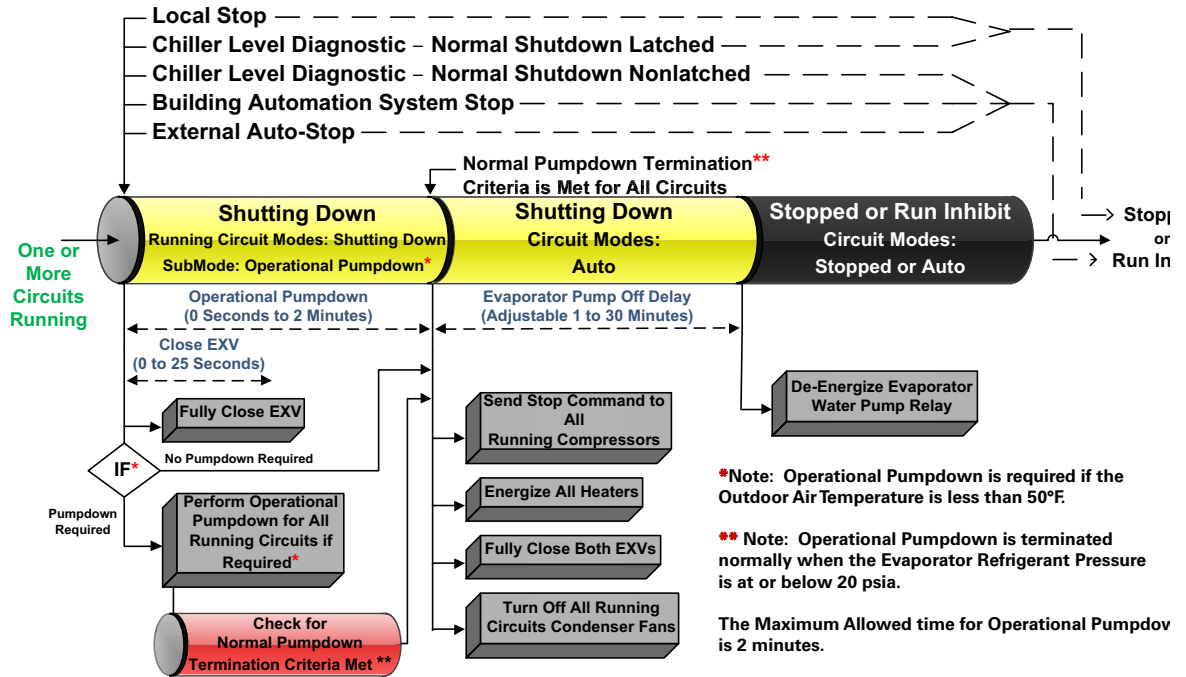

Immediate Shutdown to Stopped or Run Inhibit

Figure 62 shows the Transition from Running through an Immediate Shutdown. The dashed lines on the top attempt to show the final mode if you enter the stop via various inputs.


Figure 62. Sequence of events: immediate shutdown to stopped or run inhibit

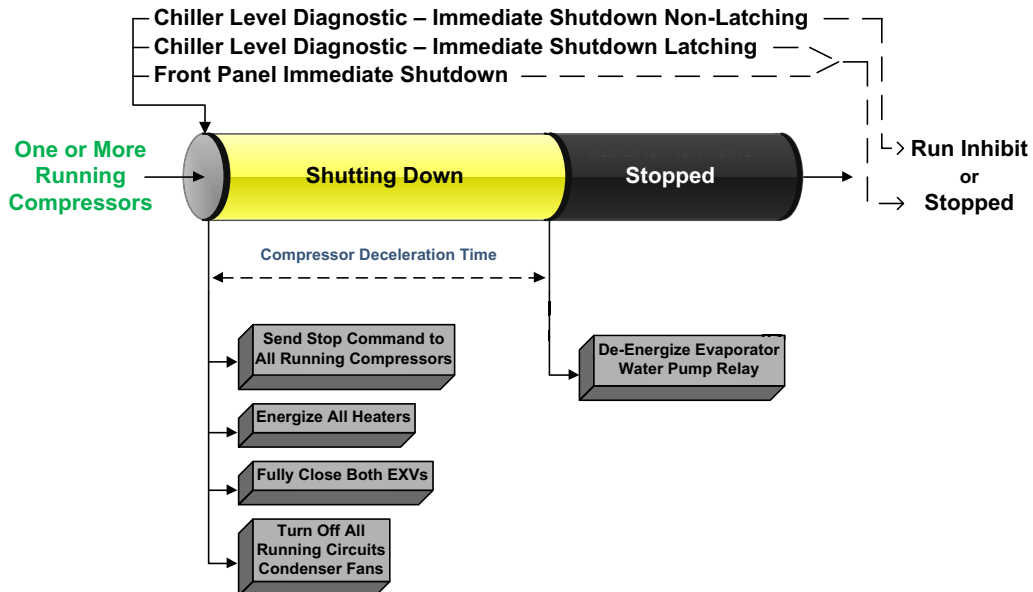

Ice Making (Running to Ice Making to Running)

Figure 63 shows the transition from normal cooling to Ice making, back to normal cooling


Figure 63. Sequence of events: ice making (running to ice making to running)

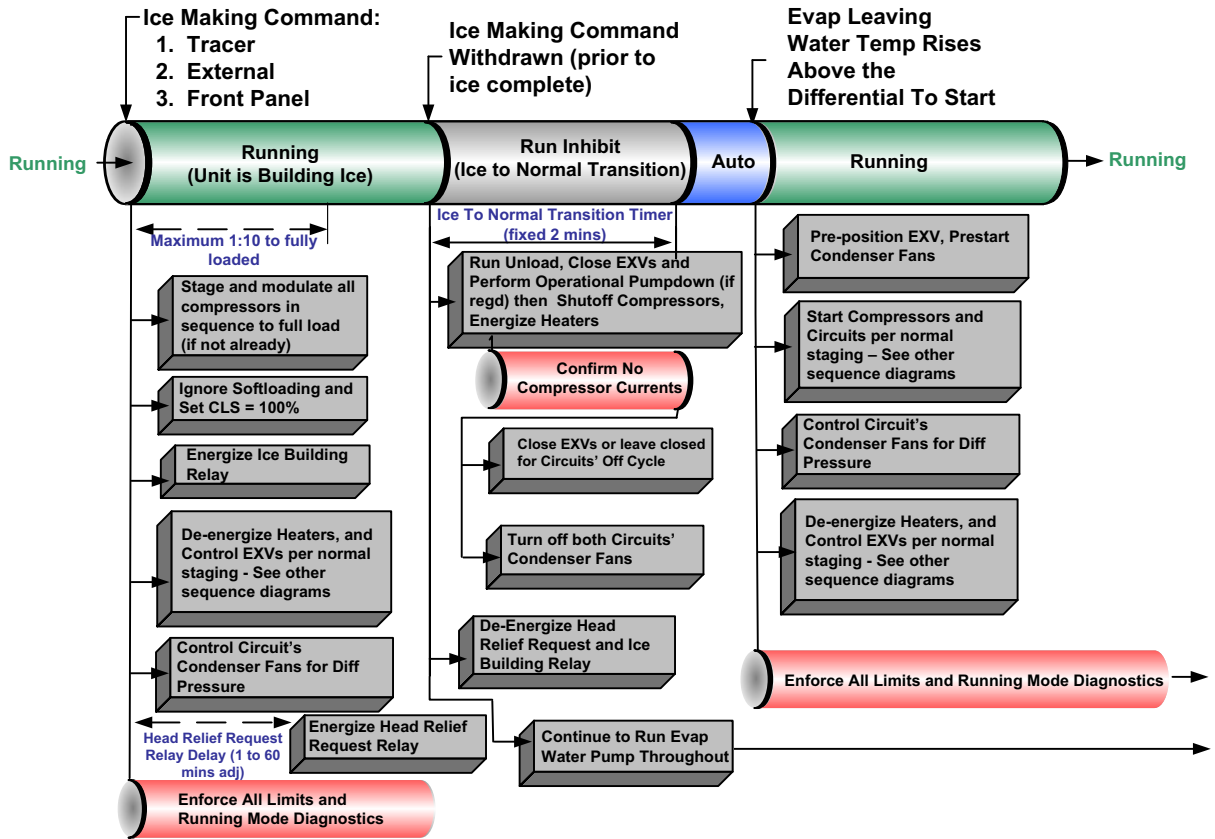

Ice Making (Auto to Ice Making to Ice Making Complete)

Figure 64 shows the transition from Auto to Ice making, to Ice Making Complete.

Figure 64. Sequence of events: ice making (auto to ice making to ice making complete)

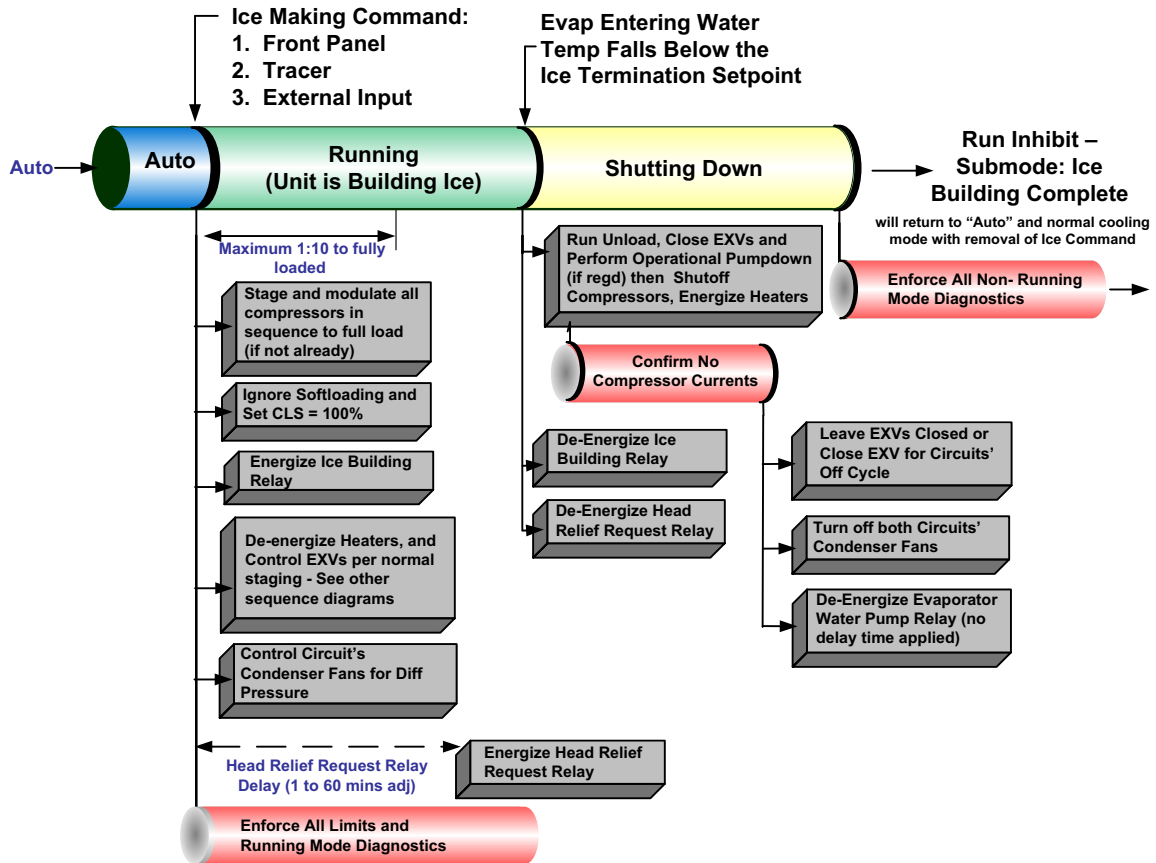



Maintenance

⚠ WARNING

Hazardous Voltage - Pressurized Burning Fluid!

The motors in the compressors have strong permanent magnet motors and have the capability to generate voltage during situations when the refrigerant charge is being migrated. This potential will be present at the motor terminals and at the output of the variable speed drives in the power panel.

Before removing compressor terminal box cover for servicing, or servicing power side of control panel, **CLOSE COMPRESSOR DISCHARGE SERVICE VALVE** and disconnect all electric power including remote disconnects. Discharge all motor start/run capacitors. Follow lockout/tagout procedures to ensure the power cannot be inadvertently energized. Verify with an appropriate voltmeter that all capacitors have discharged.

The compressor contains hot, pressurized refrigerant. Motor terminals act as a seal against this refrigerant. Care should be taken when servicing **NOT** to damage or loosen motor terminals.

Do not operate compressor without terminal box cover in place.

Failure to follow all electrical safety precautions could result in death or serious injury.

For additional information regarding the safe discharge of capacitors, see "Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge," p. 32 and PROD-SVB06A-EN.

⚠ WARNING

Hazardous Voltage w/Capacitors!

Disconnect all electric power, including remote disconnects and discharge all motor start/run and AFD (Adaptive Frequency™ Drive) capacitors before servicing. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized.

- For variable frequency drives or other energy storing components provided by Trane or others, refer to the appropriate manufacturer's literature for allowable waiting periods for discharge of capacitors. Verify with an appropriate voltmeter that all capacitors have discharged.
- DC bus capacitors retain hazardous voltages after input power has been disconnected. Follow proper lockout/tagout procedures to ensure the power cannot be inadvertently energized. After disconnecting input power, wait five (5) minutes for the DC capacitors to discharge, then check the voltage with a voltmeter. Make sure DC bus capacitors are discharged (0 VDC) before touching any internal components.

Failure to follow these instructions could result in death or serious injury.

For additional information regarding the safe discharge of capacitors, see "Adaptive Frequency™ Drive (AFD₃) Capacitor Discharge," p. 32 and PROD-SVB06A-EN.

This section describes the basic chiller preventive maintenance procedures, and recommends the intervals at which these procedures should be performed. Use of a periodic maintenance program is important to ensure the best possible performance and efficiency from a Stealth™ chiller.

Use an Operator Log (see "Log and Check Sheet," p. 90) to record an operating history for unit. The log serves as a valuable diagnostic tool for service personnel. By observing trends in operating conditions, an operator can anticipate and prevent problem situations before they occur.

If unit does not operate properly during inspections, see "Diagnostics," p. 73.

Recommended Maintenance

Weekly

While unit is running in stable conditions.

1. At AdaptiView™ TD7 or Tracer™ TU service tool, check pressure for evaporator, condenser and intermediate oil.
2. Observe liquid line sight glass on EXV. If liquid line sight glass has bubbles measure the subcooling entering the EXV. Subcooling should always be greater than 10°F.
3. Inspect the entire system for unusual operation.
4. Inspect the condenser coils for dirt and debris. If the coils are dirty, See “[Condenser Coils – Cleaning and Inspection](#),” p. 72.

NOTICE:

Equipment Damage!

Do not use detergents to clean RTAE coils. Use clean water only. Use of detergents on RTAE coils could cause damage to coils.

Monthly

1. Perform all weekly maintenance procedures.
2. Record the system subcooling.

Annual

1. Perform all weekly and monthly procedures.
2. Check oil sump oil level while unit is off. See “[Oil Sump Level Check](#),” p. 69.
3. Perform pH test of drive cooling fluid. See “[pH Test](#),” p. 71.
4. Have a qualified laboratory perform a compressor oil analysis to determine system moisture content and acid level.
5. Contact a Trane service organization to leak test the chiller, to check operating and safety controls, and to inspect electrical components for deficiencies.
6. Clean and repaint any areas that show signs of corrosion.
7. Clean the condenser coils. See “[Condenser Coils – Cleaning and Inspection](#),” p. 72.

NOTICE:

Equipment Damage!

Do not use detergents to clean RTAE coils. Use clean water only. Use of detergents on RTAE coils could cause damage to coils.

Refrigerant and Oil Charge Management

Proper oil and refrigerant charge is essential for proper unit operation, unit performance, and environmental protection. Only trained and licensed service personnel should service the chiller.

[Table 30](#) lists baseline measurements for Stealth units running at AHRI standard operating conditions. If chiller measurements vary significantly from values listed below, problems may exist with refrigerant and oil charge levels. Contact your local Trane office.

Note: *Low temperature applications units will have values that vary from [Table 30](#). Contact your local Trane office for more information.*

Table 30. Typical Stealth baselines (AHRI conditions)

| Measurement | Baseline |
|-------------------------------|-------------|
| Evaporator Pressure | 51 psia |
| Evaporator Approach | 3.4°F |
| EXV Position (150-200T units) | 45-50% open |
| EXV Position (225-300T units) | 61-64% open |
| Evaporator delta T - entering | 54°F |
| Evaporator delta T - leaving | 44°F |
| Discharge Superheat | 16.5°F |
| Condenser Pressure | 212 psia |
| Subcooling | 10-20°F |

Lubrication System

The lubrication system has been designed to keep most of the oil lines filled with oil as long as there is a proper oil level in the oil sump.

Oil Sump Level Check

The oil level in the sump can be measured to give an indication of the system oil charge. Follow the procedures below to measure the level.

1. Run the unit as near to full load as possible for a minimum of 30 minutes. For an accurate reading, 40 or more minutes at full load with normal/steady discharge superheat readings and no limits/warnings is recommended. Assessing oil charge after running at minimum or low loads may lead to an inaccurate reading.
2. Cycle the compressor off line.
3. Let the chiller sit (powered, but off line) to allow the oil separator heater to boil off the refrigerant that may be in the oil separator. An initial assessment of the oil separator level may be made after 30 minutes of heater ON dwell time, but oil charge adjustments should not be made without allowing the oil heaters to run for a minimum of 4 hours.

NOTICE:

Equipment Damage!

Never operate the compressor with the sightglass service valves opened. Close the valves after checking the oil level. Operating compressors with service valves open will result in severe oil loss and equipment damage.

- Attach a 3/8" or 1/2" hose with a sightglass in the middle to the oil sump service valve (1/4" flare) and the oil separator service valve (1/4" flare). See Figure 65, p. 70 for valve locations.

Note: Using high pressure rated clear hose with appropriate fittings can help speed up the process. Hose must be rated to withstand system pressures as found on unit nameplate.

Figure 65. Oil service valves


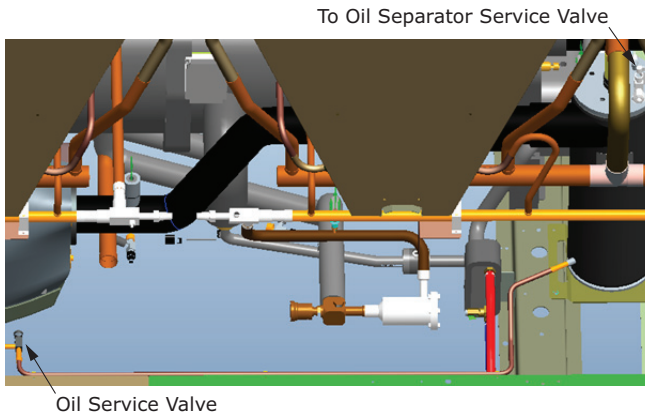


Figure 66. Nominal oil level

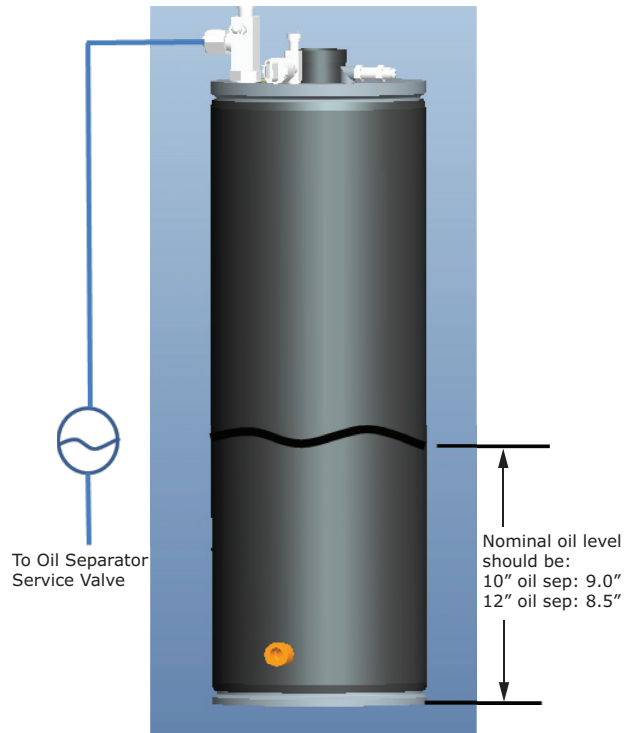

- After the unit is off line for 30 minutes, move the sightglass along the side of the oil sump.
- The nominal oil level from the bottom of the oil separator should be as shown in Table 31 and Figure 66, p. 70. Depending on running conditions and oil heater dwell time, some deviation from nominal levels is expected.

Important: If level is less than 4 inches from the bottom of the oil separator, contact your local Trane office.

Table 31. Oil sump level height

| Unit Size (tons) | Oil Separator Size | Nominal Oil Height |
|-----------------------------------|--------------------|--------------------|
| | 150-200 | 225 - 300 |
| Oil Separator Size | 10" | 12" |
| Nominal Oil Charge Height in (mm) | 9 | 8.5 |

Drive Cooling System

NOTICE:

Equipment Damage!

Use only Trane Heat Transfer Fluid P/N CHM01023. This fluid is a direct use concentration and is not to be diluted. Do not top off with water or any other fluid. Use of unapproved fluids, or dilution of approved fluid could result in catastrophic equipment damage.

Service Intervals

NOTICE:

Equipment Damage!

Drive cooling fluid and strainer must be serviced every five (5) years. Failure to do so could result in equipment damage.

- Every (5) years, contact your local Trane office to service drive fluid and strainer.
- On a yearly basis, a fluid pH test should be performed.

Unit Diagnostics

An improperly filled drive cooling system (either low fluid level or entrapped air in the circuit) can result in the AFD drive or output load inductors overheating. This condition may result in the following diagnostics:

- AFD xA Inverter Heatsink Over Temp
- AFD xA Rectifier Heatsink Over Temp
- AFD xA Estimated Junction Over Temp
- AFD xA Load Inductor High Temperature

A front panel warning of Low Oil Return or AFD Cooling – CktX does not indicate an issue with the drive cooling fluid system, but represents a low refrigerant level reported by the liquid level sensor for a given length of time.

If chiller diagnostics indicated drive cooling system problem, contact your local Trane office.

pH Test


Obtain a sample of fluid from the drive cooling loop via the loop drain located near the oil return heat exchanger. Test for pH level using litmus paper with a 0.5 resolution.

- pH < 8 indicates fluid to be changed
- pH < 7 indicates potential component damage

Pressure Relief Cap

The pressure relief cap is an automotive style pressure-vent radiator cap. See [Figure 67, p. 71](#). The setting for the relief spring is 16 lbs. The function of the relief cap can be verified with a standard automotive radiator cap tester.


Figure 67. Pressure relief cap

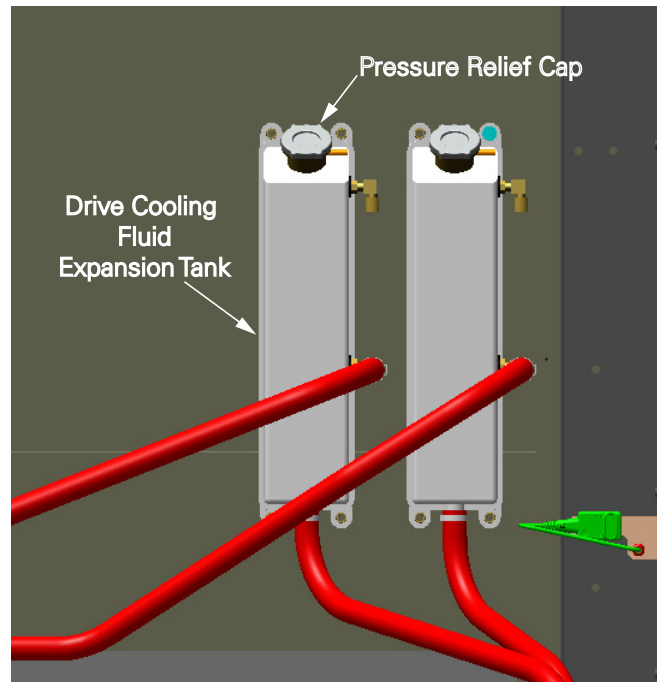

Drive Cooling Expansion Tank

Proper fluid level is important to the operation of the unit. To verify proper level, inspect the liquid level in each of the fluid reservoirs (located behind the chiller control panel). See [Figure 68](#) for fluid levels under various temperature conditions. If levels are low, contact your local Trane office.

Figure 68. Drive cooling expansion tank fill^(a)

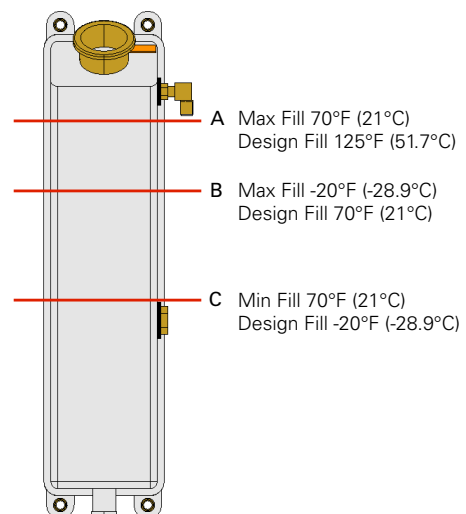

(a) Fill lines are NOT marked on tank. The A level is just below upper fitting, C level is just above lower fitting. B is in the middle of the fittings.



Condenser Coils — Cleaning and Inspection

Coil Cleaning and Inspection Interval

Clean condenser coils at least once a year or more frequently if it is in a “dirty” environment. A clean condenser coil will help maintain chiller operating efficiency. Perform coil inspection each time coils are cleaned.

Cleaning Air Side of RTAE Coils

NOTICE:

Equipment Damage!

Do not use coil cleaning agents to clean uncoated RTAE coils. Use clean water only. Use of coil cleaning agents on uncoated RTAE coils could cause damage to coils.

Do not use detergents to clean the air side of RTAE coils. Use clean water only. Clean from inside out by removing end panels.

Cleaning Coated Coils

⚠ WARNING

Hazardous Chemicals!

Coil cleaning agents can be either acidic or highly alkaline and can burn severely if contact with skin occurs. Handle chemical carefully and avoid contact with skin. ALWAYS wear Personal Protective Equipment (PPE) including goggles or face shield, chemical resistant gloves, boots, apron or suit as required. For personal safety refer to the cleaning agent manufacturer’s Materials Safety Data Sheet and follow all recommended safe handling practices. Failure to follow all safety instructions could result in death or serious injury.

Coated coils may be cleaned using traditional detergents.

Coil Corrosion Protection Inspection

Inspect corrosion protection at each coil refrigerant connection where the copper tube joins the aluminum manifold. If damaged or missing, wrap new Prestite Insulation (STR01506) on joint to cover area from the aluminum header body to at least 2 inches of the copper tube. Seal insulation using hand pressure. Rubber gloves are suggested when handling insulation.

Reinstallation of Compressor Shipping Bolts

Units with InvisiSound™ Ultimate Only (Model Number Digit 12 = 3)

If compressor removal or unit move is required on a unit with InvisiSound Ultimate option, reinstall compressor shipping bolts which were removed in section “Compressor Shipping Bolt Removal,” p. 23.

Servicing Chiller Roof

⚠ WARNING

Do Not Climb on Top of Chiller!

Do not climb on roof to service unit. Use service tools designed to access top of chiller. Failure to follow these instructions could result in technician falling off the equipment which could result in death or serious injury.

Service tools are available to access top of chiller. Entry on chiller roof is not required.

Diagnostics

Diagnostic Name and Source: Name of Diagnostic and its source. Note that this is the exact text used in the User Interface and/or Service Tool displays.

Affects Target: Defines the “target” or what is affected by the diagnostic. Usually either the entire Chiller, or a particular Circuit or Compressor is affected by the diagnostic (the same one as the source), but in special cases functions are modified or disabled by the diagnostic. “None” implies that there is no direct affect to the chiller, sub components or functional operation.

Design Note: Functions that are affected by a diagnostic are simply reported as “chiller or circuit x” targets in Tracer TU and on the Alarms page of the AdaptiView™ display, even though only a specific function and not the entire circuit or chiller would be effected.

Severity: Defines the severity of the above effect. Immediate means immediate shutdown of the affected portion, Normal means normal or friendly shutdown of the affected portion, Special Action means a special action or mode of operation (limp along) is invoked, but without shutdown, and Info means an Informational Note or Warning is generated. Design Note: Tracer TU does not support display of “Special Action”, on its Diagnostics pages, so that if a diagnostic has a special action defined in the table below, it will be displayed only as “Informational Warning” as long as no circuit or chiller

shutdown results. If there is a shutdown and special action defined in the table, then the Tracer TU Diagnostics Page display will indicate the shutdown type only.

Persistence: Defines whether or not the diagnostic and its effects are to be manually reset (Latched), or can be either manually or automatically reset when and if the condition returns to normal (Nonlatched).

Active Modes [Inactive Modes]: States the modes or periods of operation that the diagnostic is active in and, as necessary, those modes or periods that it is specifically “not active” in as an exception to the active modes. The inactive modes are enclosed in brackets, []. Note that the modes used in this column are internal and not generally announced to any of the formal mode displays.

Criteria: Quantitatively defines the criteria used in generating the diagnostic and, if nonlatching, the criteria for auto reset.

Reset Level: Defines the lowest level of manual diagnostic reset command which can clear the diagnostic. The manual diagnostic reset levels in order of priority are: Local or Remote. For example, a diagnostic that has a reset level of Remote, can be reset by either a remote diagnostic reset command or by a local diagnostic reset command.

AFD Diagnostics

Table 32. AFD diagnostics

| Diagnostic Name and Source | Affects | | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|---------|----------|------------------------|-------------------------------|--|-------------|
| | Target | Severity | | | | |
| AFD xA Temperature Sensor Warning | None | Info | NonLatch – timed reset | All | Any of the 3 IGBT modules (one per phase) has an open or out of range temperature sensor | Local |
| AFD 1A Voltage Transient Protection Loss | None | Info | NonLatch | All | Circuitry for respective AFD “Panel Interlock Warning” was activated. For RTAE the panel interlock warning input circuitry of AFD1A, is used to monitor the state of the entire unit’s Surge Arresters, which is an array of 4 Metal Oxide Varistors intended to protect the entire unit. An open state of the circuit suggests at least one of the MOVs has opened and the transient suppression protection is thereby compromised. Although the unit is not shutdown from this warning diagnostic, it is highly recommended to replace the protection MOVs as soon as practical, in order to protect from further damage to the drives as a result of incoming line transients. Even though the diagnostic has an AFD 1A prefix, it applies to the entire unit | Local |



Diagnostics

Table 32. AFD diagnostics (continued)

| Diagnostic Name and Source | Affects | | | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|---------|-------------------|-------------|-------------------------------|---|-------------|
| | Target | Severity | Persistence | | | |
| AFD xA 12-Pulse or Auto Transf High Temp | Circuit | Immediate | Latch | All | The emergency stop input of the respective AFD was activated (open circuit has been detected). For RTAE units with the Input Harmonic Distortion Option installed, (TDD<5%), the respective drive's Emergency Stop Fault input circuitry is used to monitor and trip on the series connected high limit thermostats of its associated 12-Pulse Autotransformer. For 200, 230 & 575 V units, the same input is used to monitor and trip on the series connected high limit thermostats of the Step-up/Step-down Voltage Autotransformer. Both circuit diagnostics will occur in the event of a high temperature trip of the Voltage Autotransformer. A tripped (open) state of the circuit, suggests an excessively high temperature of the respective transformer- Check the glycol cooling loop, the control panel ventilation or the Voltage Autotransformer panel ventilation fan as applicable. | Local |
| AFD xA A/D Calibration Error | Circuit | Immediate (decel) | Latch | Starting | Before each start, the A/D converters are calibrated against a known zero-voltage measurement. If the measurement reads more than 3% of full scale, the AFD asserts this A/D Calibration Error diagnostic. | Local |
| AFD xA AHD Frequency Out of Range | Circuit | Info | NonLatch | Running | The input frequency for the Active Harmonic Damping function of the respective AFD is outside the range 47 Hz < Fin < 63 Hz for more than one minute. This diagnostic is automatically reset when the input frequency returns to the range 47 Hz < Fin < 63 Hz. | Local |
| AFD xA AHD Sync Signal Error | Circuit | Info | NonLatch | Running | The Active Harmonic Damping function of the respective AFD is experiencing noise or glitching of the input line sync signal continuously for one minute. This diagnostic is automatically reset when the condition clears. | Local |
| AFD xA Bump Failure | Circuit | Immediate | Latch | Bump Mode | During the compressor bump operation, the motor current exceeded Bump Cutout Current. | Local |
| AFD xA Bus Over Voltage | Circuit | Immediate | NonLatch | Holding, Running | Bus overvoltage indicated the high bus voltage cut out has been exceeded while the AFD is in a non-stopped mode. The diagnostic will auto-reset when the bus voltage returns to its normal range for 1 minute. | Local |
| AFD xA Bus Under Voltage | Circuit | Immediate (decel) | NonLatch | Holding, Running | The bus voltage dropped below the Low Bus Cutout threshold and there is not enough voltage to reliably operate the load. The diagnostic will auto-reset when the bus voltage returns to its normal range for 1 minute. | Local |
| AFD xA Bus Voltage Ripple Too High | Circuit | Immediate | Latch | Running | The DC power bus voltage's ripple exceeds the drive's capability to operate reliably. | Local |
| AFD xA Comm Loss: Main Processor | Circuit | Immediate (decel) | Latch | All | The AFD detected a continual loss of communication with the main processor for greater than the Communications Loss Time (bound setpoint) | Local |
| AFD xA Compressor Start Failure | Circuit | Immediate | Latch | Starting | The compressor motor failed to start. This is most likely due to load torque (possibly transients) exceeding the torque capability. | Local |
| AFD xA Current Sensor Self Test Failure | Circuit | Immediate | Latch | Starting | Self testing indicates a current sensor is not working. Either it output is out of range or it significantly deviates from the expected current trajectory on self-test | Local |
| AFD xA Desaturation Detected | Circuit | Immediate | Latch | All | Output Short circuit sufficient to drive IGBT transistor gate into desaturation has been detected | Local |
| AFD xA DSP Board ID Error | Circuit | Immediate (decel) | Latch | Power Up | Occurs when frame size identification does not match the drive software. May occur upon DSP board replacement. Requires rebinding. | Local |
| AFD xA DSP Board Initialization Failure | Circuit | Immediate (decel) | Latch | Power Up | This results from address bus checking, data bus checking, line sync test, RAM test, each performed during the initialization | Local |
| AFD xA DSP Board Low Voltage Failure | Circuit | Immediate | NonLatch | All | One of the AFD internal power supplies' voltage has dropped below a reliable operation threshold | Local |
| AFD xA DSP Board Over Temp | Circuit | Immediate (decel) | NonLatch | All | DSP board thermal switch indicates a temperature above 85°C. | Local |

Table 32. AFD diagnostics (continued)

| Diagnostic Name and Source | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---------------------------------------|----------------|-------------------|-------------|-------------------------------|---|-------------|
| AFD xA Estimated Junction Over Temp | Circuit | Immediate (decel) | Latch | Running | The AFD has exceeded the allowed IGBT junction temperature. Suspect a problem with the Drive cooling system or if occurring during start acceleration, a damaged and/or locked rotor compressor | Local |
| AFD xA Excessive AHD Inhibit | Circuit | Info | Latch | All | The Active Harmonic Damping function of the respective AFD is experiencing noise or glitching of the input line sync signal and has experienced 3 inhibits in one minute or 10 inhibits in one hour. | Local |
| AFD xA Gate Drive Board Over Temp | Circuit | Immediate (decel) | NonLatch | All | Thermal switch on gate-drive board indicates its temperature exceeds 99°C | Local |
| AFD xA Gate Drive Fault | Circuit | Immediate | NonLatch | Running | Gate-drive board faults - One of the gate drive module power supplies is out of range | Local |
| AFD xA Gate Drive Low Voltage Failure | Circuit | Immediate | NonLatch | All | The 24Vdc gate drive supply to the gate drive module has dropped below a reliable operation threshold | Local |
| AFD xA Gate Drive Module Comm Loss | Circuit | Immediate (decel) | Latch | All | Loss of communication between DSP module and Gate Drive Module | Local |
| AFD xA Gate Kill Active | Circuit | Immediate | Latch | All | The respective drive's gate-kill circuitry was activated (open circuit). For RTAE, the respective compressor's High Pressure Cutout Switch is wired into this circuit, and will cause an immediate shutdown of the drive and compressor in the event of an HPC trip. A 2nd separate HPC diagnostic will occur in conjunction with this diagnostic – see details of the Main Processor Diagnostic "High Pressure Cutout" below | Local |
| AFD xA General Failure | Circuit | Immediate (decel) | Latch | All | Drive fault other than those supported in this list. | Local |
| AFD xA Ground Fault | Circuit | Immediate (decel) | Latch | Running | Measured ground current exceeds ground current sensitivity. | Local |
| AFD xA IGBT Self Test Failure | Circuit | Immediate | Latch | Starting | Self testing indicates one or more IGBT's is not working. | Local |
| AFD xA IMC 24V Low Voltage | Circuit | Immediate (decel) | NonLatch | All | Loss of 24V on the IMC/IPC machine bus has been detected by the AFD | Local |
| AFD xA Instantaneous Current Overload | Circuit | Immediate | Latch | Running | The instantaneous current of any of the output phases exceeded the drive capacity. | Local |
| AFD xA Invalid Drive Command | Circuit | Info | NonLatch | All | The AFD has reported that it had received a command for an invalid state transition from the main processor (MP). This diagnostic is not supported in 2.0 build | Local |
| AFD xA Inverter Heatsink Over Temp | Circuit | Immediate (decel) | NonLatch | All | The IGBT heatsink temperature exceeded the cut out temperature. | Local |
| AFD xA Load Inductor High Temperature | Circuit | Immediate (decel) | NonLatch | All | Circuitry for respective AFD "Panel Interlock Fault" was activated. For RTAE units, the panel interlock fault input circuitry is used to sense the state of the high limit thermostat of its associated load inductors. A tripped (open) state of the circuit, suggest a high temperature of the load inductor – Check the glycol cooling loop and the control panel ventilation | Local |
| AFD xA Loss of AHD Sync Signal | Circuit | Info | NonLatch | Running | The Active Harmonic Damping function of the respective AFD has received no valid input line sync signals for 1 minute | Local |
| AFD xA Low Rotor Flux Feedback | Circuit | Immediate (decel) | Latch | Running | The estimated rotor flux dropped below the minimum threshold | Local |
| AFD xA Motor Current Overload | Circuit | Immediate (decel) | Latch | Running | Compressor Motor Overload "Time to Trip" vs Current curve exceeded | Local |
| AFD xA Non-Volatile Memory Failure | Circuit | Immediate (decel) | Latch | Power Up | NV Memory does not pass CRC checks during initialization. This fault will normally occur when firmware is upgraded, and can be ignored and reset in that circumstance | Local |
| AFD xA Output Phase Loss | Circuit | Immediate (decel) | Latch | Running | Drive sensed that an output phase is missing. Output phase loss is defined as greater than 15% output current imbalance for more than 5.0 seconds. | Local |
| AFD xA Over Speed | Circuit | Immediate | Latch | All | The compressor motor's speed either exceeded Absolute Maximum Speed, or the drive has lost control. | Local |



Diagnostics

Table 32. AFD diagnostics (continued)

| Diagnostic Name and Source | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|-------------------------------------|----------------|-------------------|-------------|-------------------------------|---|-------------|
| AFD xA Rectifier Heatsink Over Temp | Circuit | Immediate (decel) | NonLatch | All | The diode heatsink temperature exceeded the cut out temperature. | Local |
| AFD xA Watchdog Timer Overflow | Circuit | Immediate | Latch | All | Watchdog timer overflowed. Requires power cycle to restore operation. | Local |

Main Processor Diagnostics

Table 33. Main processor diagnostics

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---|----------------|----------------|-------------|-------------------------------|--|-------------|
| BAS Communication Lost | None | Special Action | NonLatch | All | The BAS was setup as "installed" at the MP and the Lontalk LCIC lost communications with the BAS for 15 contiguous minutes after it had been established. Refer to Section on Setpoint Arbitration to determine how setpoints and operating modes may be affected by the comm loss. The chiller follows the value of the Tracer Default Run Command which can be previously written by Tracer and stored nonvolatily by the MP (either use local or shutdown). Note that this diagnostic is never operational for BACnet Communication interface (BCI-C) and only operational with a LonTalk Communication interface (LCI-C) if so configured by the BAS or Tracer system. | Remote |
| BAS Failed to Establish Communication | None | Special Action | NonLatch | At power-up | The BAS was setup as "installed" and the BAS did not communicate with the Lontalk LCIC within 15 minutes after chiller controls power-up. Refer to Section on Setpoint Arbitration to determine how setpoints and operating modes may be effected. Note that this diagnostic is never operational for BACnet Communication interface (BCI-C) and only operational with a LonTalk Communication interface (LCI-C) if so configured by the BAS or Tracer system. | Remote |
| Check Clock | Chiller | Info | Latch | All | The real time clock had detected loss of its oscillator at some time in the past. Check / replace battery? This diagnostic can be effectively cleared only by writing a new value to the chiller's time clock using the TU or DynaView's "set chiller time" functions. | Remote |
| Condenser Fan Inverter Fault - Ckt1 | None | Info | NonLatch | All | A fault signal has been detected from at least one of the Variable Speed Inverter Drive Condenser Fans of Circuit 1 (including the right hand fan of the Shared Fan Module if present). No action is taken. | Remote |
| Condenser Fan Inverter Fault - Ckt2 | None | Info | NonLatch | All | A fault signal has been detected from at least one of the Variable Speed Inverter Drive Condenser Fans of Circuit 2 (including the left hand fan of the Shared Fan Module if present). No action is taken. | Remote |
| Condenser Rfgt Pressure Transducer - Ckt1 | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Condenser Rfgt Pressure Transducer - Ckt2 | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Discharge Rfgt Temp Sensor - Cprsr1A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Discharge Rfgt Temp Sensor - Cprsr2A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Drive Cooling Supply Temp Sensor - Ckt1 | Circuit | Normal | Latch | All | Bad Sensor or LLID. | Remote |

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---|---------------------|-------------------------|-------------|---------------------------------------|--|-------------|
| Drive Cooling Supply Temp Sensor – Ckt2 | Circuit | Normal | Latch | All | Bad Sensor or LLID. | Remote |
| Emergency Stop | Chiller | Immediate | Latch | All | EMERGENCY STOP input is open. An external interlock has tripped. Time to trip from input opening to unit stop shall be 0.1 to 1.0 seconds. | Local |
| Evap Rfgt Pool Temp Sensor – Ckt1 | Circuit and Chiller | Special Action and Info | NonLatch | All | Bad Sensor or LLID. Note: The Evap Pool Temp Sensors are used for evaporator freeze protection (running and non-running). | Remote |
| Evap Rfgt Pool Temp Sensor – Ckt2 | Circuit and Chiller | Special Action and Info | NonLatch | All | Bad Sensor or LLID. Note: The Evap Pool Temp Sensors are used for evaporator freeze protection (running and non-running). | Remote |
| Evap Rfgt Pool Temp Sensor Error – Ckt1 | Circuit | Info and Special Action | Latch | Ckt Energized [Ckt Not Energized] | The evaporator refrigerant pool temperature sensor is indicating a temperature significantly warmer than the evaporator entering water temperature (by more than 7.2°F for 5 continuous min excluding ckt nonoperation and a 2 min ignore time relative to ckt startup). While this diagnostic is active, it will invalidate the evaporator pool temperature sensor. Freeze protection functions (i.e. freeze diagnostics and Evap Pump Override) will default to the respective evaporator pressure transducer and its calculated saturation temperature. | Local |
| Evap Rfgt Pool Temp Sensor Error – Ckt2 | Circuit | Info and Special Action | Latch | Ckt Energized [Ckt Not Energized] | The evaporator refrigerant pool temperature sensor is indicating a temperature significantly warmer than the evaporator entering water temperature (by more than 7.2°F for 5 continuous min excluding ckt nonoperation and a 2 min ignore time relative to ckt startup). While this diagnostic is active, it will invalidate the evaporator pool temperature sensor. Freeze protection functions (i.e. freeze diagnostics and Evap Pump Override) will default to the respective evaporator pressure transducer and its calculated saturation temperature. | Local |
| Evap Spillover Liquid Level Sensor – Ckt1 | Circuit | Normal | Latch | All | Bad Sensor or LLID | Remote |
| Evap Spillover Liquid Level Sensor – Ckt2 | Circuit | Normal | Latch | All | Bad Sensor or LLID | Remote |
| Evap Water Flow (Entering Water Temp) | None | Info | NonLatch | Any Ckt Energized [No Ckts Energized] | The entering evaporator water temp fell below the leaving evaporator water temp by more than 2°F for 180°F-sec, minimum trip time 30 seconds. It can warn of improper flow direction through the evaporator, misbound water temperature sensors, improper sensor installation, partially failed sensors, or other system problems. Note that either entering or leaving water temp sensor or the water system could be at fault. | Remote |
| Evaporator Approach Error – Ckt1 | Circuit | Immediate | Latch | Respective circuit running | The Evaporator approach temperature for the respective circuit (ELWT – Evap Sat Temp Ckt 1) is negative by more than 10°F for 1 minute continuously while the circuit / compressor is operating. Either the Evap Leaving Water Temp sensor, or Evap Suction Rfgt Pressure Transducer Ckt 1 is in error. | Remote |
| Evaporator Approach Error – Ckt2 | Circuit | Immediate | Latch | Respective circuit running | The Evaporator approach temperature for the respective circuit (ELWT – Evap Sat Temp Ckt 2) is negative by more than 10°F for 1 minute continuously while the circuit / compressor is operating. Either the Evap Leaving Water Temp sensor, or Evap Suction Rfgt Pressure Transducer Ckt 2 is in error. | Remote |
| Evaporator Entering Water Temp Sensor | Chiller | Normal | Latch | All | Bad Sensor or LLID. Note: Entering Water Temp Sensor is used in EXV pressure control as well as ice making so it must cause a unit shutdown even if ice or CHW reset is not installed. | Remote |
| Evaporator Leaving Water Temp Sensor | Chiller | Normal | Latch | All | Bad Sensor or LLID | Remote |
| Evaporator Water Flow Lost | Chiller | Immediate | NonLatch | [All Stop modes] | a. The Evaporator water flow switch input was open for more than 6 contiguous seconds (or 15 seconds for thermal dispersion type flow switch). b. This diagnostic does not de-energize the evap pump output. c. 6 seconds of contiguous flow shall clear this diagnostic. | Remote |



Diagnostics

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes | | Reset Level | |
|--|----------------|-----------|-------------|------------------|---|---|--------|
| | | | | [Inactive Modes] | Criteria | | |
| Evaporator Water Flow Overdue | Chiller | Normal | NonLatch | | Estab. Evap. Water Flow on going from STOP to AUTO or Evap Pump Override. | Remote | |
| Excessive Condenser Pressure – Ckt1 | Circuit | Immediate | Latch | All | The condenser pressure transducer of this circuit has detected a condensing pressure in excess of the design high side pressure as limited by the particular compressor type. | Remote | |
| Excessive Condenser Pressure – Ckt2 | Circuit | Immediate | Latch | All | The condenser pressure transducer of this circuit has detected a condensing pressure in excess of the design high side pressure as limited by the particular compressor type. | Remote | |
| External Chilled/Hot Water Setpoint | None | Info | Latch | All | a. Function Not "Enabled": no diagnostics. b. "Enabled": Out-Of-Range Low or Hi or bad LLID, set diagnostic, default CWS to next level of priority (e.g. Front Panel SetPoint). | Remote | |
| External Demand Limit Setpoint | None | Info | Latch | All | a. Not "Enabled": no diagnostics. b. "Enabled": Out-Of-Range Low or Hi or bad LLID, set diagnostic, default CLS to next level of priority (e.g. Front Panel SetPoint). | Remote | |
| Failure to Arm or Hold - AFD 1A | Circuit | Info | Nonlatch | All | AFD 1A (controlling Compressor 1A) failed to respond in an appropriate time with its status of Armed to Hold or Hold within the allotted time of 1 minute of the sent command. (Arm to Hold command sent; armed to Hold status received; Hold command sent; Hold status received) | Local | |
| Failure to Arm or Hold - AFD 2A | Circuit | Info | Nonlatch | All | AFD 2A (controlling Compressor 2A) failed to respond in an appropriate time with its status of Armed to Hold or Hold within the allotted time of 1 minute of the sent command. (Arm to Hold command sent; armed to Hold status received; Hold command sent; Hold status received) | Local | |
| Failure to Arm or Start - AFD 1A | Circuit | Immediate | Latch | All | AFD 1A (controlling Compressor 1A) failed to arm or start within the allotted time of 1 minute. (Arm to Start command sent; armed to Start status received; Start command sent; Started status received) | Local | |
| Failure to Arm or Start - AFD 2A | Circuit | Immediate | Latch | All | AFD 2A (controlling Compressor 2A) failed to arm or start within the allotted time of 1 minute. (Arm to Start command sent; armed to Start status received; Start command sent; Started status received) | Local | |
| High Differential Rfgt Pressure - Ckt1 | Circuit | Normal | Latch | | Cprsr Energized [Service/Op Pumpdown] | The differential pressure for the respective circuit was above 275 Psid (1890 kPa) for 2 consecutive samples 5 seconds apart. | Remote |
| High Differential Rfgt Pressure - Ckt2 | Circuit | Normal | Latch | | Cprsr Energized [Service/Op Pumpdown] | The differential pressure for the respective circuit was above 275 Psid (1890 kPa) for 2 consecutive samples 5 seconds apart | Remote |
| High Discharge Temperature – Cprsr1A | Circuit | Immediate | Latch | | All [compressor run unload or compressor not running] | The compressor discharge temperature exceeded 200°F (without oil cooler) or 230°F (with oil cooler). This diagnostic will be suppressed during Stopping mode or after the compressor has stopped. Note: As part of the Compressor High Temperature Limit Mode (aka Minimum Capacity Limit), the compressor shall be forced loaded as the filtered discharge temperature reaches 190°F (without oil coolers), or 220°F (with oil coolers). | Remote |
| High Discharge Temperature – Cprsr2A | Circuit | Immediate | Latch | | All [compressor run unload or compressor not running] | The compressor discharge temperature exceeded 200°F (without oil cooler) or 230°F (with oil cooler). This diagnostic will be suppressed during Stopping Mode or after the compressor has stopped. Note: As part of the Compressor High Temperature Limit Mode (aka Minimum Capacity Limit), the compressor shall be forced loaded as the filtered discharge temperature reaches 190°F (without oil coolers), or 220°F (with oil coolers). | Remote |

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|----------------|---------------------------------------|-------------|--|--|-------------|
| High Evaporator Refrigerant Pressure | Chiller | Immediate | NonLatch | All | The evaporator refrigerant pressure of either circuit has risen above 190 psig. The evaporator water pump relay will be de-energized to stop the pump regardless of why the pump is running. The diagnostic will auto reset and the pump will return to normal control when all of the evaporator pressures fall below 185 psig. The primary purpose is to stop the evaporator refrigerant side pressures, close to the evaporator relief valve setting, when the chiller is not running, such as could occur with Evap Water Flow Overdue or Evaporator Water Flow Loss Diagnostics. | Remote |
| High Evaporator Water Temperature | Chiller | Info and Special Action | NonLatch | Only effective if either 1)Evap Wtr Flow Overdue, 2)Evap Wtr Flow Loss, or 3)Low Evap Rfgr Temp,-Unit Off, diagnostic is active. | Either the leaving or the entering water temperature exceeded the high evap water temp limit (TV service menu settable – default 105°F) for 15 continuous seconds. The evaporator water pump relay will be de-energized to stop the pump but only if it is running due one of the diagnostics listed on the left . The diagnostic will auto reset and the pump will return to normal control when both the entering and leaving temperatures fall 5°F below the trip setting. The primary purpose is to stop the evaporator water pump and its associated pump heat from causing excessive waterside temperatures and waterside pressures when the chiller is not running but the evap pump is on due to either Evap Water Flow Overdue, Evaporator Water Flow Loss, or Low Evap Temp – Unit Off Diagnostics. This diagnostic will not auto clear solely due to the clearing of the enabling diagnostic. | Remote |
| High Motor Winding Temperature - Cprsr1A | Circuit | Immediate | Latch | All | Any of the compressor’s motor winding temperature sensors is seen to be beyond the windings rated temperature of 265°F (129.4°C) | Local |
| High Motor Winding Temperature - Cprsr2A | Circuit | Immediate | Latch | All | Any of the respective compressor’s motor winding temperature sensors is seen to be beyond the windings rated temperature of 265°F (129.4°C) | Local |
| High Pressure Cutout - Cprsr1A | Circuit | Immediate | Latch | All | A high pressure cutout was detected by AFD 1A Gate Kill Input ; trip at 315 ± 5 PSIG. | Local |
| High Pressure Cutout - Cprsr2A | Circuit | Immediate | Latch | All | A high pressure cutout was detected by AFD 2A Gate Kill Input ; trip at 315 ± 5 PSIG. | Local |
| High Refrigerant Pressure Ratio – Ckt1 | Circuit | Immediate | Latch | Cprsr Energized | The pressure ratio for the respective circuit exceeded 12.3 for 1 contiguous minute while running in any mode. The pressure ratio is defined as Pcond (abs)/Pevap(abs). | Remote |
| High Refrigerant Pressure Ratio – Ckt2 | Circuit | Immediate | Latch | Cprsr Energized | The pressure ratio for the respective circuit exceeded 12.3 for 1 contiguous minute while running in any mode. The pressure ratio is defined as Pcond (abs)/Pevap(abs). | Remote |
| Interrupt Failure – AFD1A | Circuit | Immediate Shutdown and Special Action | Latch | AFD intended to be OFF | Respective AFD is reporting that it is still running the compressor when the MP has commanded the drive/compressor to be Off. Detection time shall be 10 seconds minimum and 15 seconds maximum. On detection and until the controller is manually reset: this diagnostic shall be active and the alarm relay shall be energized, the Evap Pump Output will be energized, the effected compressor will be continually commanded off, and be unloaded, while a normal stop shall be commanded to all other compressors. For as long as compressor operation continues, the MP shall continue liquid level, oil return, and fan control on the circuit effected. | Local |

Diagnostics

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---------------------------------------|----------------|---------------------------------------|-------------|--|--|-------------|
| Interrupt Failure – AFD2A | Circuit | Immediate Shutdown and Special Action | Latch | AFD intended to be OFF | Respective AFD is reporting that it is still running the compressor when the MP has commanded the drive/compressor to be Off. Detection time shall be 10 seconds minimum and 15 seconds maximum. On detection and until the controller is manually reset: this diagnostic shall be active and the alarm relay shall be energized, the Evap Pump Output will be energized, the effected compressor will be continually commanded off, and be unloaded, while a normal stop shall be commanded to all other compressors. For as long as compressor operation continues, the MP shall continue liquid level, oil return, and fan control on the circuit effected. | Local |
| LCI-C Software Mismatch: Use BAS Tool | Chiller | Info | Nonlatch | All | The neuron software in the LCI-C module does not match the chiller type. Download the proper software into the LCI-C neuron. To do this, use the Rover service tool, or a LonTalk® tool capable of downloading software to a Neuron 3150®. | Remote |
| Loss of Oil (Running) - Cprsr1A | Circuit | Immediate | Latch | Starter Contactor Energized | In running modes, Oil Loss Level Sensor detects lack of oil in the oil sump feeding the compressor (distinguishing a liquid flow from a vapor flow). | Local |
| Loss of Oil (Running) - Cprsr2A | Circuit | Immediate | Latch | Starter Contactor Energized | In running modes, Oil Loss Level Sensor detects lack of oil in the oil sump feeding the compressor (distinguishing a liquid flow from a vapor flow). | Local |
| Loss of Oil (Stopped) – Cprsr1A | Circuit | Immediate Shutdown and Special Action | Latch | Compressor Pre-start [all other modes] | Oil Loss Level Sensor detects a lack of oil in the oil sump feeding the compressor for 90 seconds after EXV preposition is completed on an attempted circuit start. Note: Compressor start is delayed pending oil detection during that time, but not allowed once the diagnostic occurs. | Local |
| Loss of Oil (Stopped) – Cprsr2A | Circuit | Immediate Shutdown and Special Action | Latch | Compressor Pre-start [all other modes] | Oil Loss Level Sensor detects a lack of oil in the oil sump feeding the compressor for 90 seconds after EXV preposition is completed on an attempted circuit start. Note: Compressor start is delayed pending oil detection during that time, but not allowed once the diagnostic occurs. | Local |
| Low Differential Rfqt Pressure - Ckt1 | Circuit | Immediate | Latch | Cprsr Energized | The system differential pressure (Pc-Pe) for the respective circuit was below 25 psid (240.5 kPa) or the pressure ratio (Pc/Pe) was less than 1.1 while the compressor is running for a period of time dependent on the deficit (15 sec ignore time from circuit start). Refer to the Oil Flow Protection specification for the time to trip function. | Remote |
| Low Differential Rfqt Pressure - Ckt2 | Circuit | Immediate | Latch | Cprsr Energized | The system differential pressure (Pc-Pe) for the respective circuit was below 25 psid (240.5 kPa) or the pressure ratio (Pc/Pe) was less than 1.1 while the compressor is running for a period of time dependent on the deficit (15 sec ignore time from circuit start). Refer to the Oil Flow Protection specification for the time to trip function. | Remote |
| Low Discharge Superheat – Ckt1 | Circuit | Normal | Latch | Any Running Mode | While Running Normally, the Discharge Superheat was less than 9 degrees F for more than 4878 degree F seconds. At circuit startup, the Discharge Superheat will be ignored for 5 minutes. | Remote |
| Low Discharge Superheat – Ckt2 | Circuit | Normal | Latch | Any Running Mode | While Running Normally, the Discharge Superheat was less than 9 degrees F for more than 4878 degree F seconds. At circuit startup, the Discharge Superheat will be ignored for 5 minutes. | Remote |
| Low Evaporator Rfqt Pressure - Ckt1 | Circuit | Immediate | Latch | Cprsr Prestart and Cprsr Energized | a. The Evap Refrig Pressure dropped below 10 Psia just prior to compressor start (after EXV preposition). b. During Early Startup Period: the Evap Refrig Pressure fell below a pressure equal to Condenser Pressure ÷ 8 but as limited to not less than 6 or greater than 10 psia. c. After Early Startup Period expires: The Evap Refrig Pressure fell below 16 Psia for 30 seconds or below 10 psia for 5 seconds. (Note: the Early Startup Period for RTAE it is between 1 and 5 min as an inverse function of the Cond Temp measured at time of circuit startup). | Local |

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---|----------------|-------------------------|-------------|---|--|-------------|
| Low Evaporator Rfght Pressure - Ckt2 | Circuit | Immediate | Latch | Cprsr Prestart and Cprsr Energized | a. The Evap Refrig Pressure dropped below 10 Psia just prior to compressor start (after EXV preposition). b. During Early Startup Period: the Evap Refrig Pressure fell below a pressure equal to Condenser Pressure ÷ 8 but as limited to not less than 6 or greater than 10 psia. c. After Early Startup Period expires: The Evap Refrig Pressure fell below 16 Psia for 30 seconds or below 10 psia for 5 seconds. (Note: the Early Startup Period for RTAE it is between 1 and 5 min as an inverse function of the Cond Temp measured at time of circuit startup). | Local |
| Low Evaporator Rfght Temperature - Ckt1 | Circuit | Immediate | Latch | All Ckt Running Modes [Service Pumpdown] | The warmer of either the Evaporator Refrigerant Pool Temperature or the Evaporator Saturated Temperature for the respective circuit, dropped below the Low Refrigerant Temperature Cutout Setpoint for 2250°F-sec (12°F-sec/sec max rate for early circuit startup period) while the circuit was running. The minimum LERTC setpoint is -5°F the point at which oil separates from the refrigerant. The integral is held nonvolatily though power down, is continuously calculated, and can decay or build during the circuit's off cycle as conditions warrant. | Remote |
| Low Evaporator Rfght Temperature - Ckt2 | Circuit | Immediate | Latch | All Ckt Running Modes [Service Pumpdown] | The warmer of either the Evaporator Refrigerant Pool Temperature or the Evaporator Saturated Temperature for the respective circuit, dropped below the Low Refrigerant Temperature Cutout Setpoint for 2250°F-sec (12°F-sec/sec max rate for early circuit startup period) while the circuit was running. The minimum LERTC setpoint is -5°F the point at which oil separates from the refrigerant. The integral is held nonvolatily though power down, is continuously calculated, and can decay or build during the circuit's off cycle as conditions warrant. | Remote |
| Low Evaporator Temp (Unit Off) - Ckt1 | Evap Pump | Info and Special Action | NonLatch | Unit in Stop Mode, or in Auto Mode and No Ckt's Energzd [Any Ckt Energzd] | The respective circuit's "Chiller Off Cycle Freeze Protection Integral" was seen to be higher than 1/2 of its trip value while the chiller is in the Stop mode, or in Auto mode with no compressors running, for one minute and more. The COCFP integral is increased if the Average of the Evap Water Temperature and the Evap Refrigerant Pool Temp is below the value of the Low Evap Rfght Temp Cutout + 4°F. Energize Evap Water Pump and Off-Cycle Freeze Avoidance Request Relay until diagnostic auto resets, then return to normal evap pump control and de-energize the Freeze Avoidance Request. Automatic reset occurs when the respective Evap Rfght Pool Temp rises 2°F (1.1°C) above the LERTC cutout setting and the COCFP Integral is less than 1/3 of its trip value. This diagnostic even while active, does not prevent operation of either circuit. (At each circuit shutdown, the COCFP integral is initialized to the LERTC integral). | Remote |
| Low Evaporator Temp (Unit Off) - Ckt2 | Evap Pump | Special Action | NonLatch | Unit in Stop Mode, or in Auto Mode and No Ckt's Energzd [Any Ckt Energzd] | The respective circuit's "Chiller Off Cycle Freeze Protection Integral" was seen to be higher than 1/2 of its trip value while the chiller is in the Stop mode, or in Auto mode with no compressors running, for one minute and more. The COCFP integral is increased if the Average of the Evap Water Temperatures and the Evap Refrigerant Pool Temp is below the value of the Low Evap Rfght Temp Cutout + 4°F. Energize Evap Water Pump and Off-Cycle Freeze Avoidance Request Relay until diagnostic auto resets, then return to normal evap pump control and de-energize the Freeze Avoidance Request. Automatic reset occurs when the respective Evap Rfght Pool Temp rises 2°F (1.1°C) above the LERTC cutout setting AND the COCFP Integral is less than 1/3 of its trip value. This diagnostic even while active, does not prevent operation of either circuit. (At each circuit shutdown, the COCFP integral is initialized to the LERTC integral). | Remote |



Diagnostics

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--------------------------------------|--|---------------------------------------|-------------|--|---|-------------|
| Low Evaporator Water Temp (Unit Off) | Evap Pump and Freeze Avoidance Request Relay | Info and Special Action | NonLatch | Unit in Stop Mode, or in Auto Mode and No Ckt(s) Energzd [Any Ckt Energzd] | Either the entering or leaving evaporator water temp fell below the leaving water temp cutout setting for 30°F-seconds while the Chiller is in the Stop mode, or in Auto mode with no compressors running. Energize Freeze Avoidance Request Relay and Evap Water Pump Relay until diagnostic auto resets, then de-energize the Freeze Avoidance Request Relay and return to normal evap pump control. Automatic reset occurs when both temps rise 2°F (1.1°C) above the cutout setting for 5 minutes, or either circuit starts. This diagnostic even while active, does not prevent operation of either circuit. | Remote |
| Low Evaporator Water Temp: Unit On | Chiller | Immediate Shutdown and Special Action | NonLatch | Any Ckt[s] Energzd [No Ckt(s) Energzd] | The evaporator entering or leaving water temp fell below the cutout setpoint for 30°F-seconds while the compressor was running. Automatic reset occurs when both of the temperature rises 2°F (1.1°C) above the cutout setting for 2 minutes. This diagnostic shall not de-energize the Evaporator Water Pump Output. | Remote |
| Low Oil Flow - Cprsr2A | Circuit | Immediate | Latch | Cprsr Energized and Delta P above 15 Psid | The oil pressure transducer for this compressor was indicating an unacceptable oil pressure drop as a % of the available oil pressure to move oil, suggesting significantly reduced oil flow to the compressor. Possible root causes include oil line service valve closed or restricted, dirty or restricted oil filter, or compressor oil line kepner valve malfunction. | Local |
| Low Oil Flow - Cprsr 1A | Circuit | Immediate | Latch | Cprsr Energized and Delta P above 15 Psid | The oil pressure transducer for this compressor was indicating an unacceptable oil pressure drop as a % of the available oil pressure to move oil, suggesting significantly reduced oil flow to the compressor. Possible root causes include oil line service valve closed or restricted, dirty or restricted oil filter, or compressor oil line kepner valve malfunction. | Local |
| Low Oil Return or AFD Cooling - Ckt1 | Circuit | Info | NonLatch | All Ckt Running Modes | The evaporator's spillover tank refrigerant liquid level, which feeds the oil return and drive cooling heat exchanger, is seen to be less than 90% of its min level for 20 continuous minutes – reset when level gets to 88% of min level. The occurrence of this warning in conjunction with the "Loss of Oil (Running)" or any of the "AFD Over Temp" shutdown diagnostics, suggests either EXV problems or loss of charge is a contributing factor. | |
| Low Oil Return or AFD Cooling - Ckt2 | Circuit | Info | NonLatch | All Ckt Running Modes | The evaporator's spillover tank refrigerant liquid level, which feeds the oil return and drive cooling heat exchanger, is seen to be less than 90% of its min level for 20 continuous minutes – reset when level gets to 88% of min level. The occurrence of this warning in conjunction with the "Loss of Oil (Running)" or any of the "AFD Over Temperature" shutdown diagnostics, suggests either EXV problems or loss of charge is a contributing factor. | |
| Motor Winding Temp Sensor - Cprsr1A | Circuit | Info or None | Latch | All | Both of the motor winding temperature sensors are seen to be out of their normal range. (Severity is adjustable via TU Service Tool – default is Info) | Local |
| Motor Winding Temp Sensor- Cprsr2A | Circuit | Info or None | Latch | All | Both of the motor winding temperature sensors are seen to be out of their normal range. (Severity is adjustable via TU Service Tool – default is Info) | Local |
| MP Application Memory CRC Error | Chiller | Immediate | Latch | All Modes | Memory error criteria TBD | Remote |
| MP: Could not Store Starts and Hours | None | Info | Latch | All | MP has determined there was an error with the previous power down store. Starts and Hours may have been lost for the last 24 hours. | Remote |
| MP: Invalid Configuration | None | Immediate | Latch | All | MP has an invalid configuration based on the current software installed. | Remote |
| MP: Non-Volatile Memory Reformat | None | Info | Latch | All | MP has determined there was an error in a sector of the Non-Volatile memory and it was reformatted. Check settings. | Remote |

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---|----------------|------------------|-------------|--|---|-------------|
| MP: Reset Has Occurred | None | Info | NonLatch | All | The main processor has successfully come out of a reset and built its application. A reset may have been due to a power up, or a power loss of a minimum or longer duration to cause an MP power down reset, or when installing new software or defining a new configuration. This diagnostic is immediately and automatically cleared and thus can only be seen in the Historic Diagnostic List in TU. | Remote |
| No Differential Rfght Pressure – Ckt1 | Circuit | Immediate | Latch | Compressor running on Circuit | The system differential pressure was below 7.7 Psid (53 kPa) for 6 seconds after the 11 seconds ignore time relative to cprsr/ circuit startup had expired. | Remote |
| No Differential Rfght Pressure – Ckt2 | Circuit | Immediate | Latch | Compressor running on Circuit | The system differential pressure was below 7.7 Psid (53 kPa) for 6 seconds after the 11 seconds ignore time relative to cprsr/ circuit startup had expired. | Remote |
| Oil Analysis Recommended – Ckt1 | Circuit | Info | Latch | “Service Messages” enabled | Diagnostic occurs when accumulated circuit operating hours since last initialized exceeds 2000 hours. Diagnostic can be manually cleared but will reoccur every month (720 hours on real time clock) as long as accumulator is not re-initialized. | Remote |
| Oil Analysis Recommended – Ckt2 | Circuit | Info | Latch | “Service Messages” enabled | Diagnostic occurs when accumulated circuit operating hours since last initialized exceeds 2000 hours. Diagnostic can be manually cleared but will reoccur every month (720 hours on real time clock) as long as accumulator is not re-initialized. | Remote |
| Oil Filter Change Recommended – Cprsr1A | Circuit | Info | Latch | “Service Messages” enabled | Diagnostic occurs only when “service messages” are enabled and when average oil pressure drop exceeds 18%. Diagnostic can be manually cleared but will reoccur every month (720 hours on real time clock) as long as average pressure drop does not fall below 16%. | Remote |
| Oil Filter Change Recommended – Cprsr2A | Circuit | Info | Latch | “Service Messages” enabled | Diagnostic occurs only when “service messages” are enabled and when average oil pressure drop exceeds 18%. Diagnostic can be manually cleared but will reoccur every month (720 hours on real time clock) as long as average pressure drop does not fall below 16%. | Remote |
| Oil Flow Protection Fault – Ckt 1 | Circuit | Immediate | Latch | Starter Contactor Energized [all Stop modes] | The Intermediate Oil Pressure Transducer for this cprsr is reading a pressure either above its respective circuit’s Condenser Pressure by 15 Psia or more, or below its respective Suction Pressure 10 Psia or more for 30 seconds continuously. | Local |
| Oil Flow Protection Fault – Ckt2 | Circuit | Immediate | Latch | Starter Contactor Energized [all Stop modes] | The Intermediate Oil Pressure Transducer for this cprsr is reading a pressure either above its respective circuit’s Condenser Pressure by 15 Psia or more, or below its respective Suction Pressure 10 Psia or more for 30 seconds continuously. | Local |
| Oil Pressure Transducer – Cprsr1A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Oil Pressure Transducer – Cprsr2A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Outdoor Air Temperature Sensor | Chiller | Normal Shutdown; | Latch | All | Bad Sensor or LLID. If this diagnostic occurs, operational pumpdown will be performed regardless of the last valid temperature. | Remote |
| Pumpdown Terminated - Ckt1 | Circuit | Info | NonLatch | Service Pumpdown | Service Pumpdown cycle for this circuit was terminated abnormally due to excessive time. (RTAE max Service Pumpdown = 4 min). | Local |
| Pumpdown Terminated - Ckt2 | Circuit | Info | NonLatch | Service Pumpdown | Service Pumpdown cycle for this circuit was terminated abnormally due to excessive. (RTAE max Service Pumpdown = 4 min). | Local |
| Software Error 1001: Call Trane Service | All functions | Immediate | Latch | All | A high level software watchdog has detected a condition in which there was a continuous 1 minute period of compressor operation, with neither Evaporator water flow nor a “contactor interrupt failure” diagnostic active. The presence of this software error message suggests an internal software problem has been detected. The events that led up to this failure, if known, should be recorded and transmitted to Trane Controls Engineering. | Local |



Diagnostics

Table 33. Main processor diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|----------------|-----------|-------------|--|--|-------------|
| Software Error 1002: Call Trane Service | All functions | Immediate | Latch | All | Reported if state chart misalignment in stopped or inactive state occurred while a compressor was seen to be operating and this condition lasted for at least 1 minute (cmprsr operation due to Service Pumpdown or with Contactor Interrupt Failure diagnostic is excluded). The presence of this software error message suggests an internal software problem has been detected. The events that led up to this failure, if known, should be recorded and transmitted to Trane Controls Engineering. | Local |
| Software Error 1003: Call Trane Service | All functions | Immediate | Latch | All | Reported if state chart misalignment occurred inferred from either Capacity Control, Circuit, or Compressor State Machines remaining in the Stopping state for more than 3 minutes. The presence of this software error message suggests an internal software problem has been detected. The events that led up to this failure, if known, should be recorded and transmitted to Trane Controls Engineering. | Local |
| Starts or Hours Modified – Cprsr1A | None | Info | NonLatch | All | The current value for the cumulative starts and or hours for the given compressor have been modified by a write override from TU. | NA |
| Starts or Hours Modified – Cprsr2A | None | Info | NonLatch | All | The current value for the cumulative starts and or hours for the given compressor have been modified by a write override from TU. | NA |
| Suction Rfgr Pressure Transducer – Cprsr1A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Suction Rfgr Pressure Transducer – Cprsr2A | Circuit | Immediate | Latch | All | Bad Sensor or LLID | Remote |
| Unexpected Shutdown – AFD1A | Circuit | Normal | Nonlatch | All Cprsr Running modes, Starting, Running and Preparing to Shutdown | The respective AFD status reported back that it is stopped when the MP thinks it should be running and no AFD shutdown diagnostic exists. This diagnostic will be logged in the active buffer and then automatically cleared. This diagnostic could be caused by intermittent communication problems from the AFD to the MP, or due to misbinding. | Remote |
| Unexpected Shutdown – AFD2A | Circuit | Normal | Nonlatch | All Cprsr Running modes, Starting, Running and Preparing to Shutdown | The respective AFD status reported back that it is stopped when the MP thinks it should be running and no AFD shutdown diagnostic exists. This diagnostic will be logged in the active buffer and then automatically cleared. This diagnostic could be caused by intermittent communication problems from the AFD to the MP, or due to misbinding. | Remote |
| Very Low Evaporator Rfgr Pressure – Ckt1 | Chiller | Immediate | Latch | All | The respective circuit's evaporator pressure dropped below 80% of the current Low Evap Refrig Press Cutout setting (see above) or 8 psia, whichever is less, regardless of the running state of the circuit's compressor. Note: Unlike previous products, even if the circuit associated with the suction pressure transducer is locked out, it will not defeat the protection afforded by this diagnostic. | Local |
| Very Low Evaporator Rfgr Pressure – Ckt2 | Chiller | Immediate | Latch | All | The respective circuit's evaporator pressure dropped below 80% of the current Low Evap Refrig Press Cutout setting (see above) or 8 psia, whichever is less, regardless of the running state of the circuit's compressor. Note: Unlike previous products, even if the circuit associated with the suction pressure transducer is locked out, it will not defeat the protection afforded by this diagnostic. | Local |

Communication Diagnostics

Notes:

- The following communication loss diagnostics will not occur unless that input or output is required to be present by the particular configuration and installed options for the chiller.
- Communication diagnostics are named by the Functional Name of the input or output that is no longer being heard from by the Main Processor. Many LLIDs, such as the Quad Relay LLID, have more than

one functional output associated with it. A comm loss with such a multiple function board, will generate multiple diagnostics. Refer to the Chiller's wiring diagrams to relate the occurrence of multiple communication diagnostics back to the physical LLID boards that they have been assigned to (bound).

Table 34. Communication diagnostics

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|---|----------------|-----------|-------------|-------------------------------|---|-------------|
| Comm Loss: AFD 1A Circuit | | Immediate | NonLatch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: AFD 2A Circuit | | Immediate | NonLatch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Chiller % Capacity Output | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Cond Fan Enable, Shared Ckt1&2 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. This is an info warning, as it is conceivable that the circuit may run without the center shared fan deck working if there are many other coils/fans on the circuits. | Remote |
| Comm Loss: Cond Rfgt Pressure, Ckt1 | Circuit | Immediate | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Cond Rfgt Pressure, Ckt2 | Circuit | Immediate | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Condenser Fan Enable, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Condenser Fan Enable, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Discharge Temperature, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Discharge Temperature, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Drive Cooling BP Valve, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Drive Cooling BP Valve, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Drive Cooling IL Valve, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Drive Cooling IL Valve, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Drive Cooling Sply Temp, Ckt1 | Circuit | Norma | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. While this diagnostic is active, the associated Drive Cooling ByPass Valve shall be commanded fully closed. | Remote |
| Comm Loss: Drive Cooling Sply Temp, Ckt2 | Circuit | Norma | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. While this diagnostic is active, the associated Drive Cooling ByPass Valve shall be commanded fully closed | Remote |



Diagnostics

Table 34. Communication diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|---------------------------------|-------------------------|-------------|-------------------------------|---|-------------|
| Comm Loss: Emergency Stop | Chiller | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Evap Rfgt Pool Temp, Ckt1 | Circuit and Chiller | Special Action and Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Note: The Evap Pool Temp Sensors are used for both On and Off -cycle freeze protection. Substitute Suction Pressure to Temperature conversion for freeze protection functions. | Remote |
| Comm Loss: Evap Rfgt Pool Temp, Ckt2 | Circuit and Chiller | Special Action and Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Note: The Evap Pool Temp Sensors are used for both On and Off -cycle freeze protection. Substitute Suction Pressure to Temperature conversion for freeze protection functions. | Remote |
| Comm Loss: Evaporator Entering Water Temperature | Chiller | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Note: Entering Water Temp Sensor is used in EXV pressure control as well as ice making & CHW reset, so it must cause a unit shutdown even if Ice or CHW reset is not installed. | Remote |
| Comm Loss: Evaporator Leaving Water Temperature | Chiller | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Evaporator Rfgt Liquid Level, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Evaporator Rfgt Liquid Level, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Evaporator Water Flow Switch | Chiller | Immediate | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Evaporator Water Pump Relay | Chiller | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Expansion Valve, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Expansion Valve, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Ext Noise Reduction Command | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: External Auto/Stop | Chiller | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: External Chilled/Hot Water Setpoint | External Chilled Water Setpoint | Special Action | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Chiller shall discontinue use of the External Chilled Water Setpoint source and revert to the next higher priority for setpoint arbitration | Remote |
| Comm Loss: External Ckt Lockout, Ckt1 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. MP will hold the last lockout state (enabled or disabled) that was in effect at the time of comm loss. | Remote |
| Comm Loss: External Ckt Lockout, Ckt2 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. MP will hold the last lockout state (enabled or disabled) that was in effect at the time of comm loss | Remote |
| Comm Loss: External Demand Limit Setpoint | External Current Limit setpoint | Special Action | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Chiller shall discontinue use of the External Current limit setpoint and revert to the next higher priority for Current Limit setpoint arbitration | Remote |

Table 34. Communication diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|--|-----------------|-----------------|-------------|-------------------------------|---|-------------|
| Comm Loss: External Ice Building Command | Ice Making Mode | Special Action | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Chiller shall revert to normal (non-ice building) mode regardless of last state. | Remote |
| Comm Loss: Fan Inverter Fault, Ckt1 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period | Remote |
| Comm Loss: Fan Inverter Fault, Ckt2 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Fan Inverter Speed Cmd, Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Fan Inverter Speed Cmd, Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Fan Inverter Speed Cmd, Shared Ckt1&2 | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. This is an info warning, as it is conceivable that the circuit may run without the center shared fan deck working if there are many other coils/fans on the circuits. | |
| Comm Loss: Heat/Cool Switch | Heat Mode | Special Action | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Chiller shall revert to normal (non-ice building) mode regardless of last state. | Remote |
| Comm Loss: Ice-Making Status | Ice-Machine | Special Action | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Chiller shall revert to normal (non-ice building) mode regardless of last state. | Remote |
| Comm Loss: Local BAS Interface | Chiller | Info | NonLatch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Use last valid BAS setpoints. Diagnostic is cleared when successful communication is established with the LonTalk LLID (LCIC) or BACnet LLID (BCIC). | Remote |
| Comm Loss: Off-cycle Freeze Protection Relay | Chiller | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Oil Loss Level Sensor Input – Ckt1 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Oil Loss Level Sensor Input – Ckt2 | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Oil Pressure, Cprsr1A | Circuit | Immediate | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Oil Pressure, Cprsr2A | Circuit | Immediate | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Op Status Programmable Relays | None | Info | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. | Remote |
| Comm Loss: Outdoor Air Temperature | Chiller | Normal Shutdown | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. For RTAE if this diagnostic occurs, operational pumpdown will be performed regardless of the last valid temperature | Remote |
| Comm Loss: Suction Rfgt Pressure, Ckt1 | Circuit | Immediate | Latch | All [Ckt/Cprsr lock out] | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Note: This diagnostic is replaced by diagnostic 5FB below with Rev 15.0 | Remote |
| Comm Loss: Suction Rfgt Pressure, Ckt2 | Circuit | Immediate | Latch | All [Ckt/Cprsr lock out] | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period. Note: This diagnostic is replaced by diagnostic 5FD below with Rev 15.0 | Remote |



Diagnostics

Table 34. Communication diagnostics (continued)

| Diagnostic Name | Affects Target | Severity | Persistence | Active Modes [Inactive Modes] | Criteria | Reset Level |
|------------------------------------|----------------|----------|-------------|-------------------------------|--|-------------|
| Comm Loss: Winding Temp 1, Cprsr1A | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period | Remote |
| Comm Loss: Winding Temp 1, Cprsr2A | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period | Remote |
| Comm Loss: Winding Temp 2, Cprsr2A | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period | Remote |
| Comm Loss: Winding Temp 2, Cprsr1A | Circuit | Normal | Latch | All | Continual loss of communication between the MP and the Functional ID has occurred for a 30 second period | Remote |

Operator Display Diagnostics and Messages

Table 35. Operator display diagnostics and messages

| Operator Display Message | Description //Troubleshooting |
|---|---|
| Communication Lost with UC800 | <ul style="list-style-type: none"> Ethernet cable not connected between display and UC800. UC800 not powered. UC800 has an invalid configuration – Download a valid configuration UC800 is in Binding View. When exit Binding View, select 'Restart' on this message |
| Display Failed to Establish Communication | <ul style="list-style-type: none"> Ethernet cable not connected between display and UC800. UC800 not powered. UC800 just has the backup application running as received from the vendor. Download CTV application software. UC800 has an invalid configuration – Download a valid configuration |
| Display is about to Restart | <ul style="list-style-type: none"> The display is low on memory, and needs to re-start. Select Yes to restart. Selecting Yes will not affect the UC800 operation. Only the Operator Display is reset. |
| File Not Found | <ul style="list-style-type: none"> Update UC800 software with Tracer TU. |
| Screen partially populated. Auto and Stop button graphics display, no text. | <ul style="list-style-type: none"> Valid configuration is not present. Download a configuration. |
| Screen Unresponsive | <ul style="list-style-type: none"> TU is downloading software. Wait till download is complete. |
| The Page Cannot be found | <ul style="list-style-type: none"> Most likely this UC800 has only the backup application. Download the latest UC 800 software build. This could also mean that the UC800 does not have a valid configuration. Download a configuration to it. Cycle power to the OD and UC800. UC could be in binding view. If so, get it out of binding view by navigating to another screen in TU. |
| UC800 Configuration is Invalid | <ul style="list-style-type: none"> Update the UC800 configuration with TU. |

Unit Wiring

Table 36 provides a list of electrical schematics, field wiring diagrams and connection diagrams for RTAE units. Complete wiring package is documented in

RTAE-SVE001*-EN. A laminated wiring diagram booklet is also shipped with each RTAE unit.

Table 36. RTAE unit wiring drawing numbers

| Drawing Number | Description | |
|-----------------------------------|----------------------------------|--------------------------------|
| Single Circuit Units | | |
| 2311-1954 | Schematic Diagram | |
| 5724-4483 | Fan Location Diagram | |
| 5724-4473 | Assembly; Sensor Routing | |
| 2311-1965 | Panel Component Location Diagram | |
| 2311-1966 | Field Wiring Diagram | |
| 2311-1964 | Field Layout Diagram | |
| Dual Circuit Units ^(a) | | |
| 2311-1960 | Schematic Diagram | Dual Circuit without CE option |
| 2311-1980 | Schematic Diagram | Dual Circuit with CE option |
| 5724-2731 | Fan Location Diagram | |
| 5724-2721 | Assembly; Sensor Routing | |
| 2311-1963 | Panel Component Location Diagram | Dual Circuit without CE option |
| 5724-4573 | Panel Component Location Diagram | Dual Circuit with CE option |
| 2311-1961 | Field Wiring Diagram | Dual Circuit without CE option |
| 2311-1967 | Field Wiring Diagram | Dual Circuit with CE option |
| 2311-1962 | Field Layout Diagram | |

(a) Dual circuit units with CE option will be indicated by unit model number digit 13=3.



Log and Check Sheet

The operator log and check sheet are included for use as appropriate, for installation completion verification before Trane start-up is scheduled, and for reference during the Trane start-up.

Where the log or check sheet also exists outside of this publication as standalone literature, the literature order number is also listed.

- Stealth™ RTAE Installation Completion Check Sheet and Request for Trane Service (RLC-ADF002-EN)
- Operator Log



Stealth™ RTAE Installation Completion Check Sheet and Request for Trane Service

Important: A copy of this completed form must be submitted to the Trane service agency that will be responsible for the start-up of the chiller. Start-up will NOT proceed unless applicable items listed in this form have been satisfactorily completed.

| | |
|---|-----------------------|
| To: | Trane Service Office: |
| S.O. Number: | Serial Numbers: |
| Job/Project Name: | |
| Address: | |
| The following items are being installed and will be completed by: | |

Important: Start-up must be performed by Trane or an agent of Trane specifically authorized to perform start-up of Trane® products. Contractor shall provide Trane (or an agent of Trane specifically authorized to perform start-up) with notice of the scheduled start-up at least two weeks prior to the scheduled start-up.

Check boxes if the task is complete or if the answer is "yes."

1. Chiller

- Installation meets foundation requirements.
- In place and piped.
- Isolation pads or elastomeric pads installed (optional).

2. Piping

- Water piping flushed before making final connections to the system
- Chilled water piping connected to:
 - Evaporator
 - Air handling units
 - Pumps
 - Flow switch or flow proving device installed (if not factory provided)
 - Strainer installed and cleaned
- Water supply connected to filling system
- Systems filled
- Pumps run, air bled from system
- Strainer installed and cleaned
- Relief valve ventilation piping installed (if applicable)

3. Flow balancing valves installed

- Leaving chilled water
- Leaving condenser water (if applicable)
- Optional heat recovery or auxiliary condenser water (if applicable)

4. Gauges, thermometers, and air vents

- Installed on both sides of evaporator

5. Wiring

- Wire size per submittal and NEC
- Full power available
- Interconnecting wiring, starter to panel (as required)
- External interlocks (flow switch, pumps auxiliary, etc.)
- Chilled water pump (connected and tested)
- 115 Vac power available for service tools
- All controls installed and connected
- All magnetic starters installed and connected

6. Testing

- Dry nitrogen available for pressure testing
- Trace gas amounts of R-410A or R-134a available for leak testing, if necessary

7. Refrigerant on job site (if nitrogen charge option, model number digit 15 = 2, is chosen)

8. Systems can be operated under load conditions

9. Heaters

- If unit was factory charged (model number digit 15 = 1), energize heaters for 24 hours prior to start up.
Important: *It is required that chiller heaters are energized for a minimum of 24 hours prior to start up. Therefore, chiller should have power for this amount of time before Trane Service arrives to do start-up.*
- If unit has nitrogen charge (model number digit 15 = 2), contact Trane Service for unit charging prior to start-up.
Important: *Do NOT apply shore power to unit with nitrogen charge. Shore power will drive EXV valves, inhibiting ability to adequately vac and charge unit.*

10. Equipment room

- Does the equipment room have a refrigerant monitor/sensor capable of monitoring and alarming within the allowable exposure level of the refrigerant?
- Does the installation have properly placed and operating audible and visual refrigerant alarms?
- Does the equipment room have proper mechanical ventilation?
- If it is required by local code, is a self-contained breathing apparatus available?

11. Owner awareness

- Has the owner been fully instructed on the proper use of refrigerant?
- Does the owner have a copy of the MSDS for refrigerant?
- Was the owner given a copy of the Refrigerant Handling Guidelines?

Note: *Additional time required to properly complete the start-up and commissioning, due to any incompleteness of the installation, will be invoiced at prevailing rates.*

This is to certify that the Trane® equipment has been properly and completely installed, and that the applicable items listed above have been satisfactorily completed.

Checklist completed by: _____

Signed: _____ Date: _____

In accordance with your quotation and our purchase order number _____, we will therefore require the presence of Trane service on this site, for the purpose of start-up and commissioning, by _____ (date).

Note: *Minimum two-week advance notification is required to allow scheduling of the chiller start-up.*

Additional comments/instructions: _____

Note: *A copy of this completed form must be submitted to the Trane Service Office that will be responsible for start-up of chiller.*

Stealth, Trane and the Trane logo are trademarks or registered trademarks of Trane in the United States and other countries.



Trane optimizes the performance of homes and buildings around the world. A business of Ingersoll Rand, the leader in creating and sustaining safe, comfortable and energy efficient environments, Trane offers a broad portfolio of advanced controls and HVAC systems, comprehensive building services, and parts. For more information, visit www.Trane.com.

Trane has a policy of continuous product and product data improvement and reserves the right to change design and specifications without notice.





Operator Log

Stealth™ RTAE Chiller with UC800 Controller - Tracer AdaptiView Reports - Log Sheet

| | Start | 15 minutes | 30 minutes | 1 hour |
|--|-------|------------|------------|--------|
| Evaporator | | | | |
| Active Chilled Water Setpoint | | | | |
| Entering Water Temperature | | | | |
| Leaving Water Temperature | | | | |
| Ckt 1 | | | | |
| Saturated Refrigerant Temperature (°F) | | | | |
| Refrigerant Pressure (psia) | | | | |
| Approach Temperature (°F) | | | | |
| Water Flow Status | | | | |
| Spillover Tank Liquid Level (in) | | | | |
| EXV % Open | | | | |
| Ckt 2 | | | | |
| Saturated Refrigerant Temperature (°F) | | | | |
| Refrigerant Pressure (psia) | | | | |
| Approach Temperature (°F) | | | | |
| Water Flow Status | | | | |
| Spillover Tank Liquid Level (in) | | | | |
| EXV % Open | | | | |
| Condenser | | | | |
| Outdoor Air Temperature | | | | |
| Ckt 1 | | | | |
| Air Flow % | | | | |
| Saturated Refrigerant Temperature (°F) | | | | |
| Refrigerant Pressure (psia) | | | | |
| Ckt 2 | | | | |
| Air Flow % | | | | |
| Saturated Refrigerant Temperature (°F) | | | | |
| Refrigerant Pressure (psia) | | | | |
| Compressor 1A | | | | |
| Running Status | | | | |
| Starts | | | | |
| Running Time (Hr:Min) | | | | |
| Oil Pressure (psia) | | | | |
| Motor 1A | | | | |
| Active Demand Limit Setpoint | | | | |
| Average Motor Current (%) | | | | |
| Percent Speed | | | | |
| AFD Average Input Current (Amps) | | | | |
| AFD Average Input Voltage (Volts) | | | | |
| AFD Input Power (kW) | | | | |
| AFD Output Power (kW) | | | | |
| AFD Speed (rpm) | | | | |
| Compressor 2A | | | | |
| Running Status | | | | |
| Starts | | | | |
| Running Time (Hr:Min) | | | | |
| Oil Pressure (psia) | | | | |
| Motor 2A | | | | |
| Active Demand Limit Setpoint | | | | |
| Average Motor Current (%) | | | | |
| Percent Speed | | | | |
| AFD Average Input Current (Amps) | | | | |
| AFD Average Input Voltage (Volts) | | | | |
| AFD Input Power (kW) | | | | |
| AFD Output Power (kW) | | | | |
| AFD Speed (rpm) | | | | |

Date:

Technician:

Owner:



Trane optimizes the performance of homes and buildings around the world. A business of Ingersoll Rand, the leader in creating and sustaining safe, comfortable and energy efficient environments, Trane offers a broad portfolio of advanced controls and HVAC systems, comprehensive building services, and parts. For more information, visit www.Trane.com.

Trane has a policy of continuous product and product data improvement and reserves the right to change design and specifications without notice.